










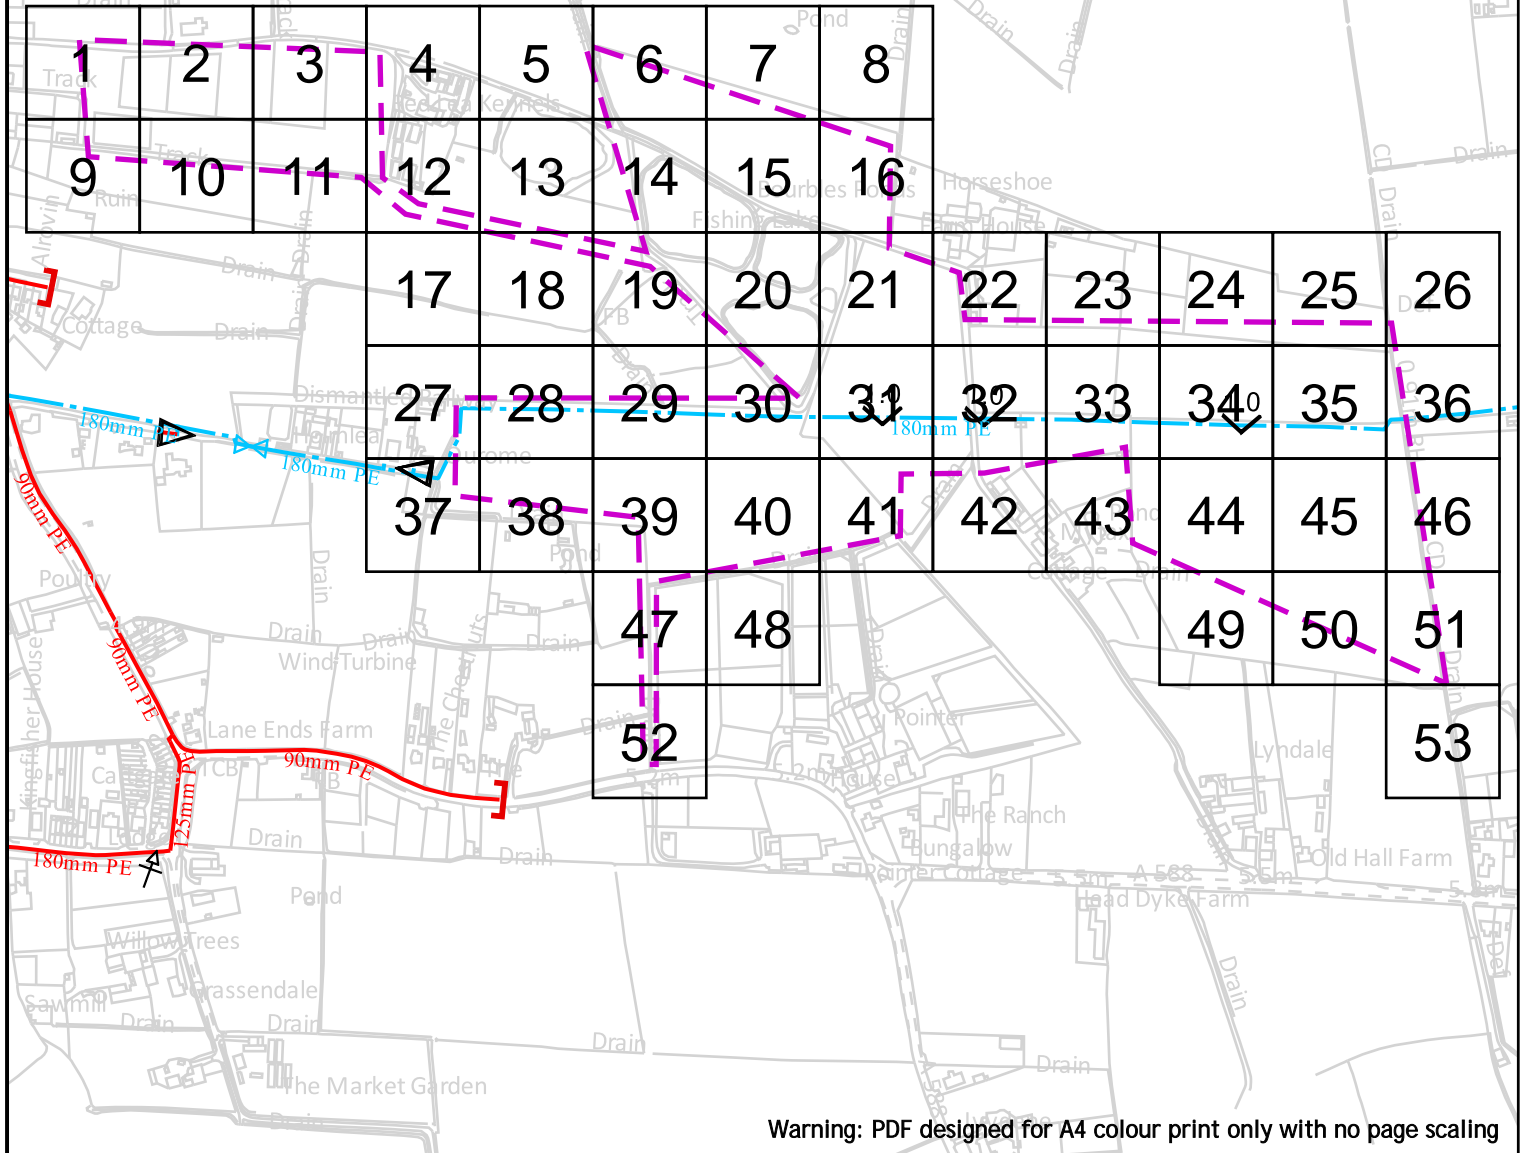




























# Overview map of worksite



Warning: PDF designed for A4 colour print only with no page scaling

	<table border="0"> <tr> <td><b>Dig Sites</b></td> <td>Area: </td> <td>Line: </td> <td></td> </tr> <tr> <td></td> <td>LP Mains</td> <td></td> <td>Valve</td> </tr> <tr> <td></td> <td>MP Mains</td> <td></td> <td>Depth of cover</td> </tr> <tr> <td></td> <td>IP Mains</td> <td></td> <td>Syphon</td> </tr> <tr> <td></td> <td>LHP Mains</td> <td></td> <td>Diameter Change</td> </tr> <tr> <td></td> <td></td> <td></td> <td>Material Change</td> </tr> <tr> <td></td> <td></td> <td></td> <td>Out of Standard Service</td> </tr> </table>	<b>Dig Sites</b>	Area: 	Line: 			LP Mains		Valve		MP Mains		Depth of cover		IP Mains		Syphon		LHP Mains		Diameter Change				Material Change				Out of Standard Service
<b>Dig Sites</b>	Area: 	Line: 																											
	LP Mains		Valve																										
	MP Mains		Depth of cover																										
	IP Mains		Syphon																										
	LHP Mains		Diameter Change																										
			Material Change																										
			Out of Standard Service																										
<p>Date Requested: 24/08/2023                  Job Reference: 30622849                  Site Location: 337833 447563                  Requested by: Mr James Parker</p> <p>Your Scheme/Reference:                  LCC/2023/0030/JMH (JP)</p> <p>View extent: 100m, 100m</p> <p>Scale: 1:6663 (When plotted at A4)</p>	<p><b>IMPORTANT NOTICES</b></p> <p>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p> <p style="text-align: center;"><b>In case of emergency call - 0800 111 999</b></p> <p><small>Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886</small></p>																												



25m

<b>Dig Sites</b>	<b>Area:</b>	<b>Line:</b>	
	LP Mains		Valve
	MP Mains		Depth of cover
	IP Mains		Syphon
	LHP Mains		Diameter Change
			Material Change
			Out of Standard Service



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker  
 Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)  
 View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**



Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

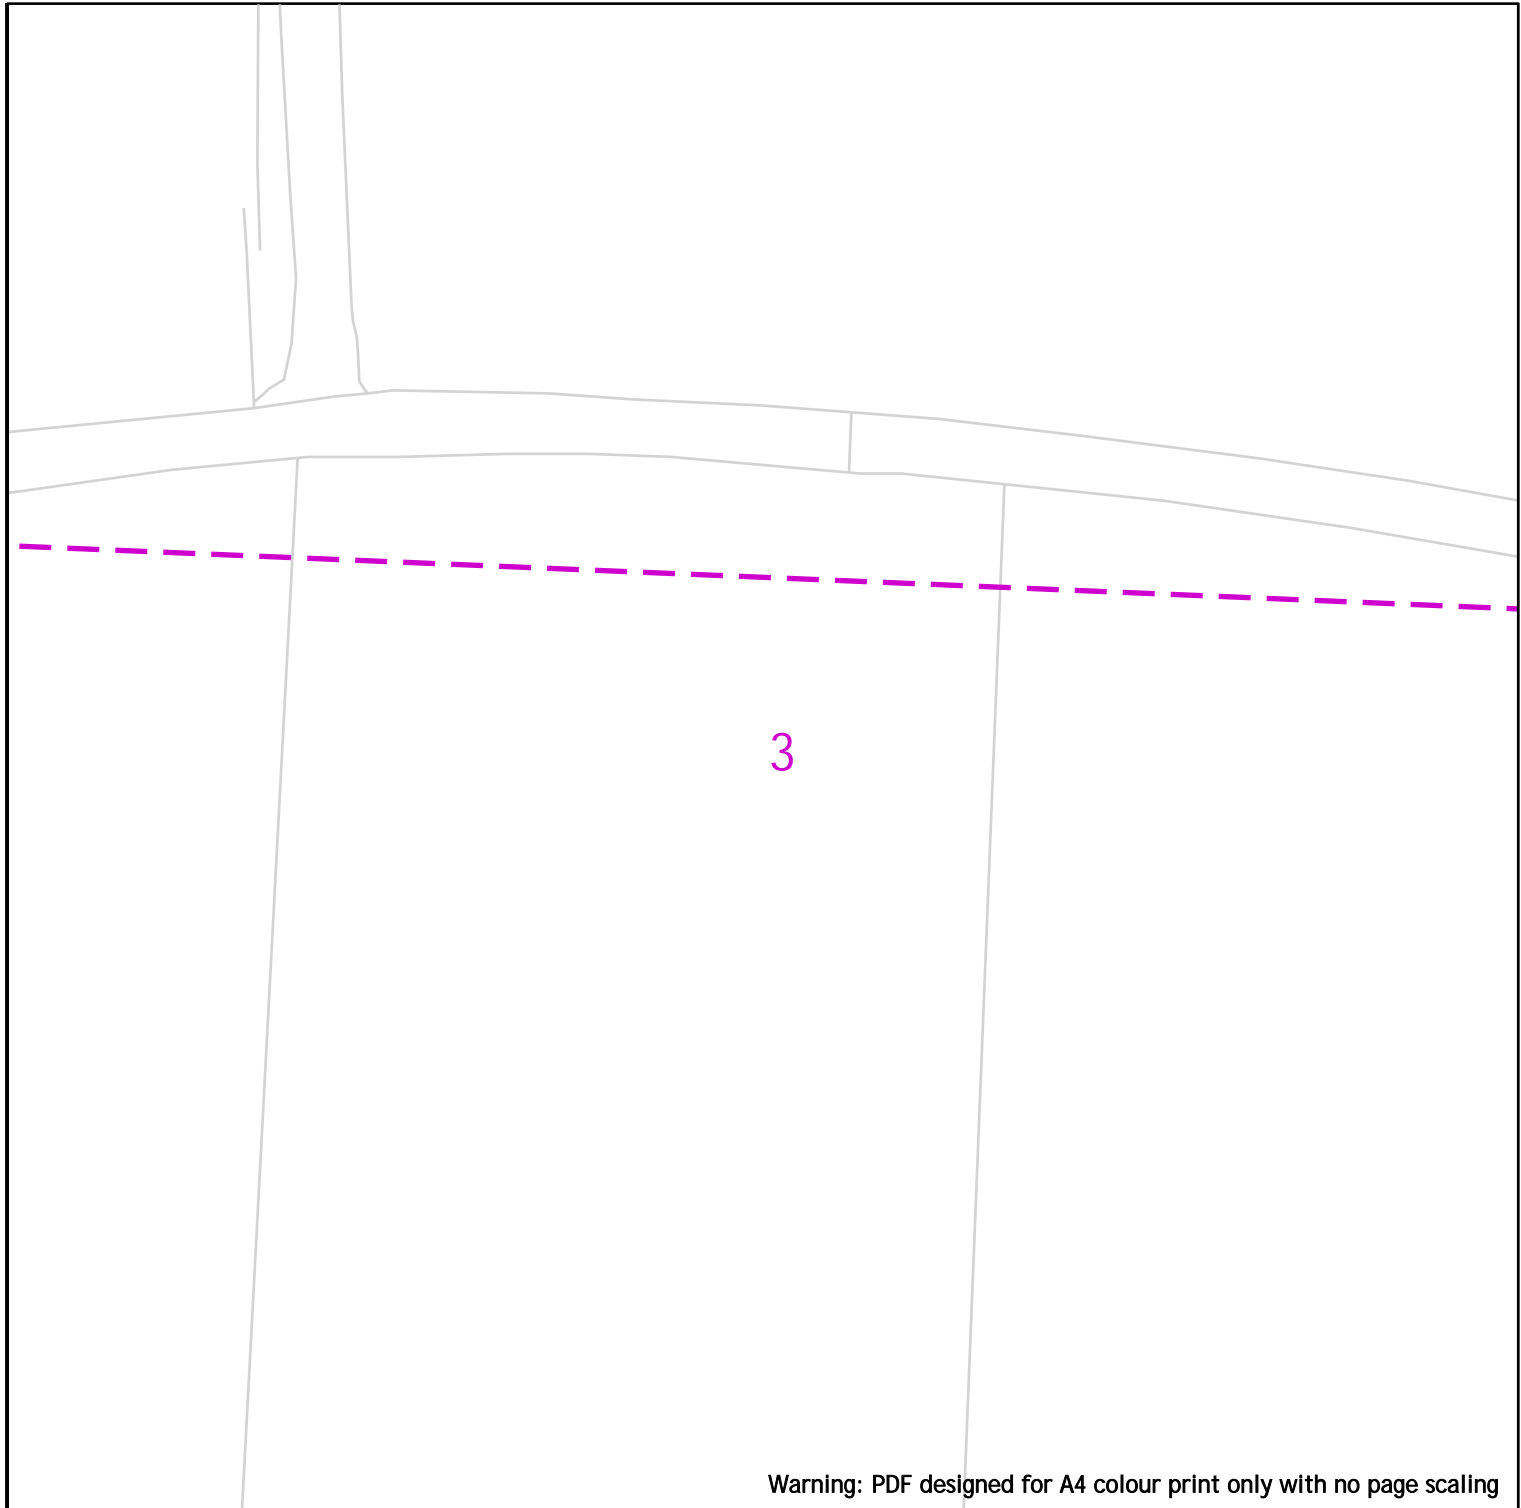

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)



View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

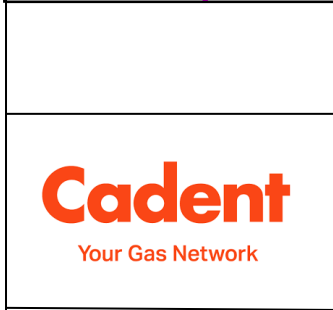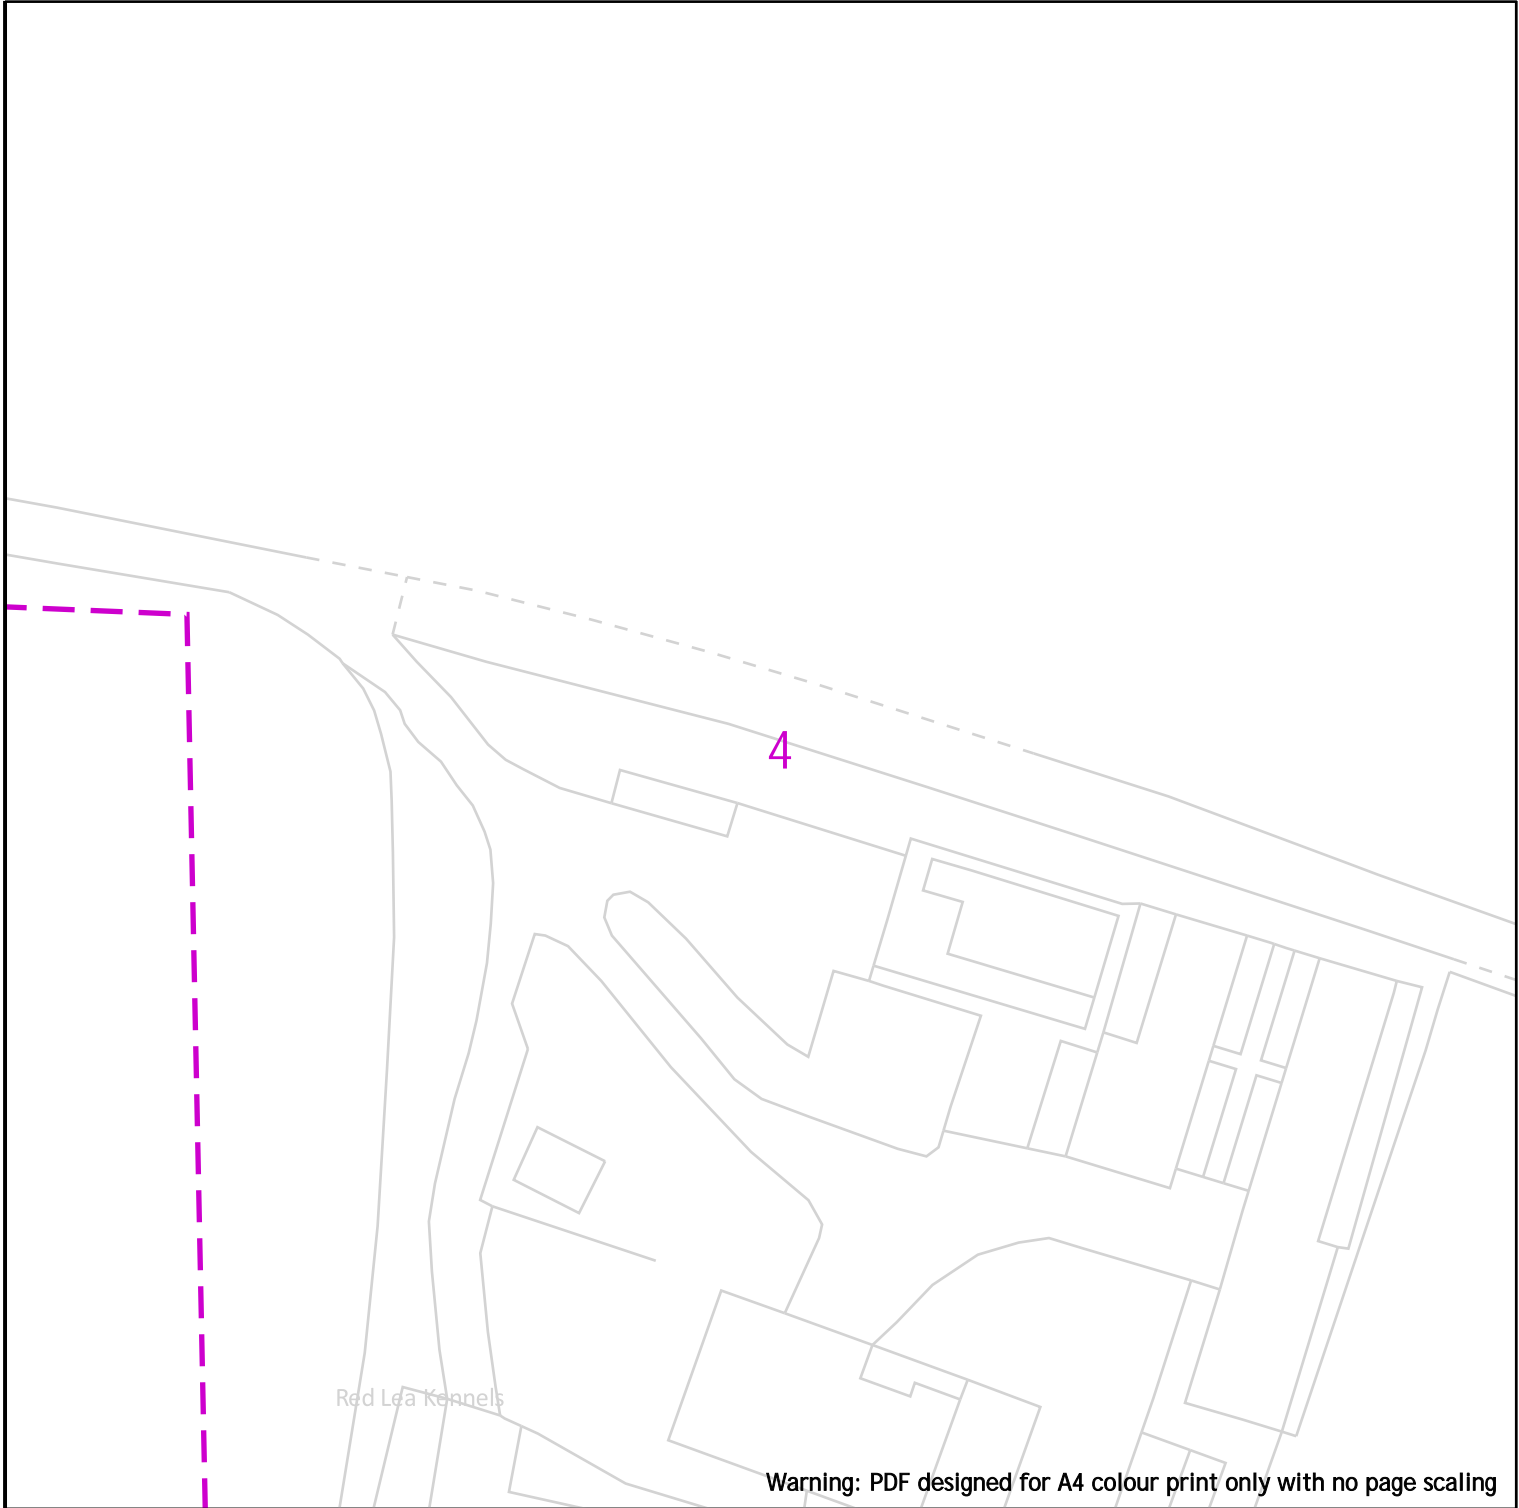

**25m**

<b>Dig Sites</b>	<b>Area:</b>	<b>Line:</b>		
	LP Mains			Valve
	MP Mains			Depth of cover
	IP Mains			Syphon
	LHP Mains			Diameter Change
				Material Change
				Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker


Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

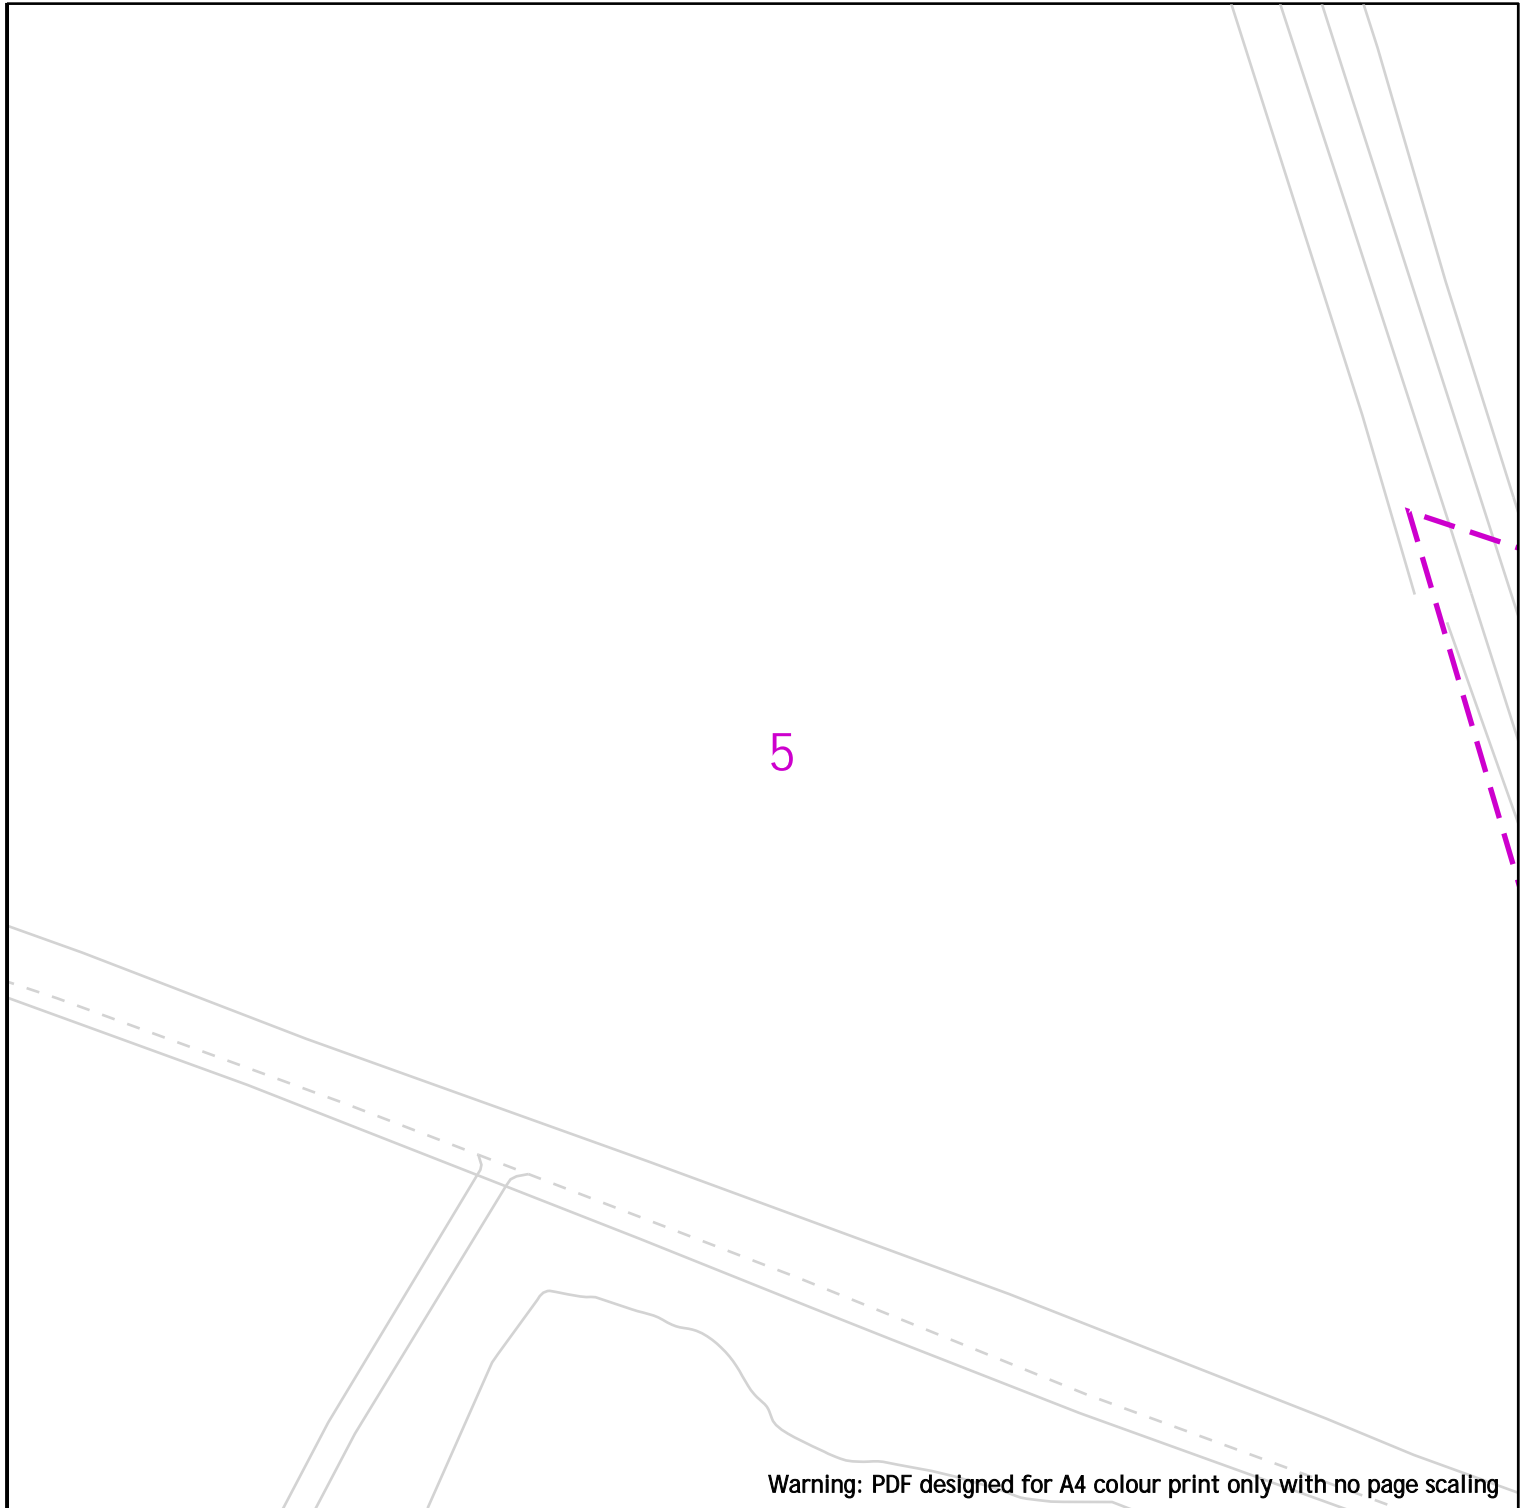

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:

- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

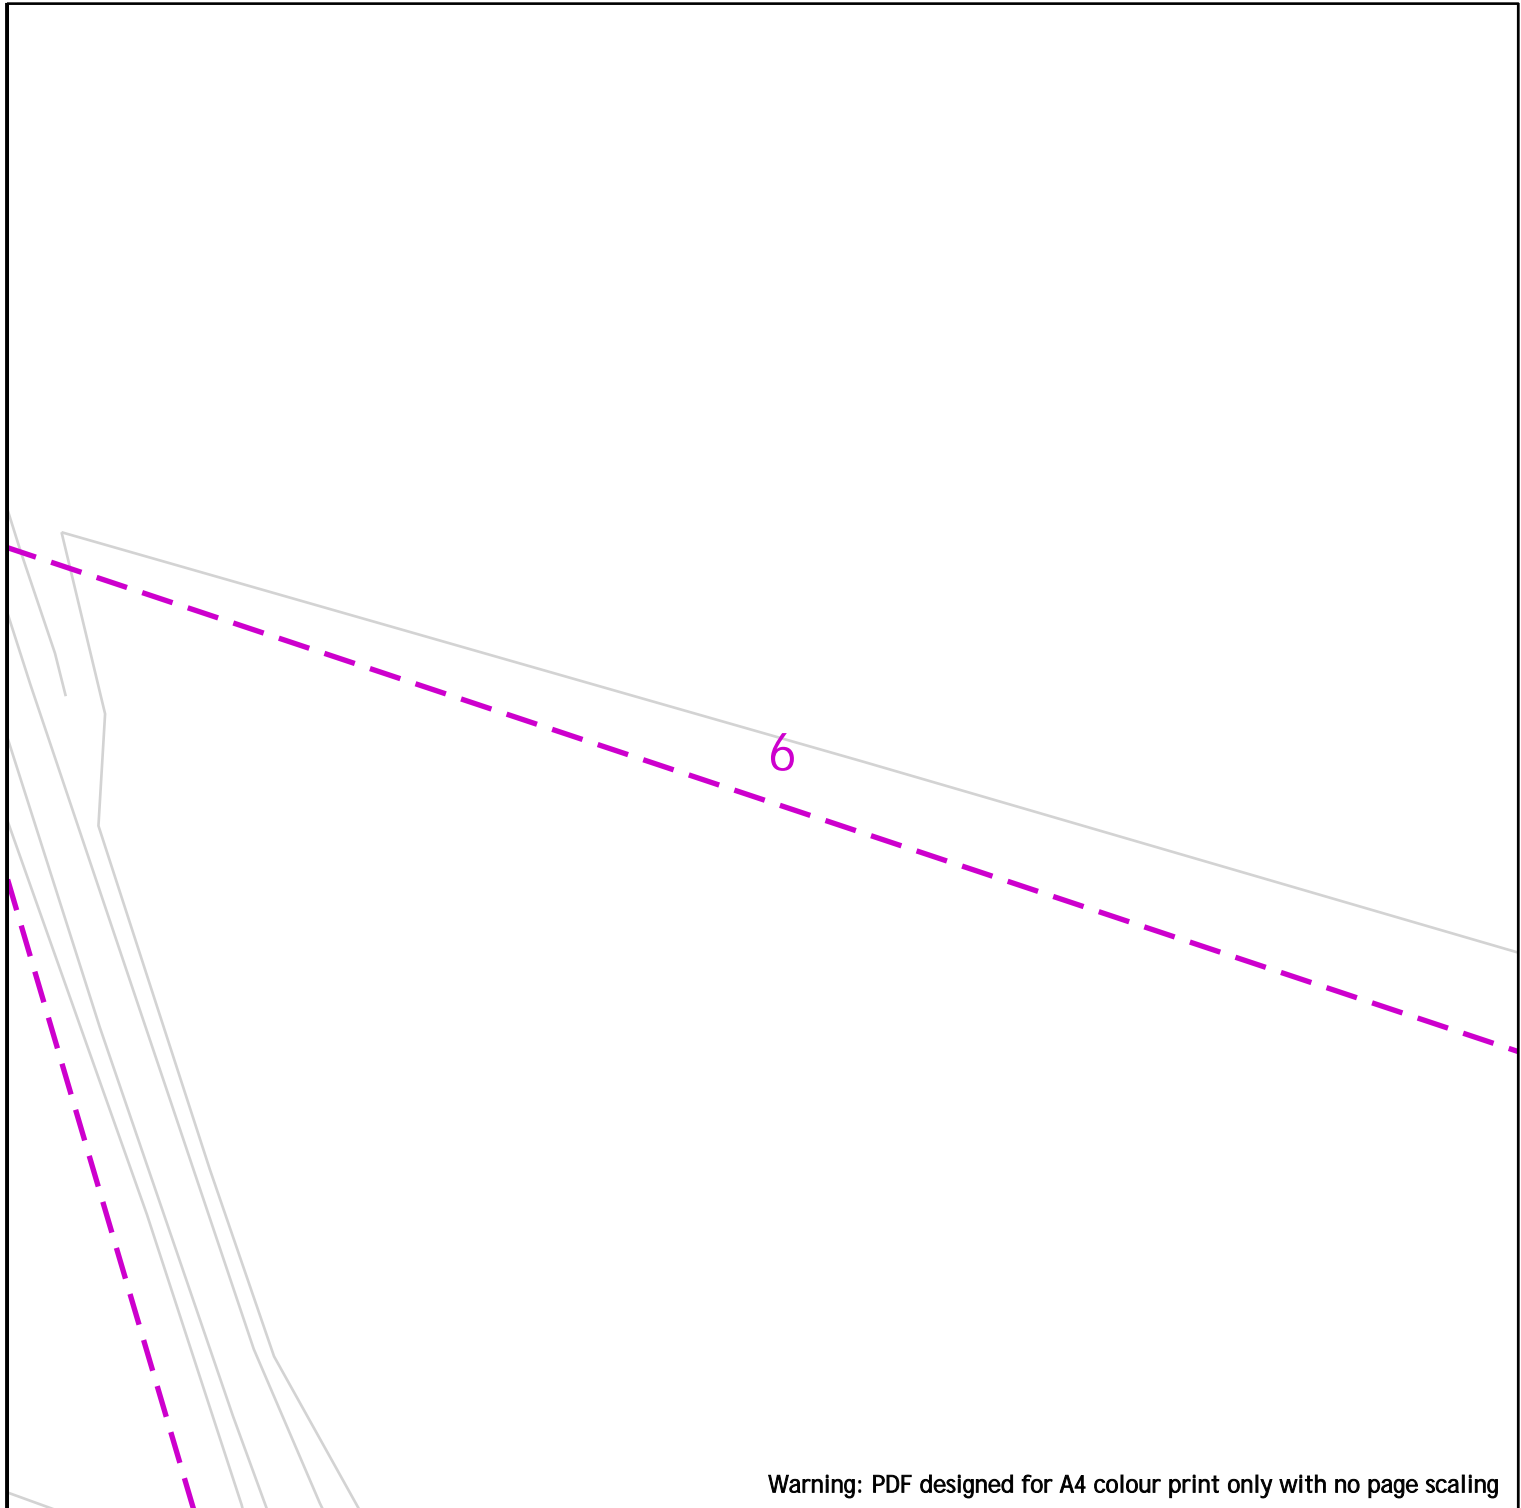











Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)













7

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- |   |           |   |                |   |                         |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |   |                |   |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.


Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)



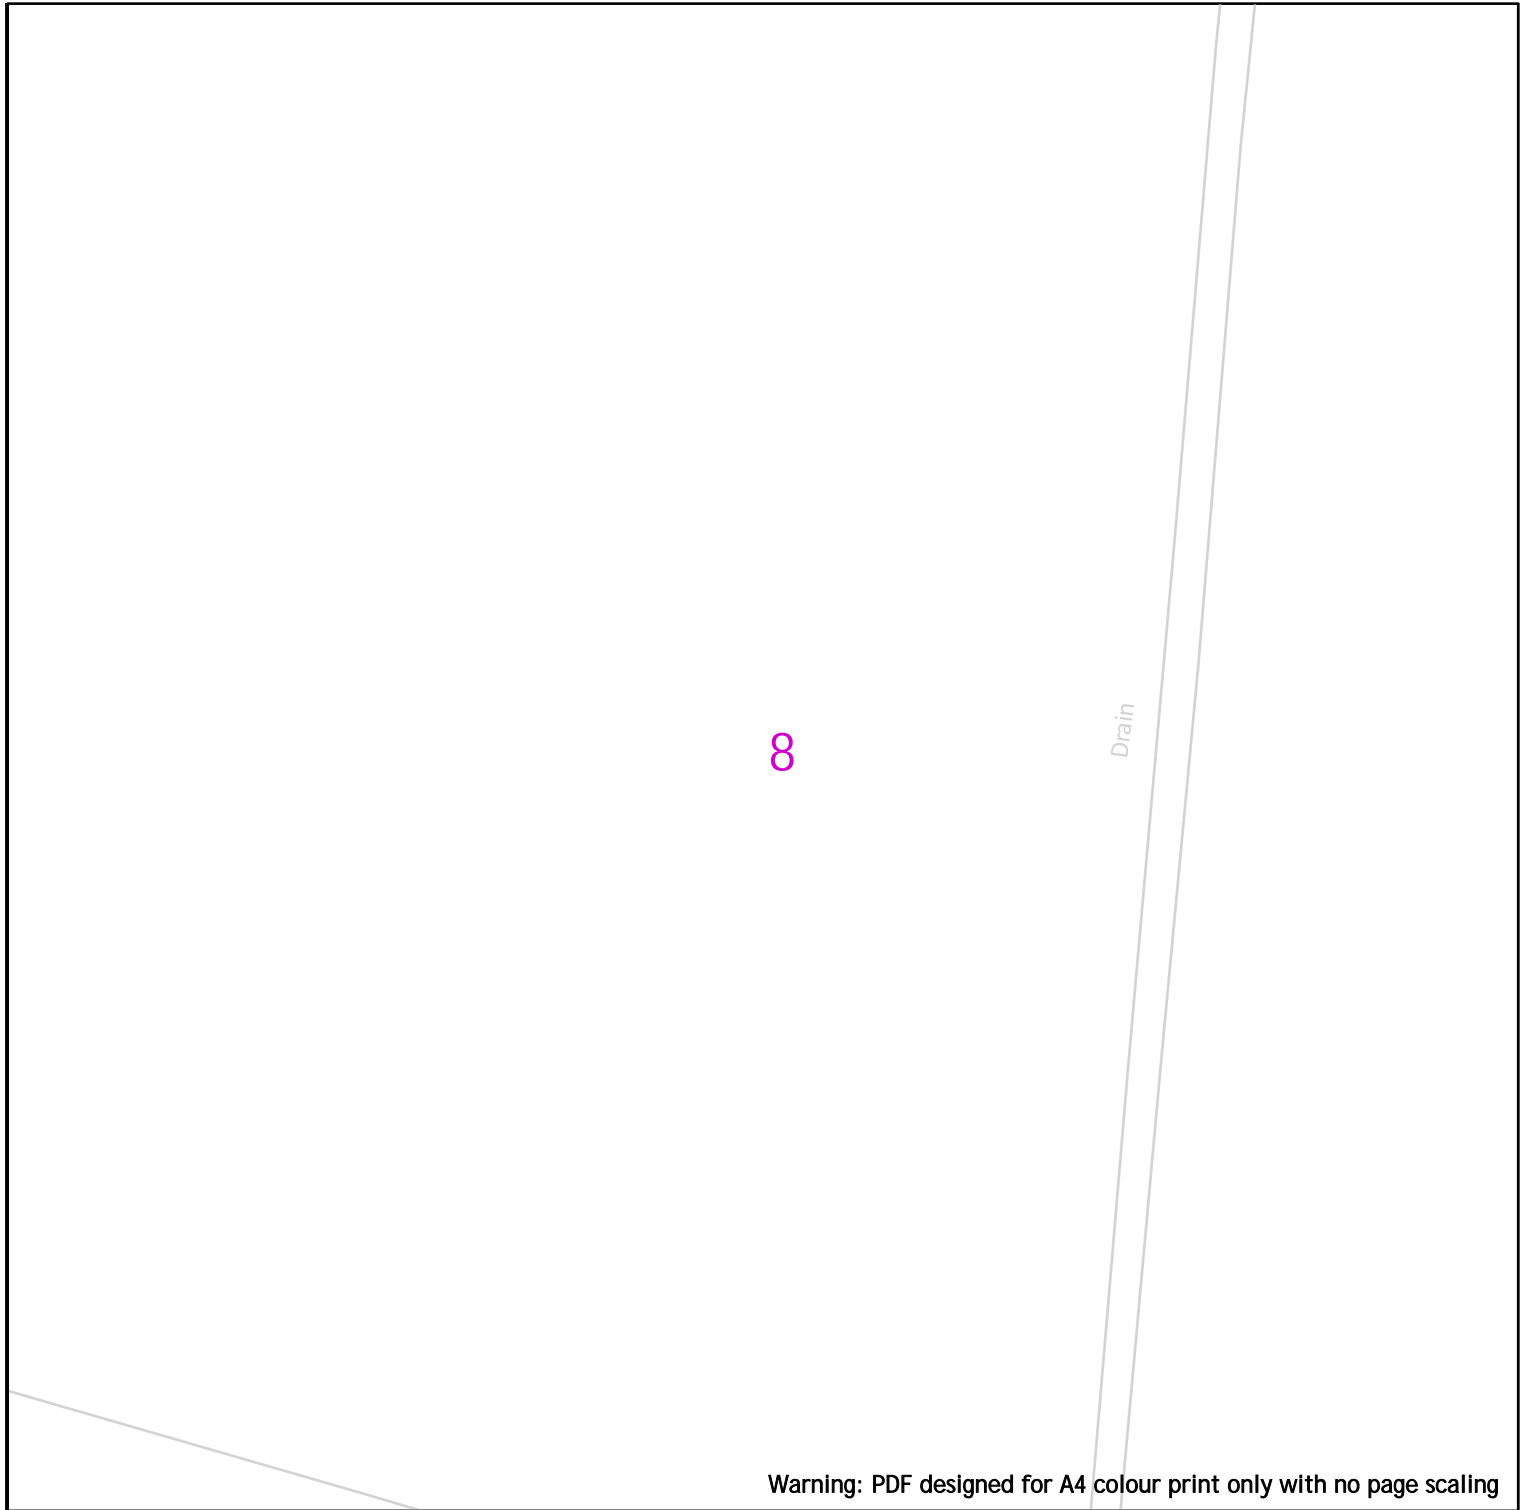











Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**


This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.





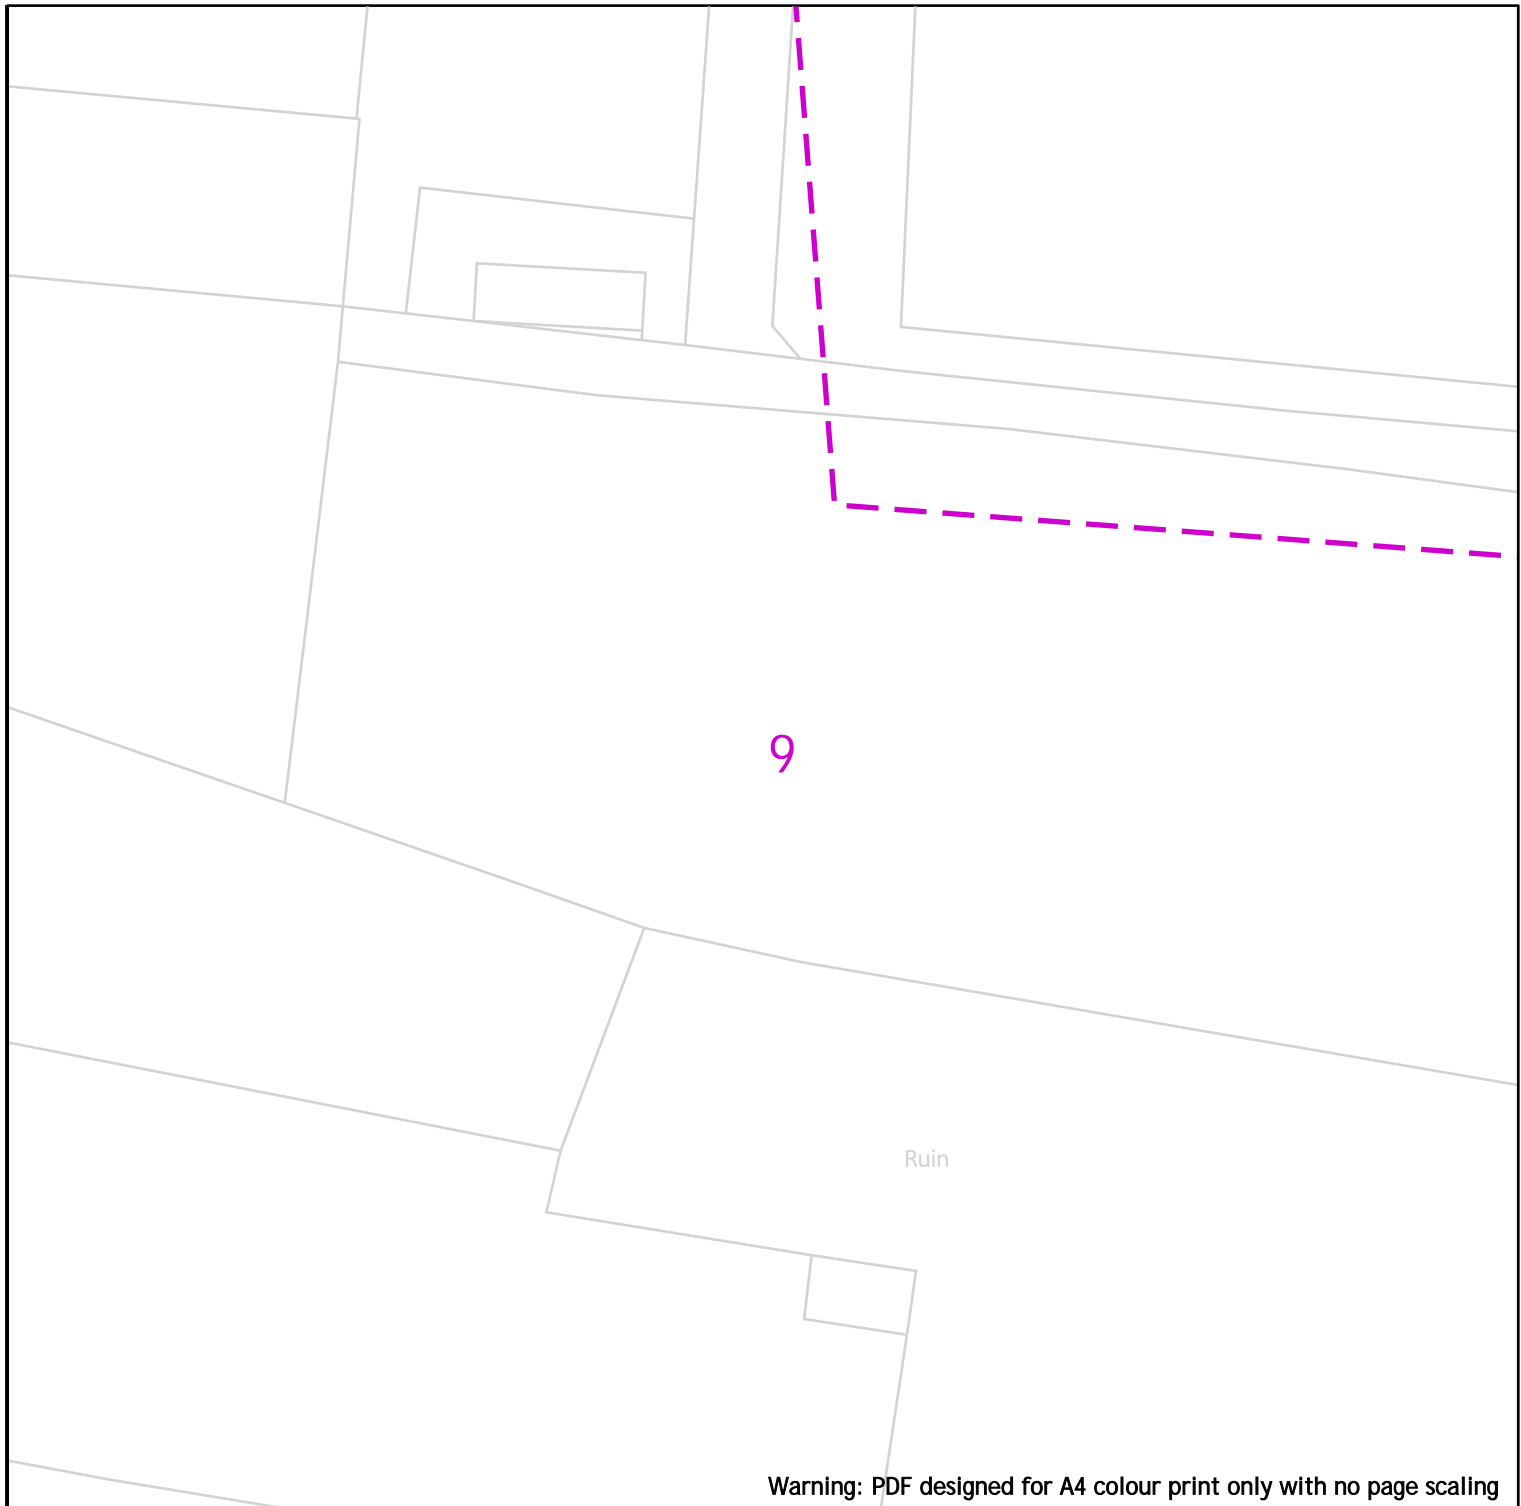







**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)



Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites	Area: 	Line: 		
	LP Mains			Valve
	MP Mains			Depth of cover
	IP Mains			Syphon
	LHP Mains			Diameter Change
				Material Change
				Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker


Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

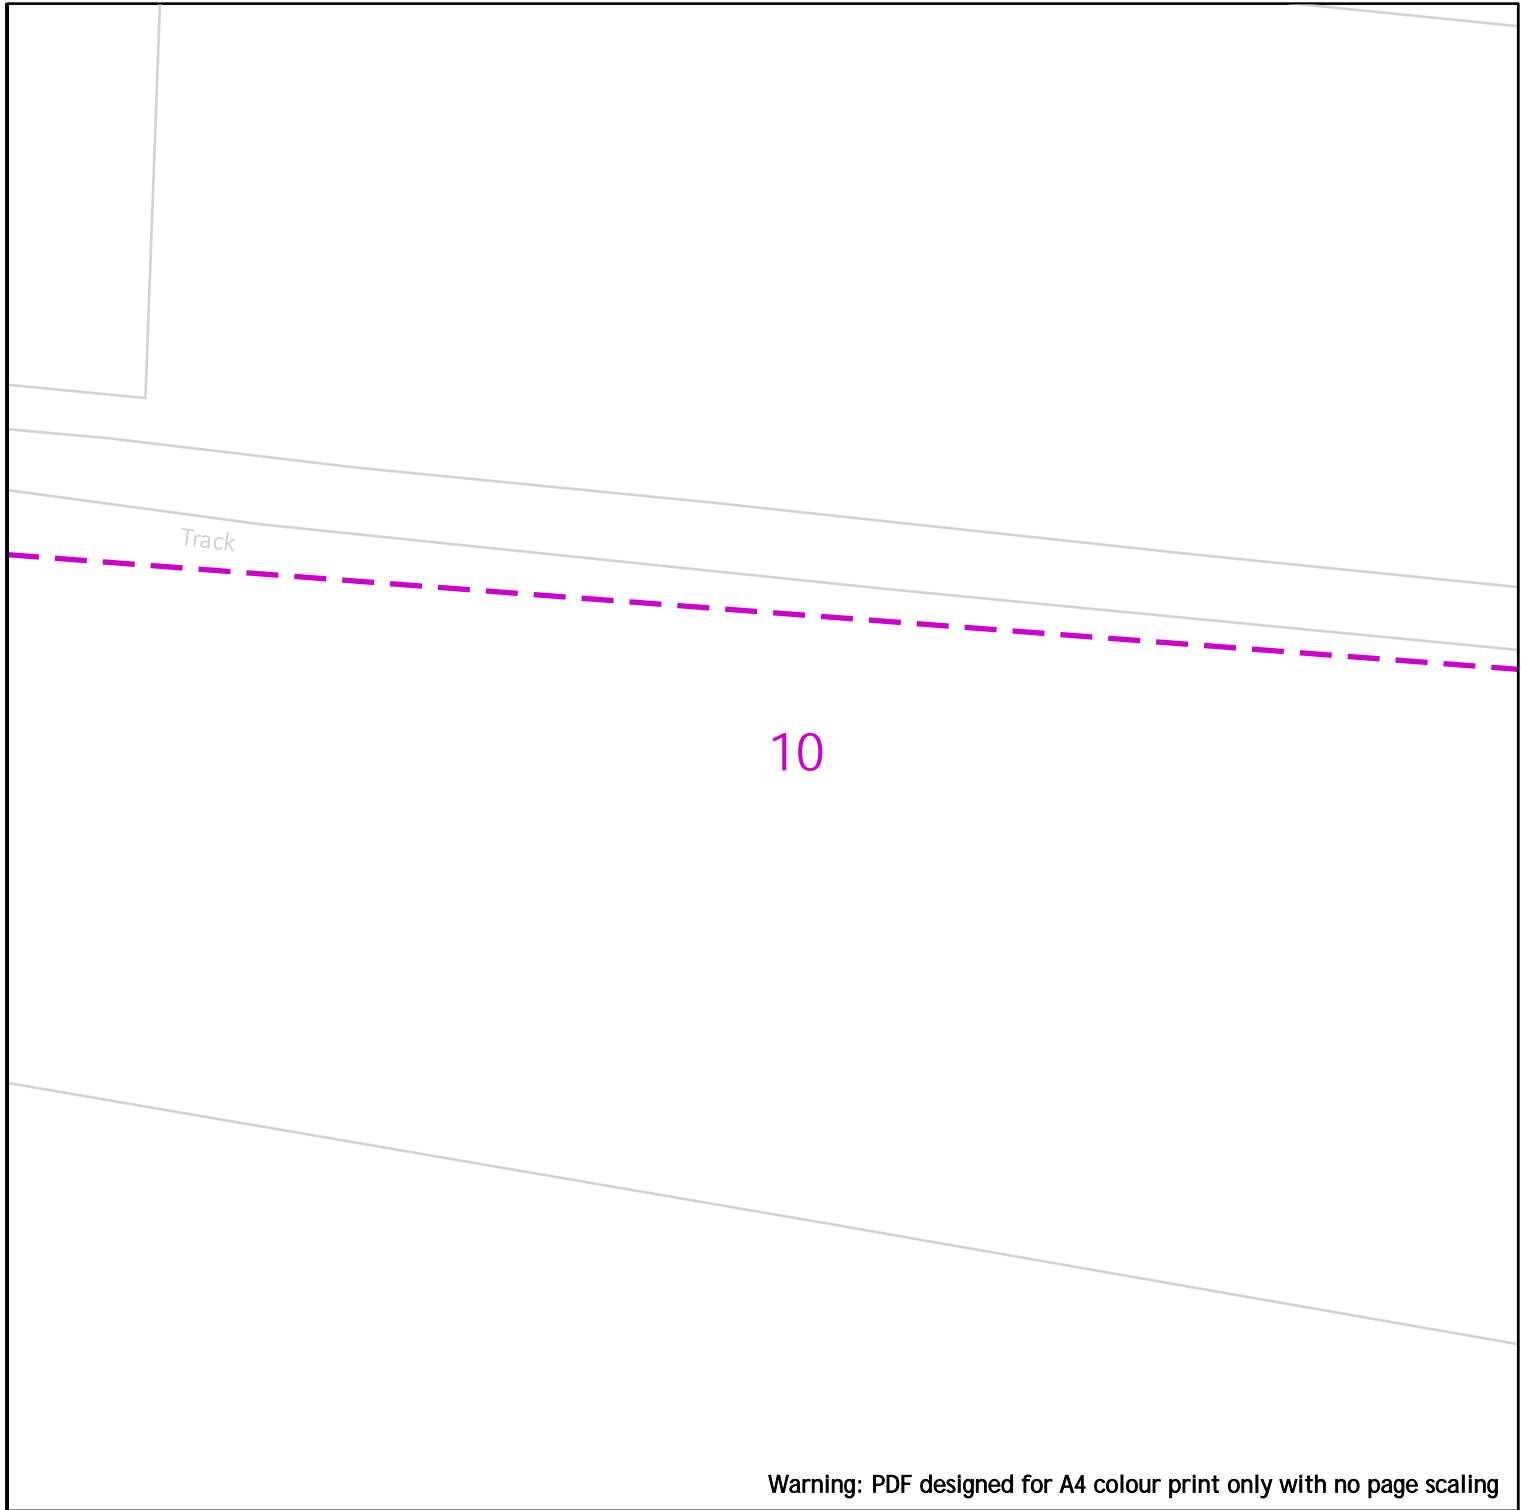

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

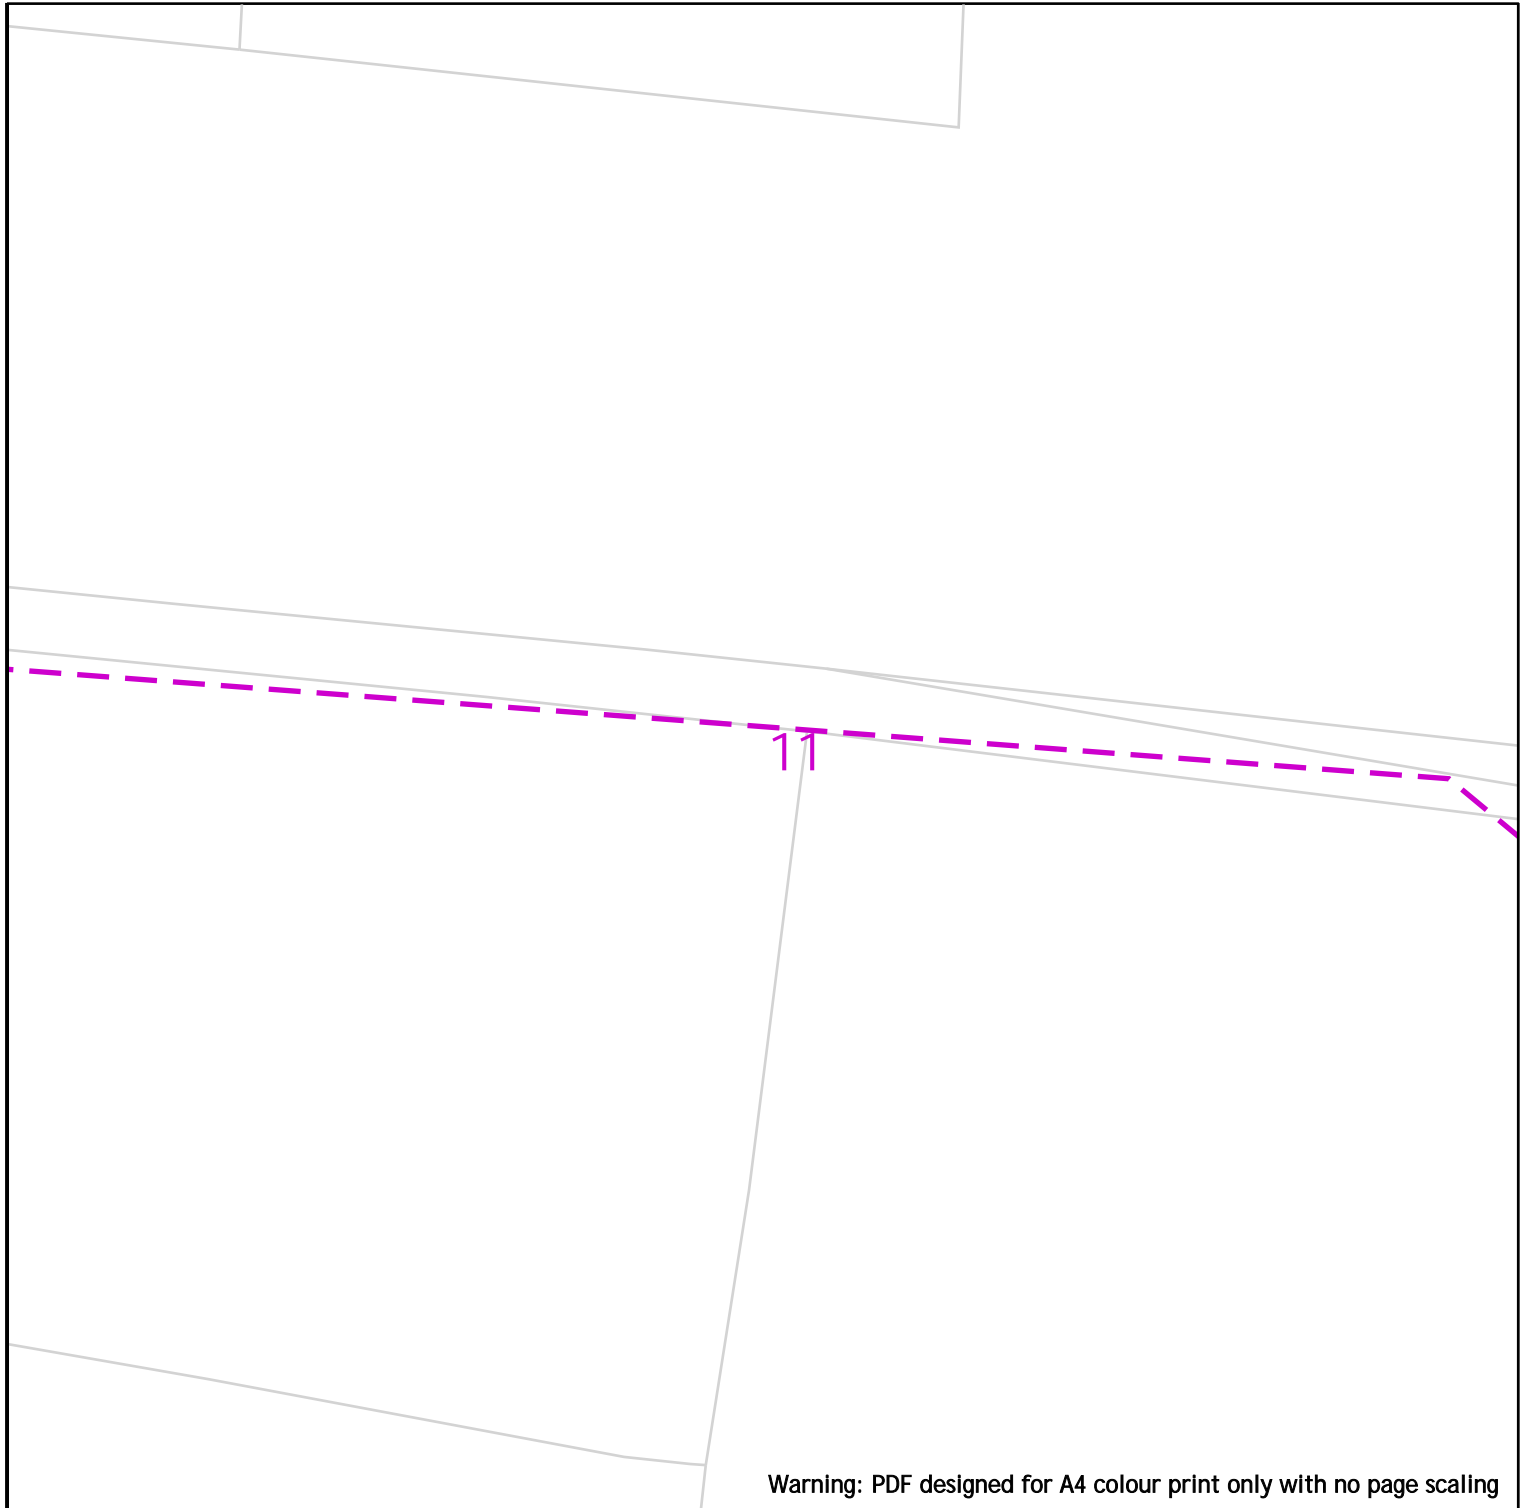

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker


Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

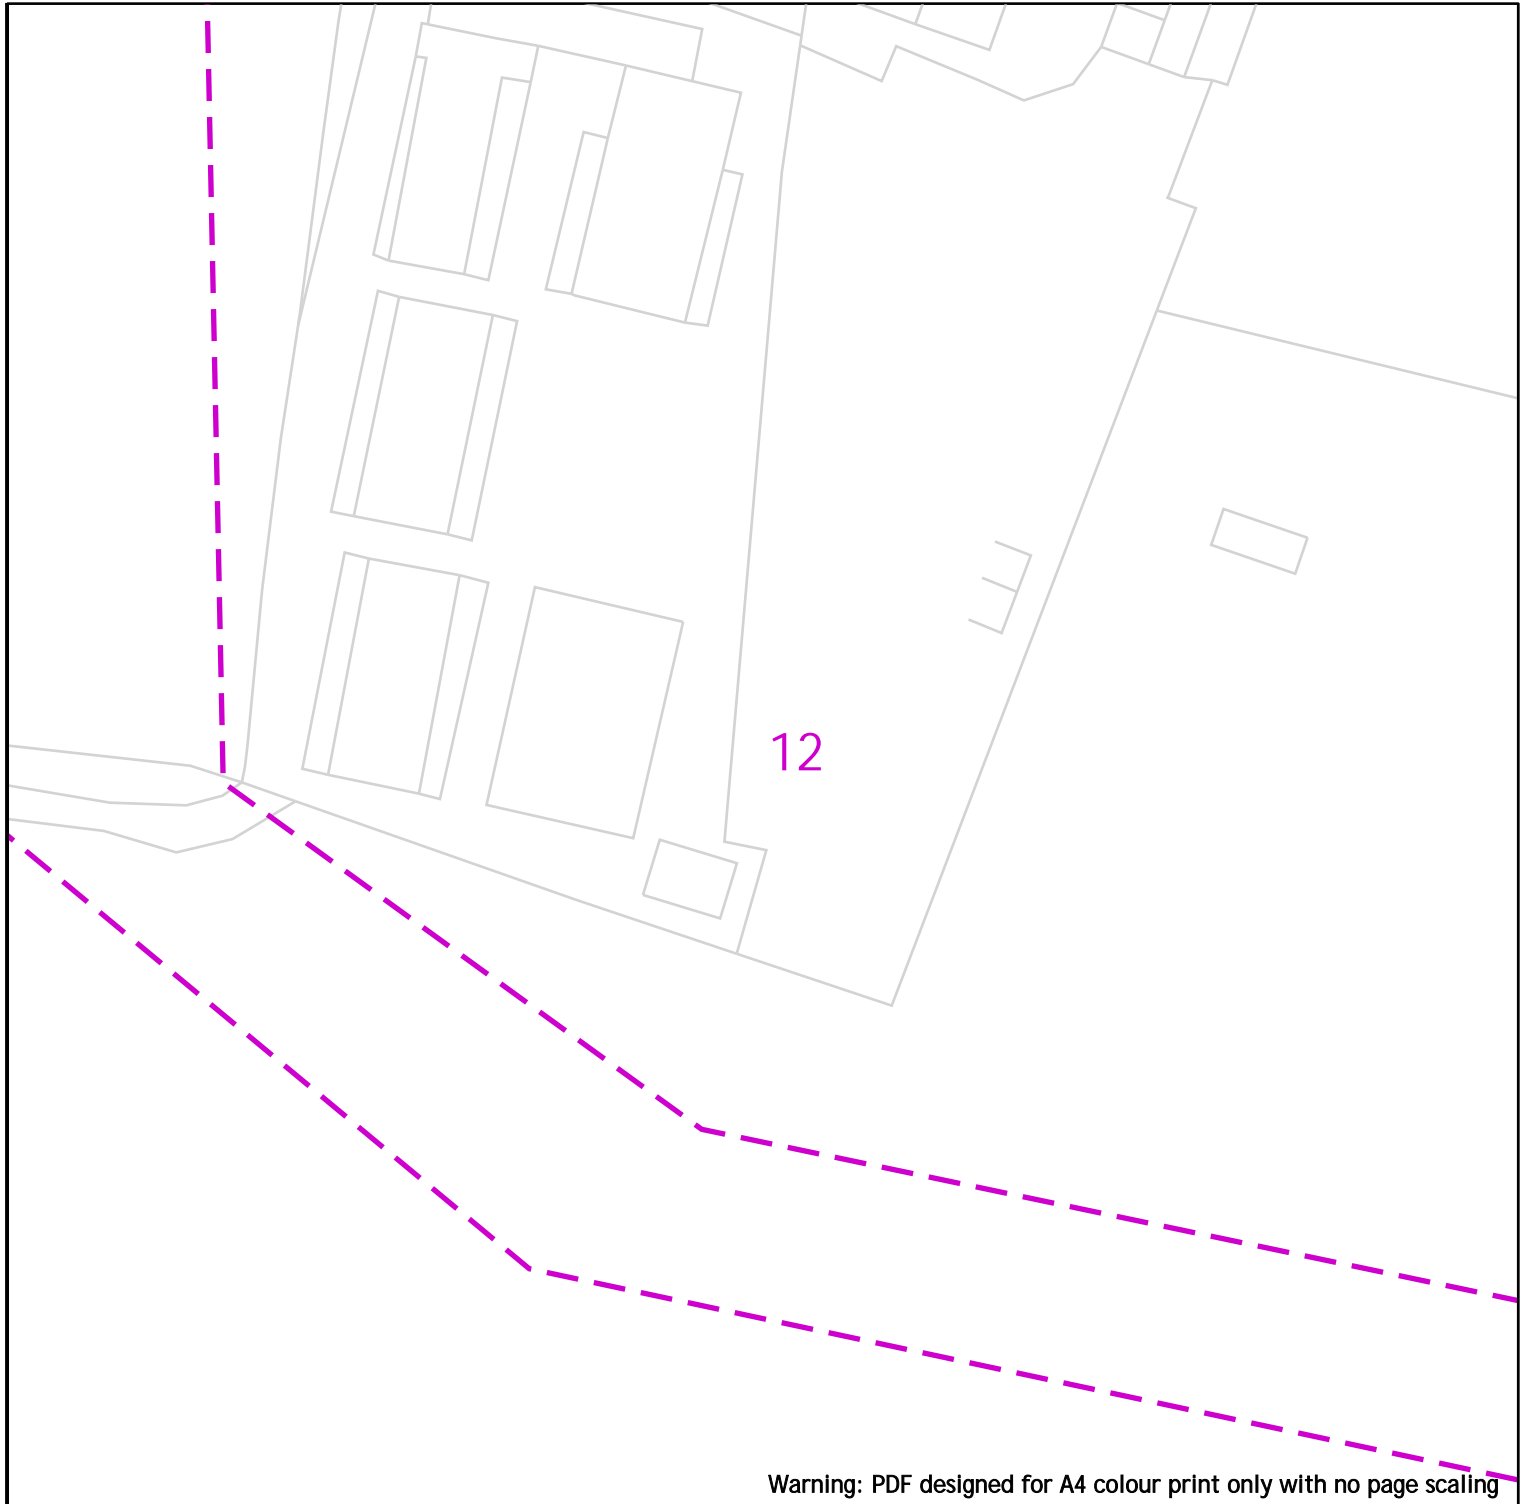

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

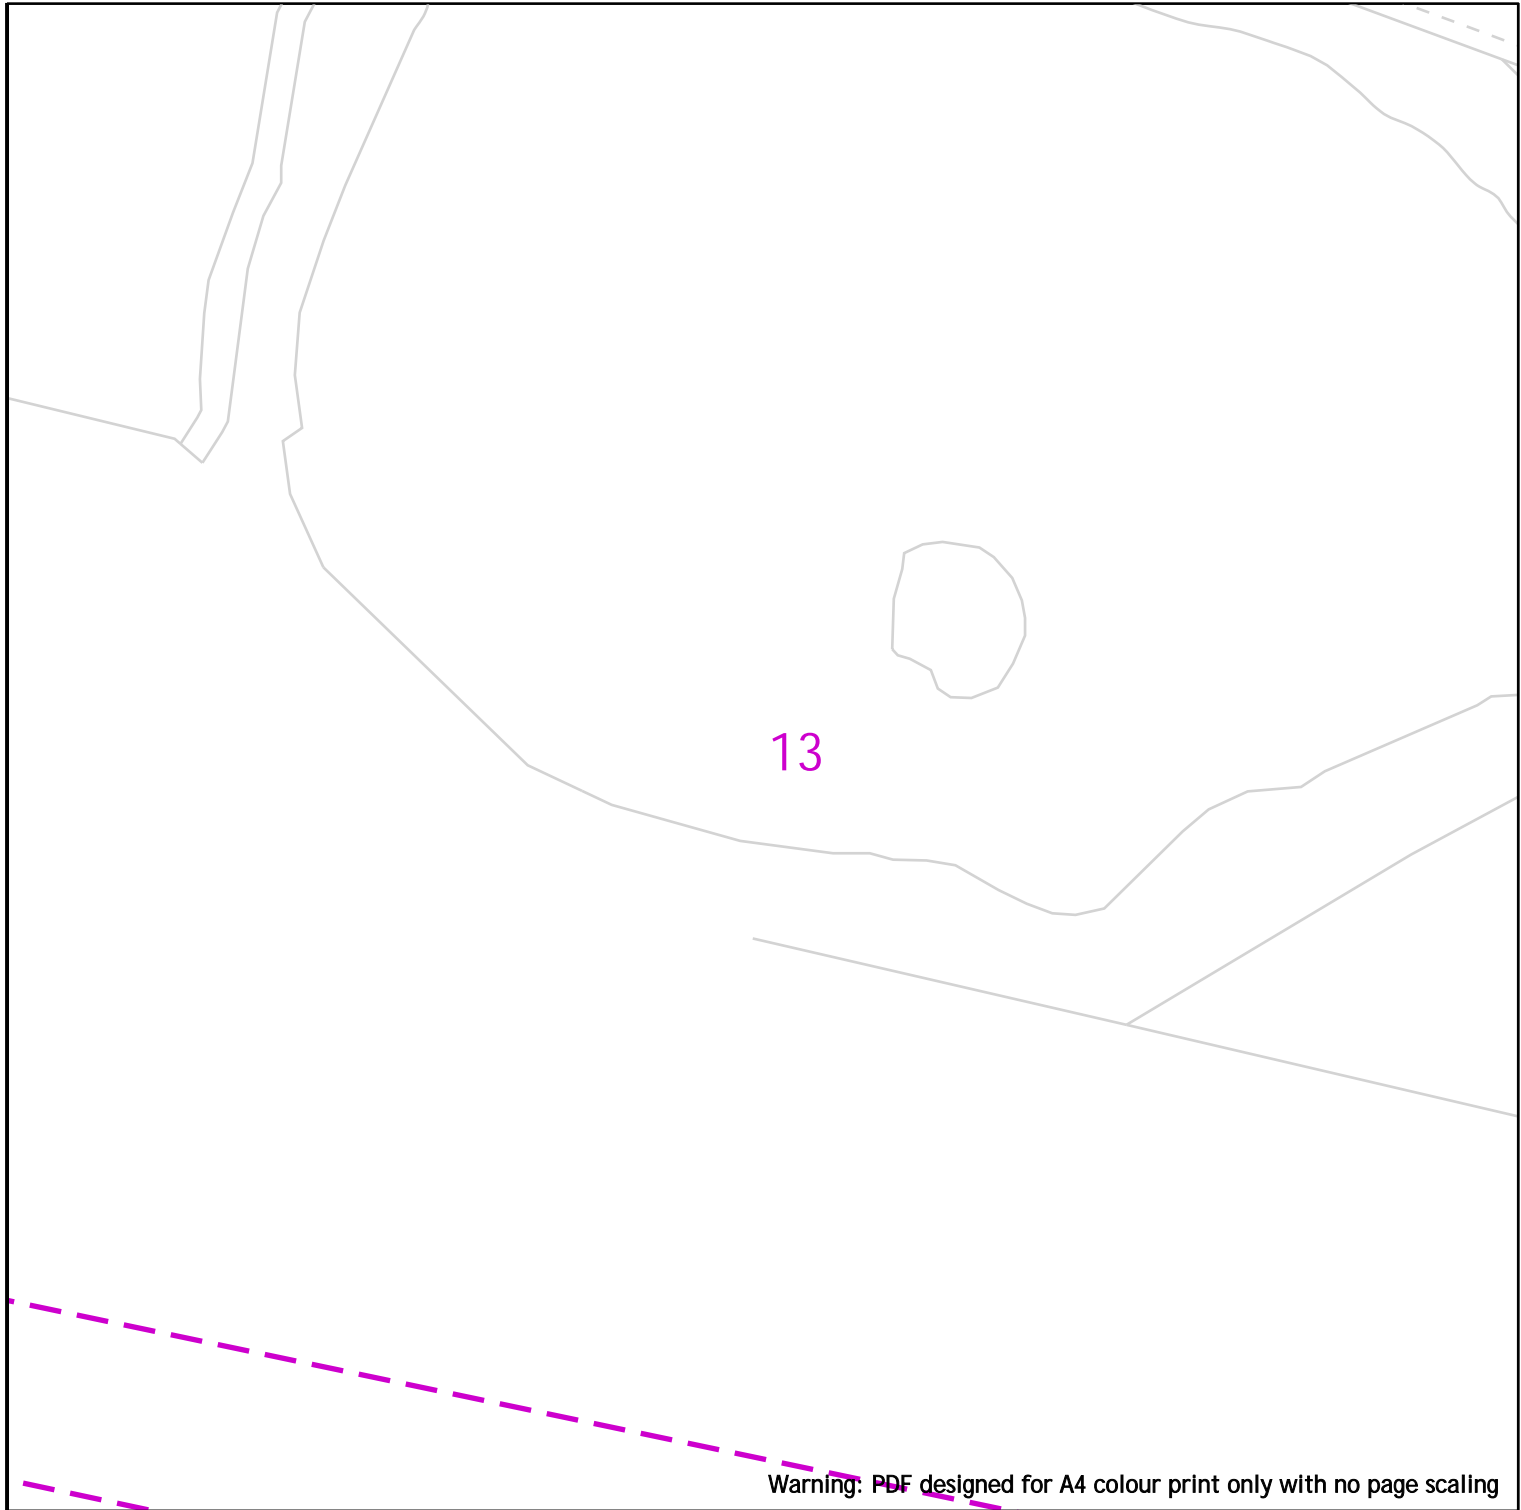

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

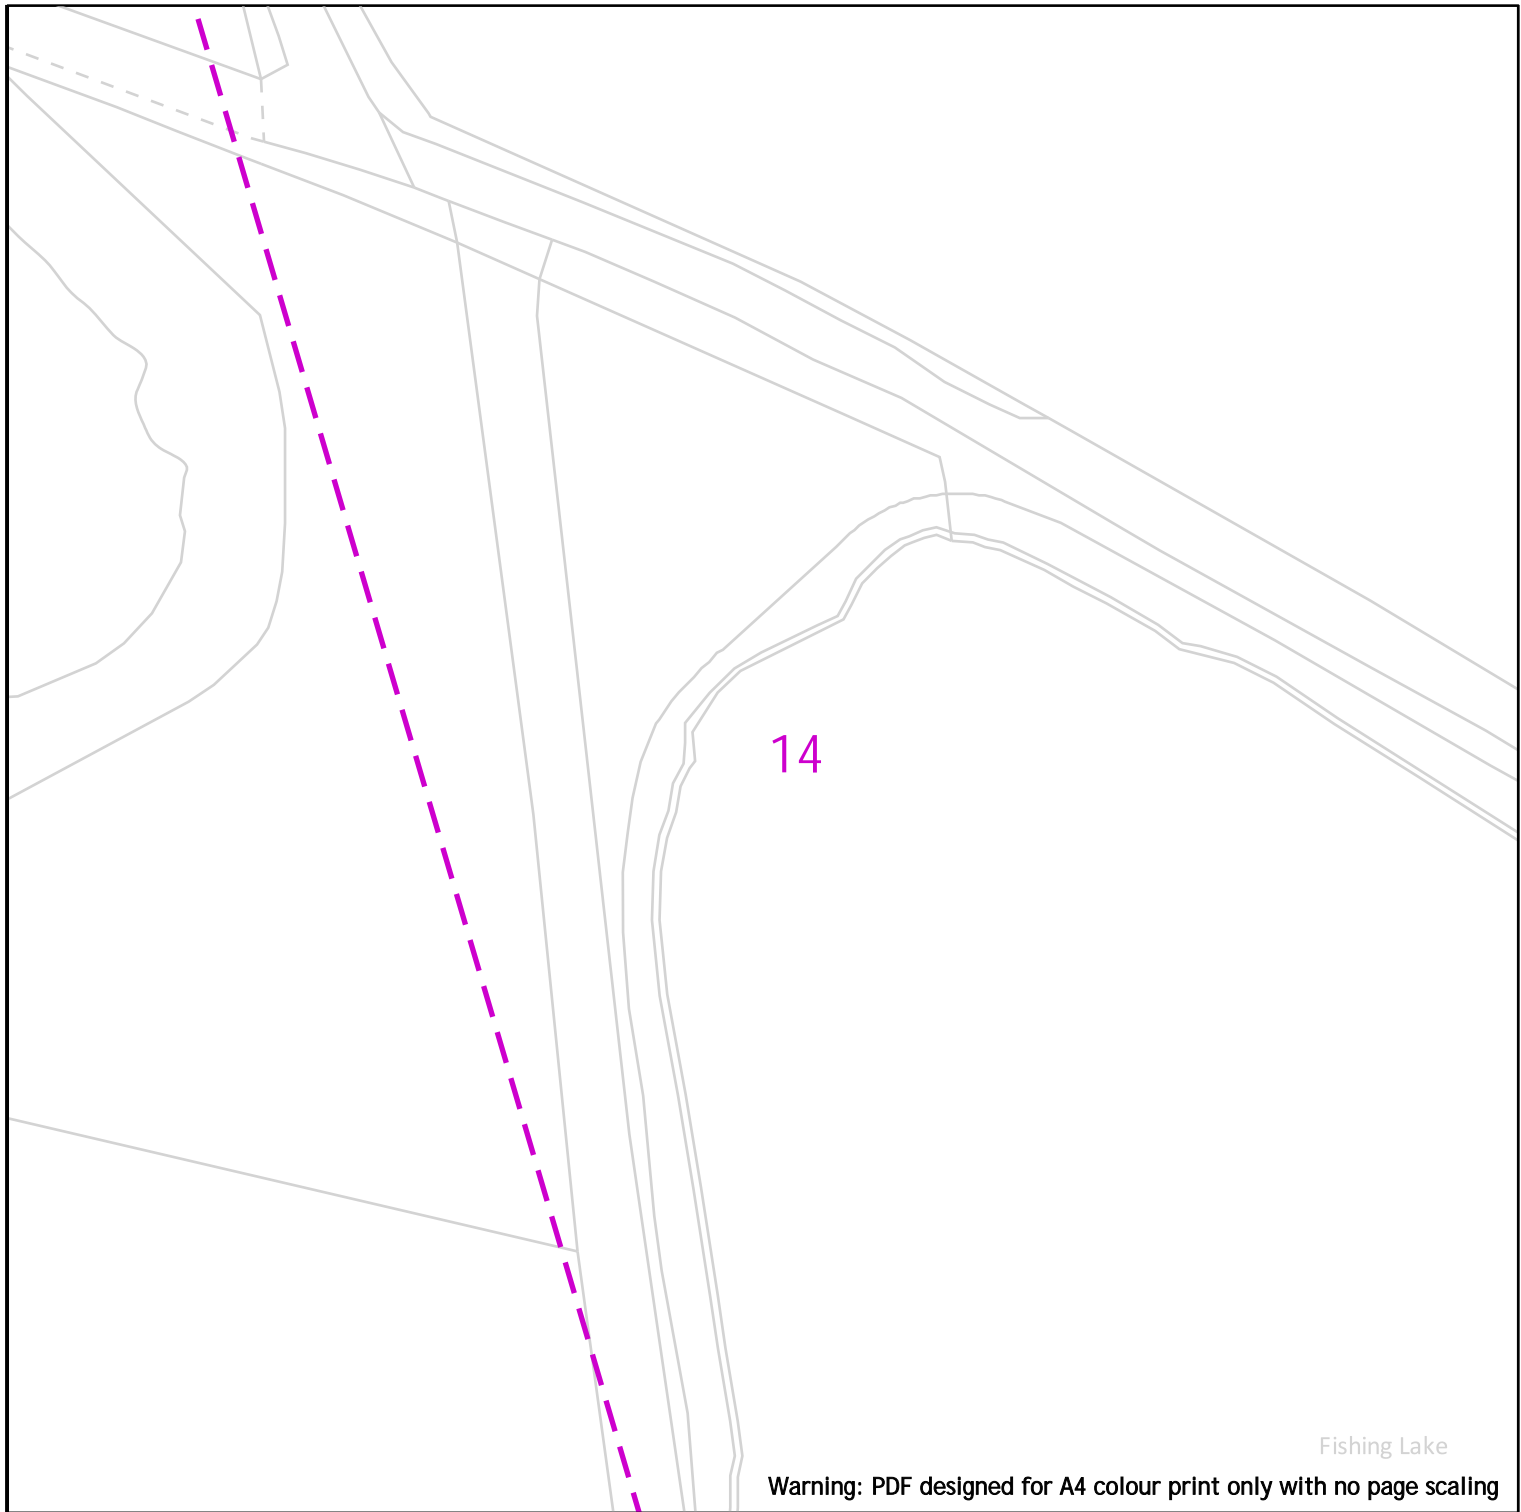

Fishing Lake

Warning: PDF designed for A4 colour print only with no page scaling

25m

<b>Dig Sites</b>	Area:	Line:
	LP Mains	
	MP Mains	
	IP Mains	
	LHP Mains	



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

15

Bourbles Ponds


Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites

Area: 

Line: 



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

IMPORTANT NOTICES


This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886



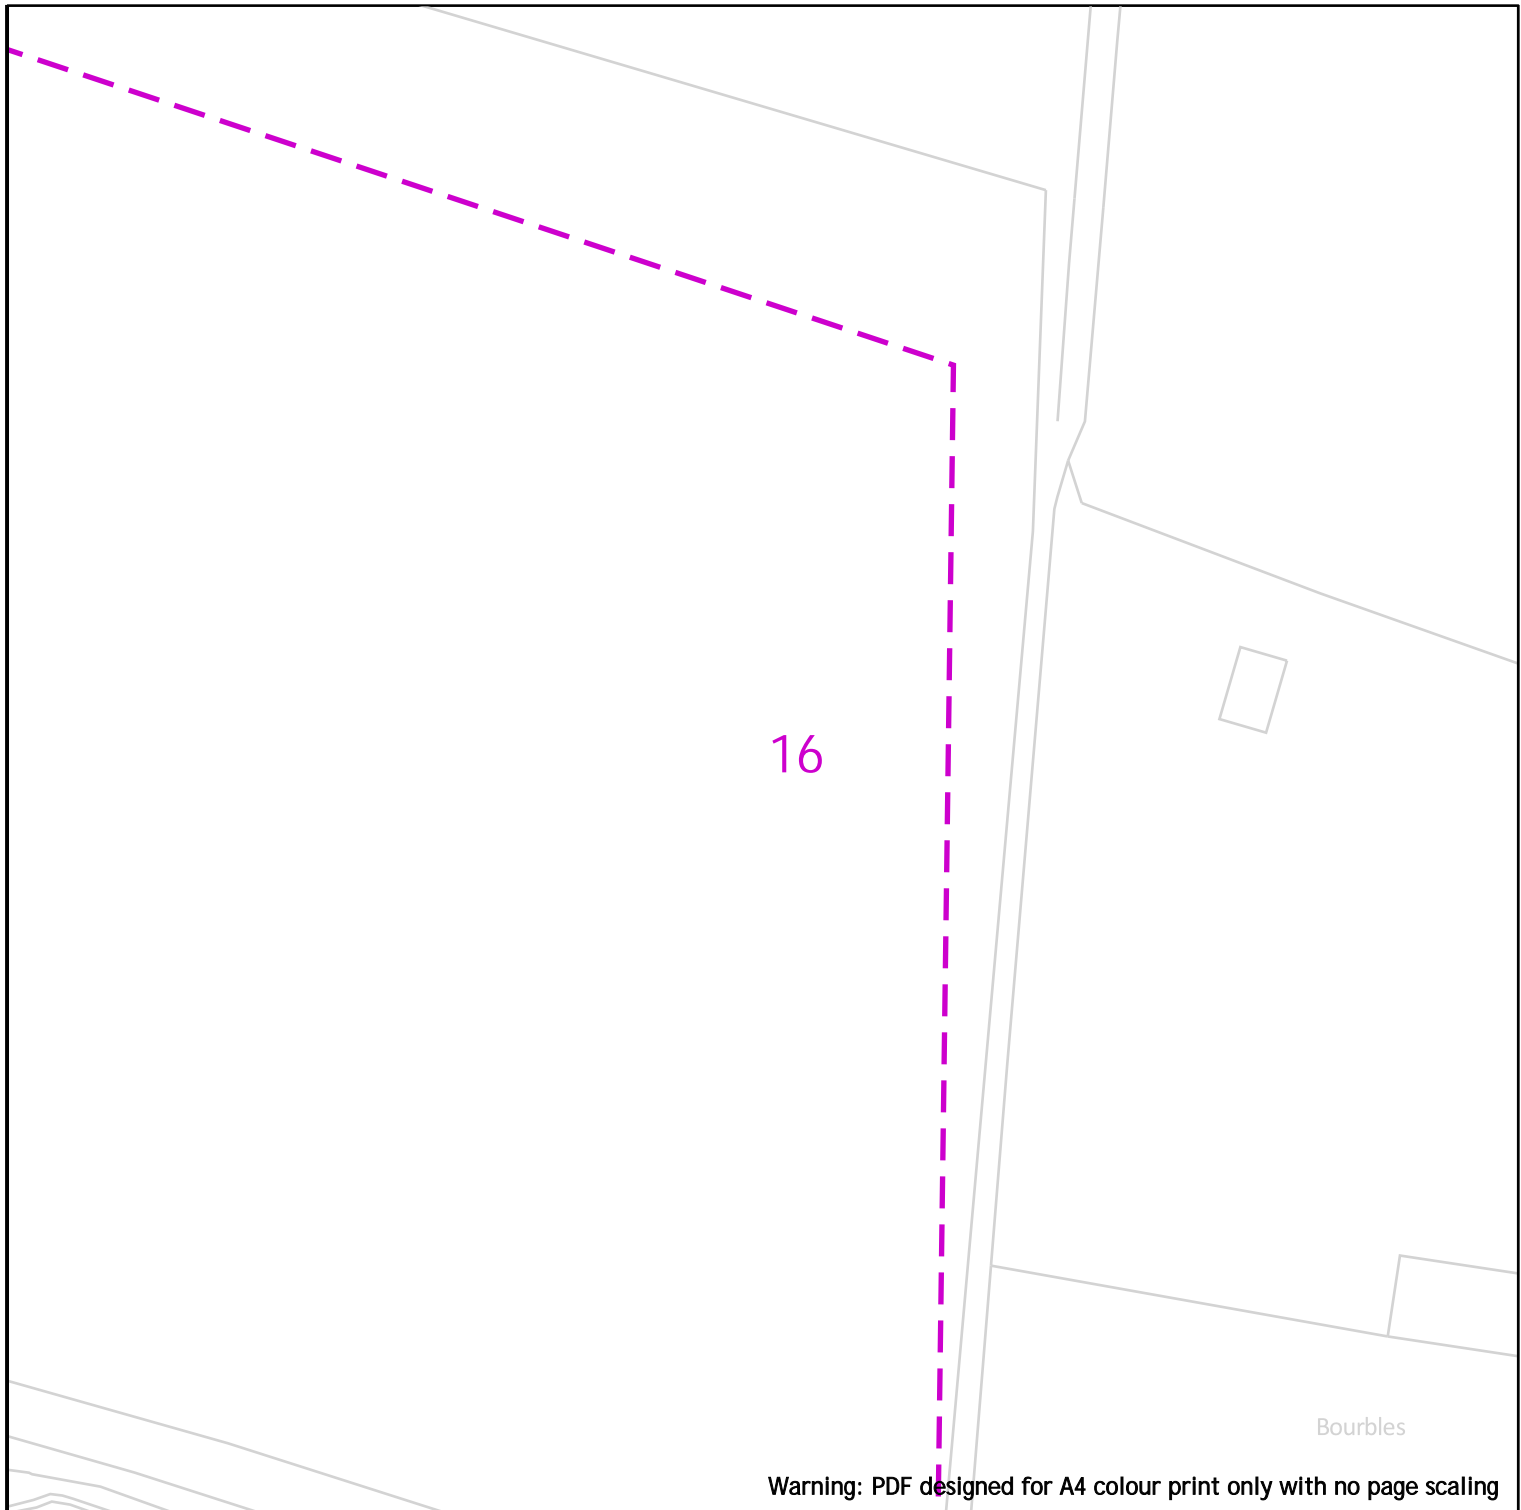

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:

- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service



**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

Scale: 1:500 (When plotted at A4)

17


Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites

Area: 

Line: 



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)











18

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



- |   |           |   |                |   |                         |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |   |                |   |                         |

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

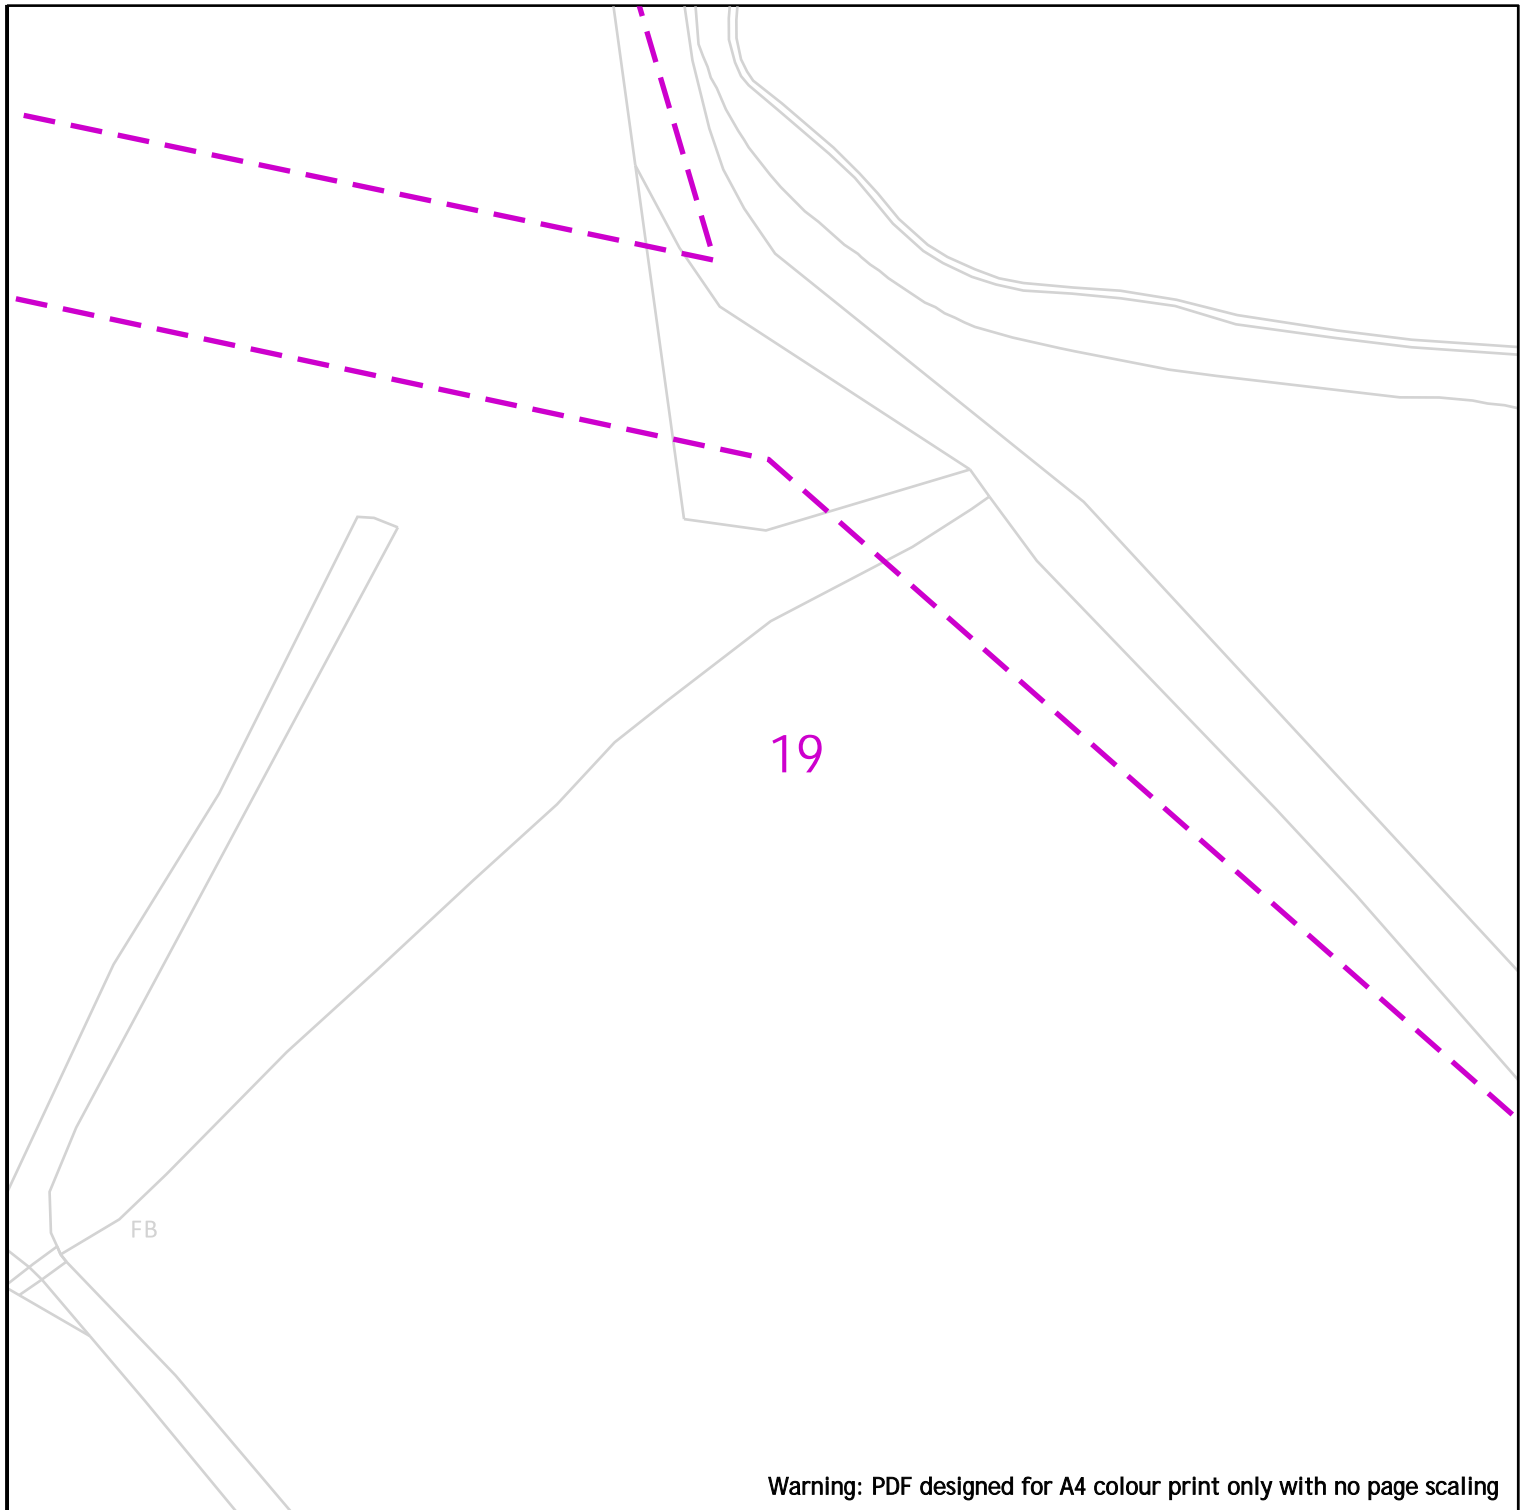

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites Area: Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

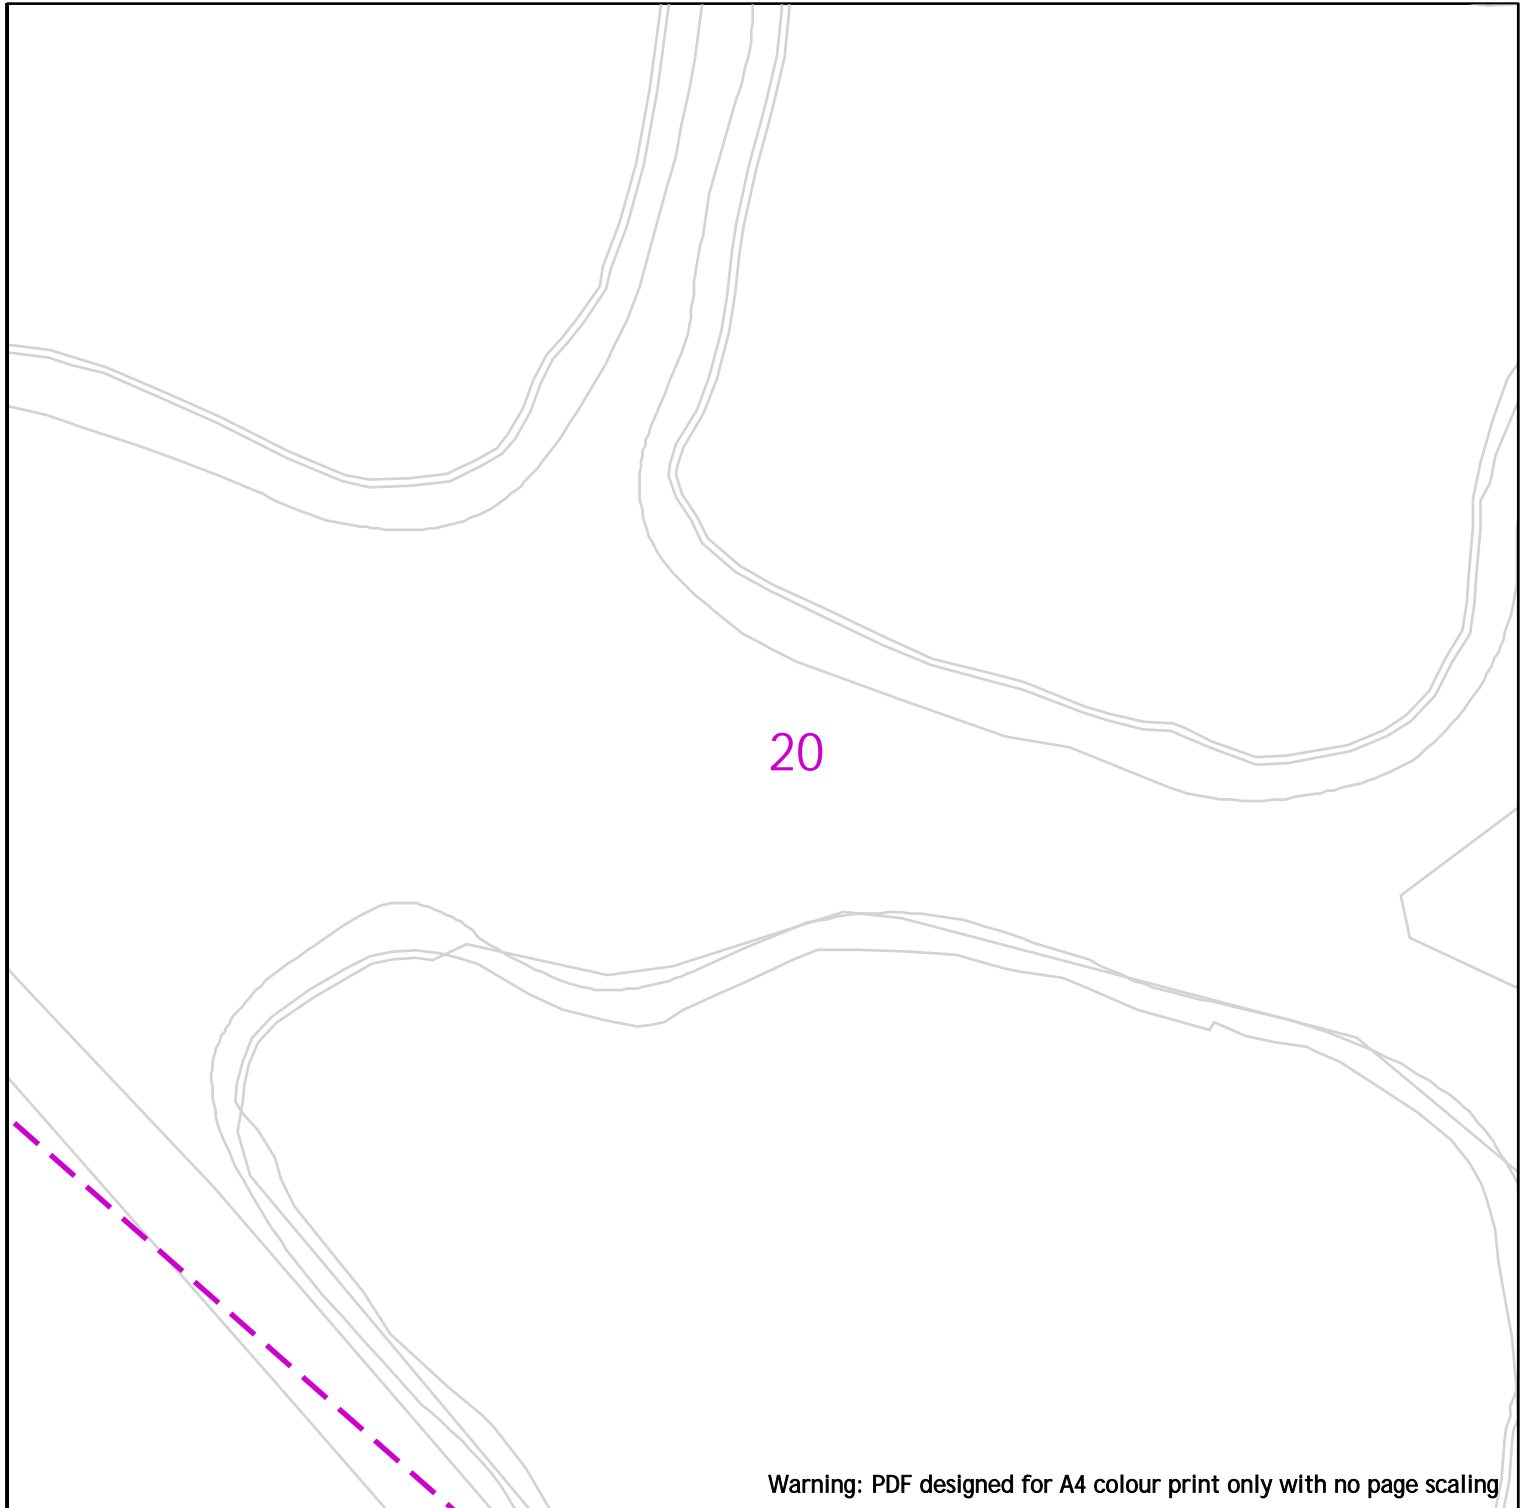

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

21

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

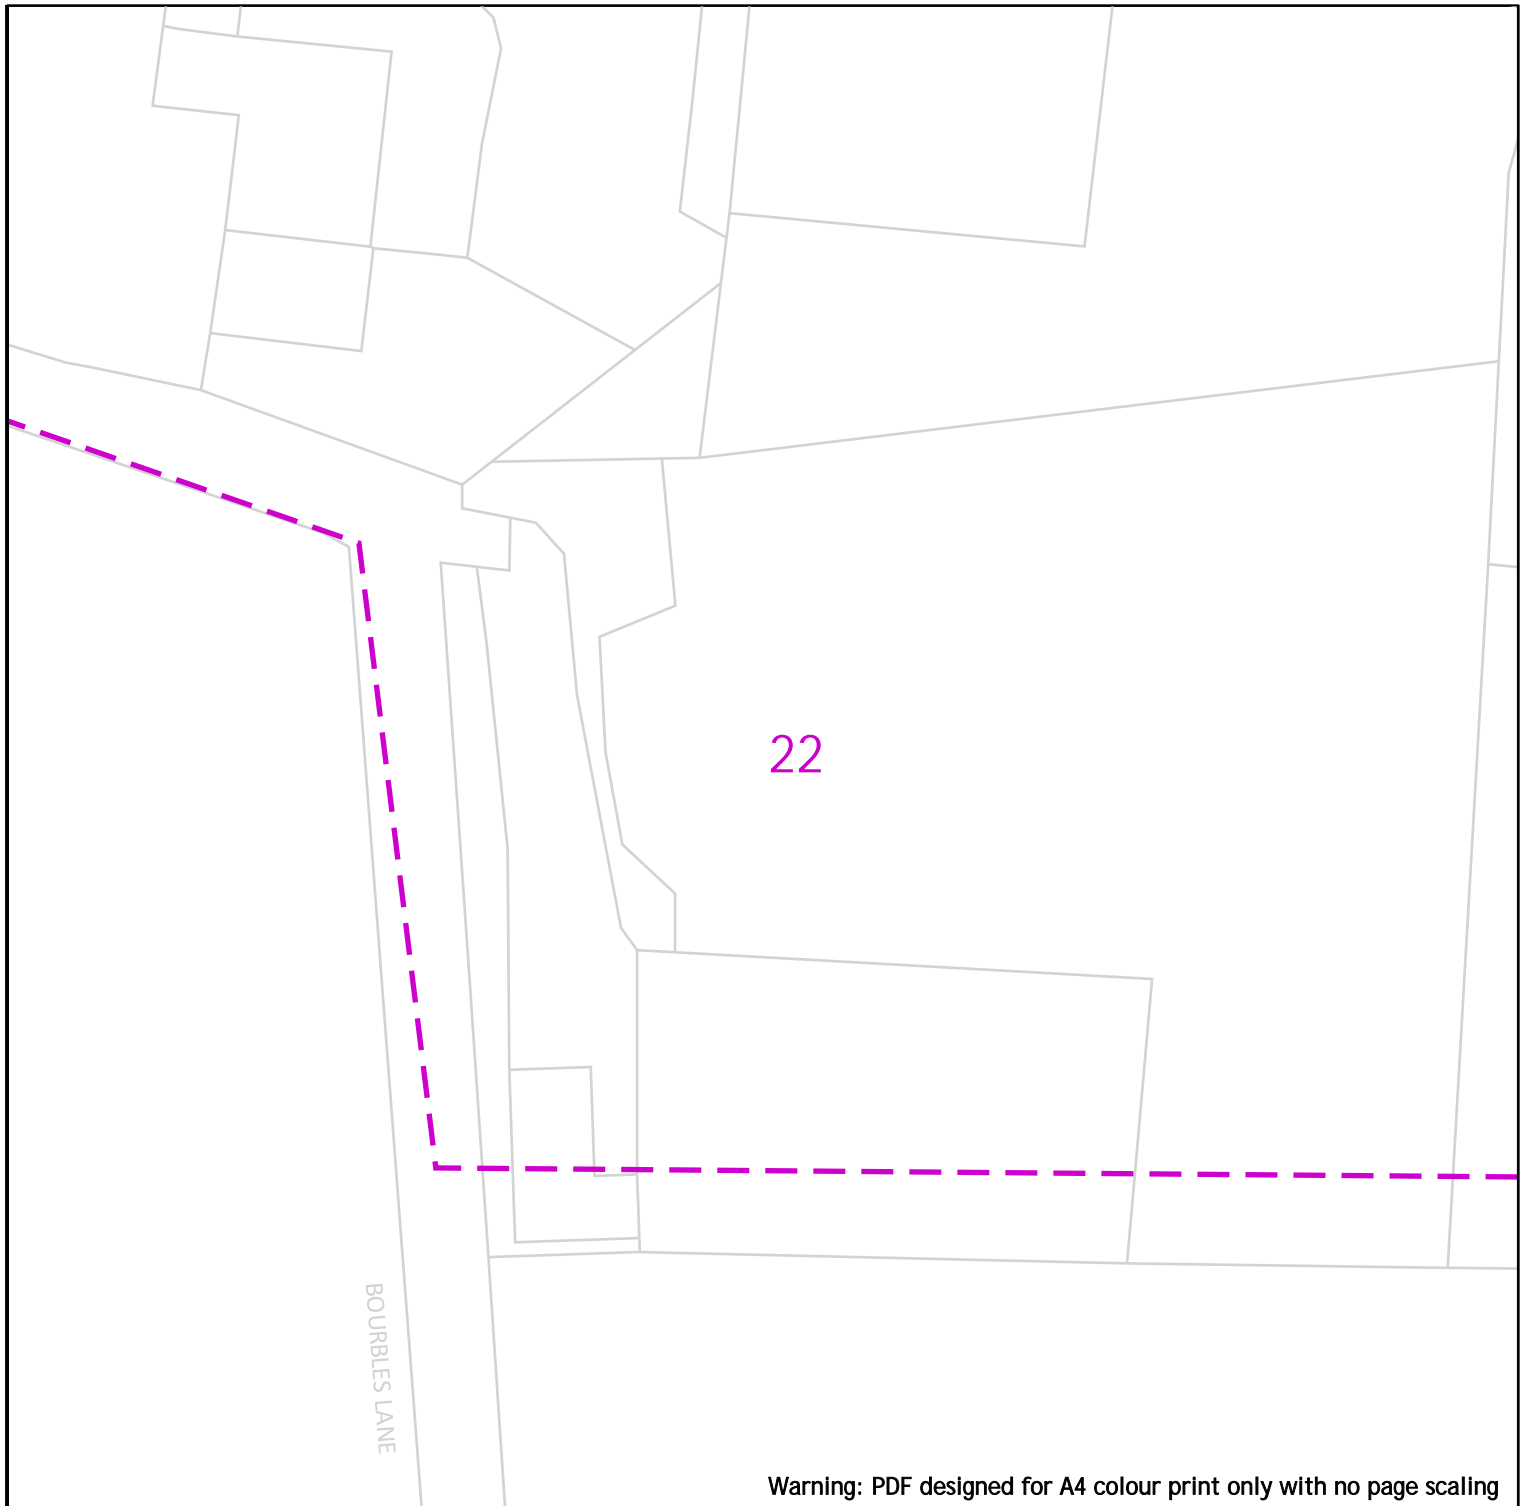

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)













Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites      Area:       Line: 



- |   |           |   |                |   |                         |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |   |                |   |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)







24

Warning: PDF designed for A4 colour print only with no page scaling

 25m


Dig Sites Area:  Line: 




	LP Mains
	MP Mains
	IP Mains
	LHP Mains

 Valve

 Depth of cover

 Syphon

 Diameter Change

 Material Change

 Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886





25




Warning: PDF designed for A4 colour print only with no page scaling




 25m

Dig Sites Area:  Line: 



	LP Mains
	MP Mains
	IP Mains
	LHP Mains

	Valve
	Depth of cover
	Syphon

	Diameter Change
	Material Change
	Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Def

Warning: PDF designed for A4 colour print only with no page scaling




Dig Sites	Area:	Line:	
	LP Mains		Valve
	MP Mains		Depth of cover
	IP Mains		Syphon
	LHP Mains		Diameter Change
			Material Change
			Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker  
 Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)  
 View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

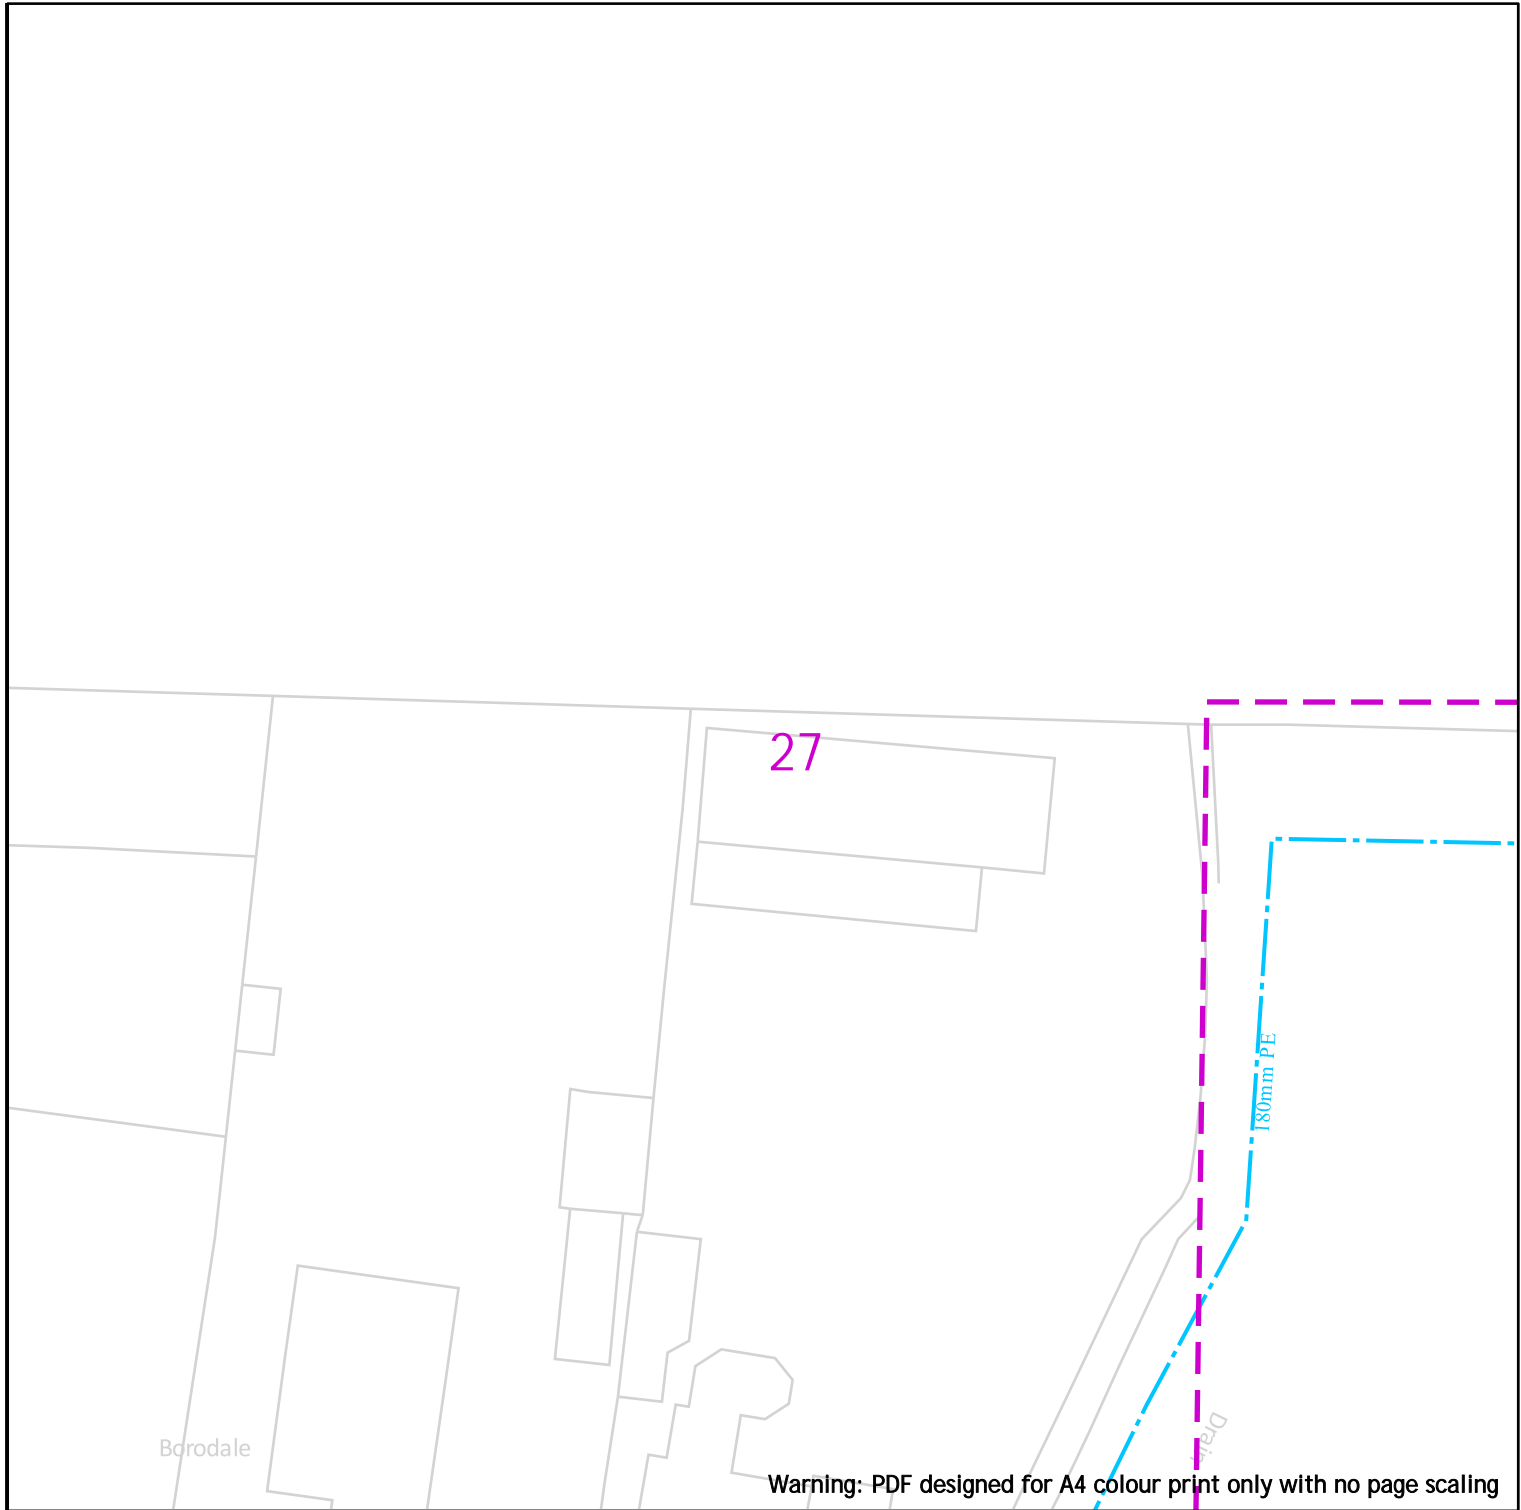

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:

- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

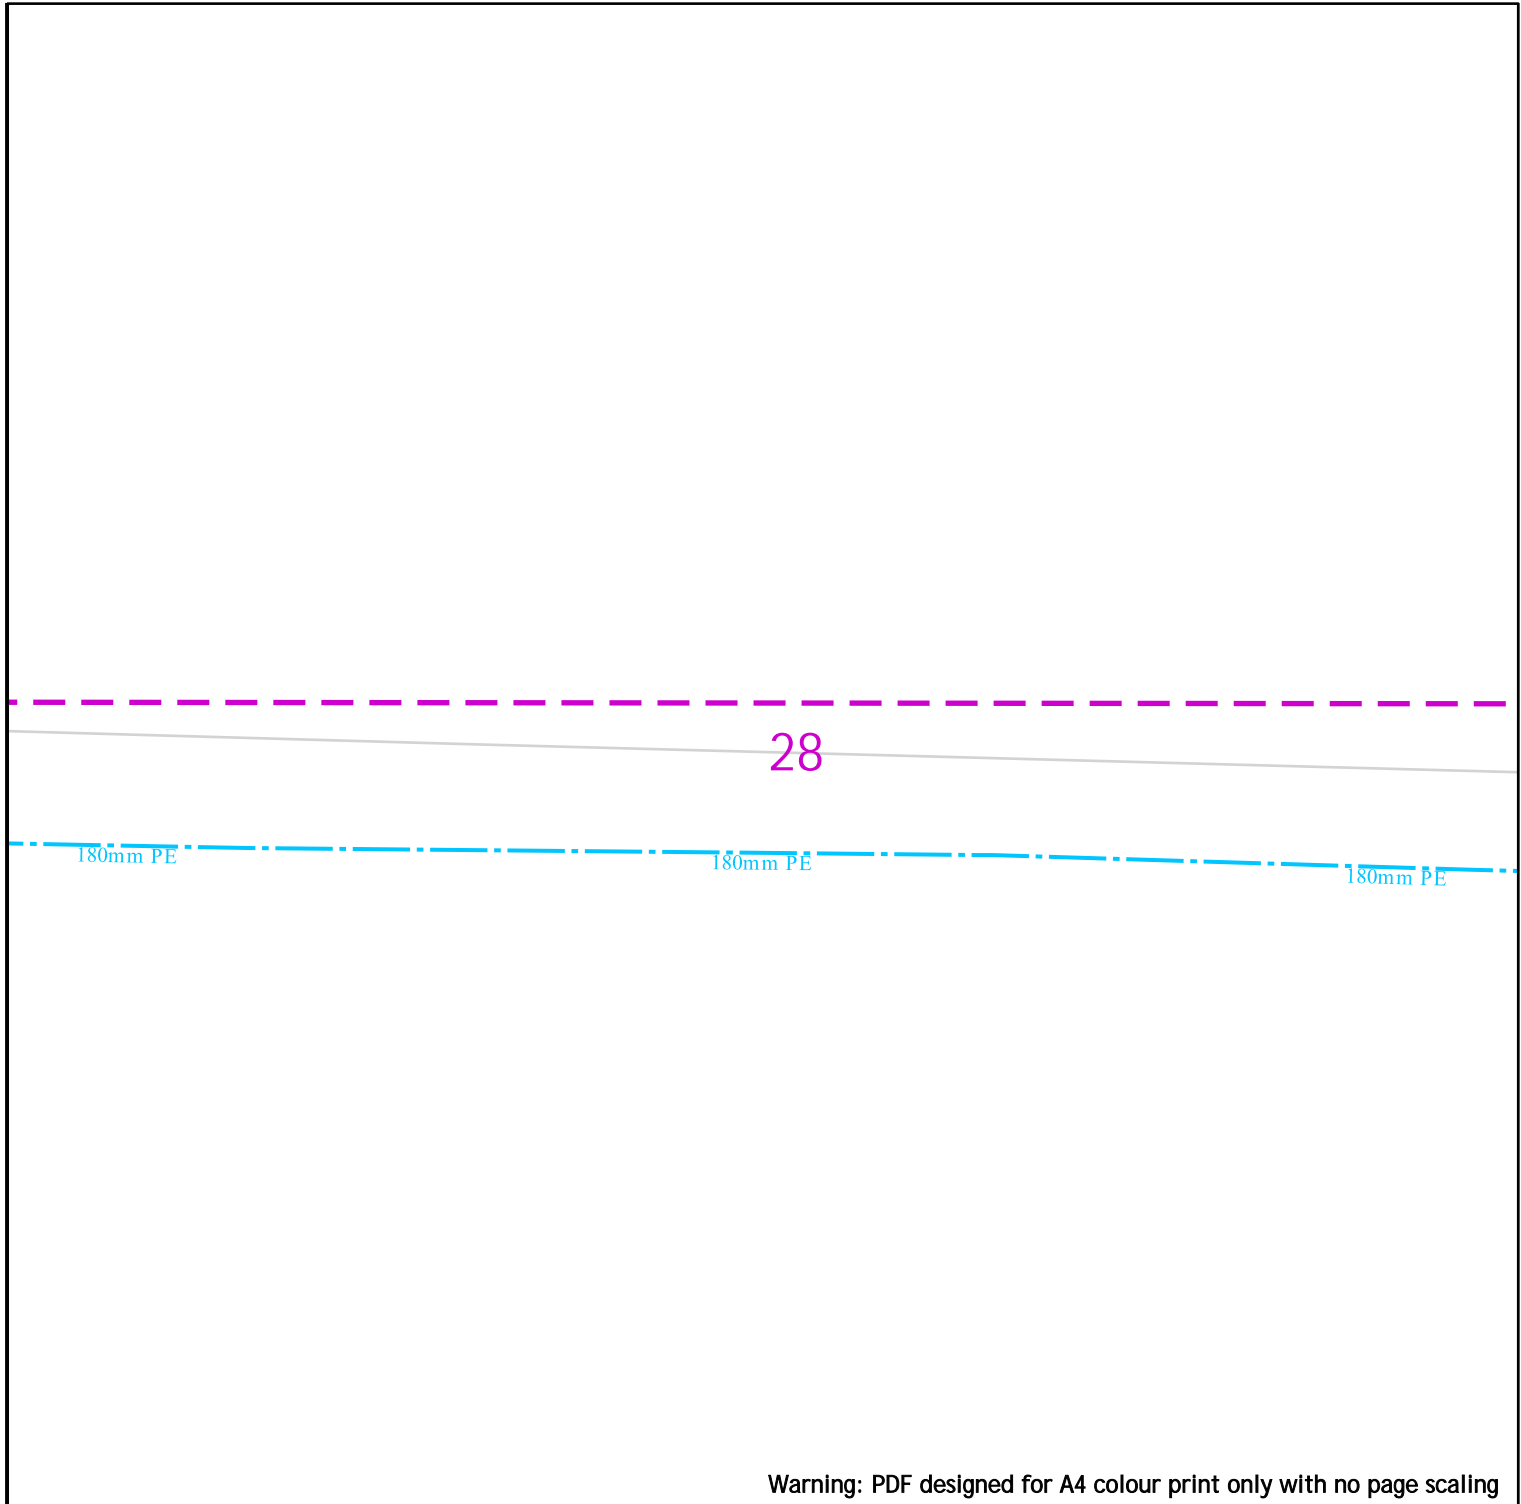

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

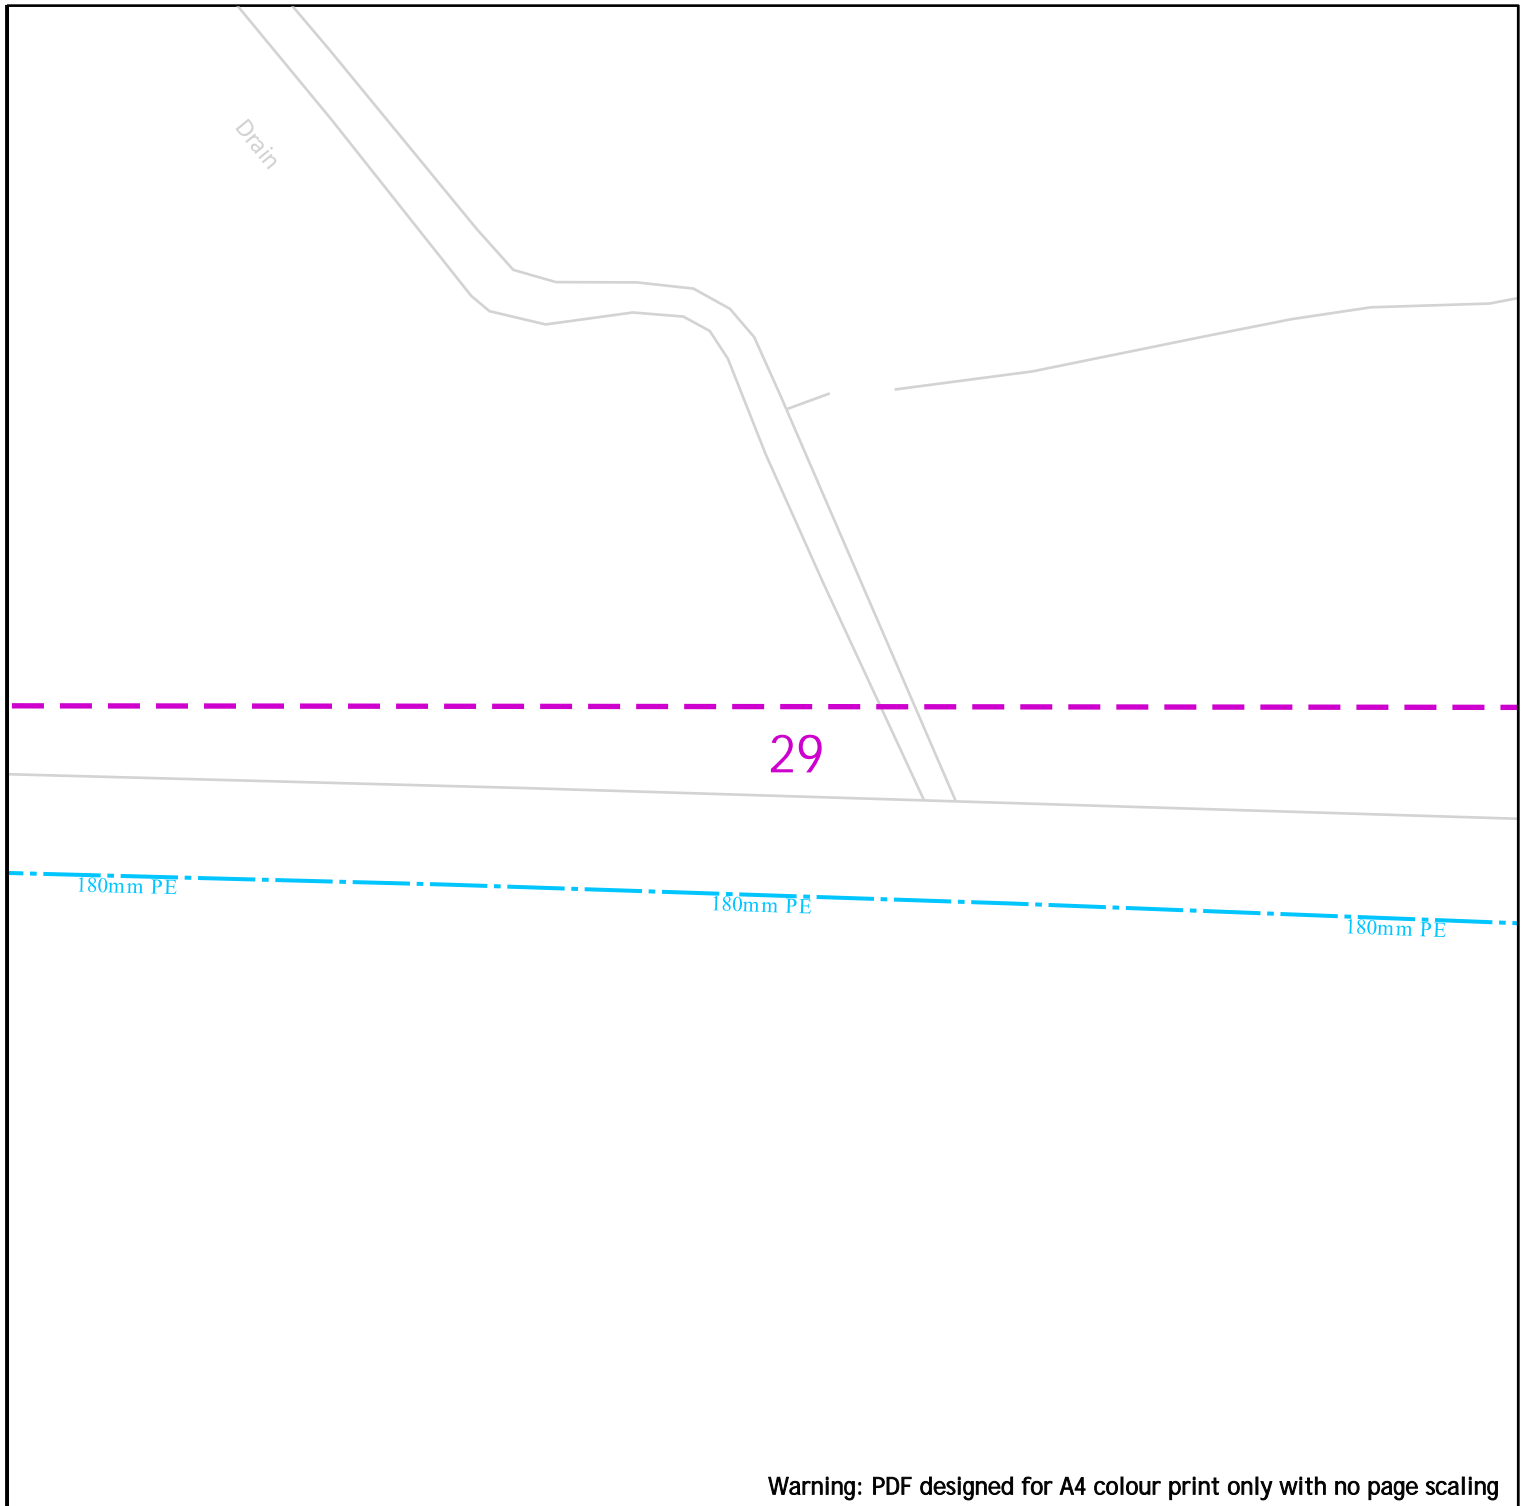


Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

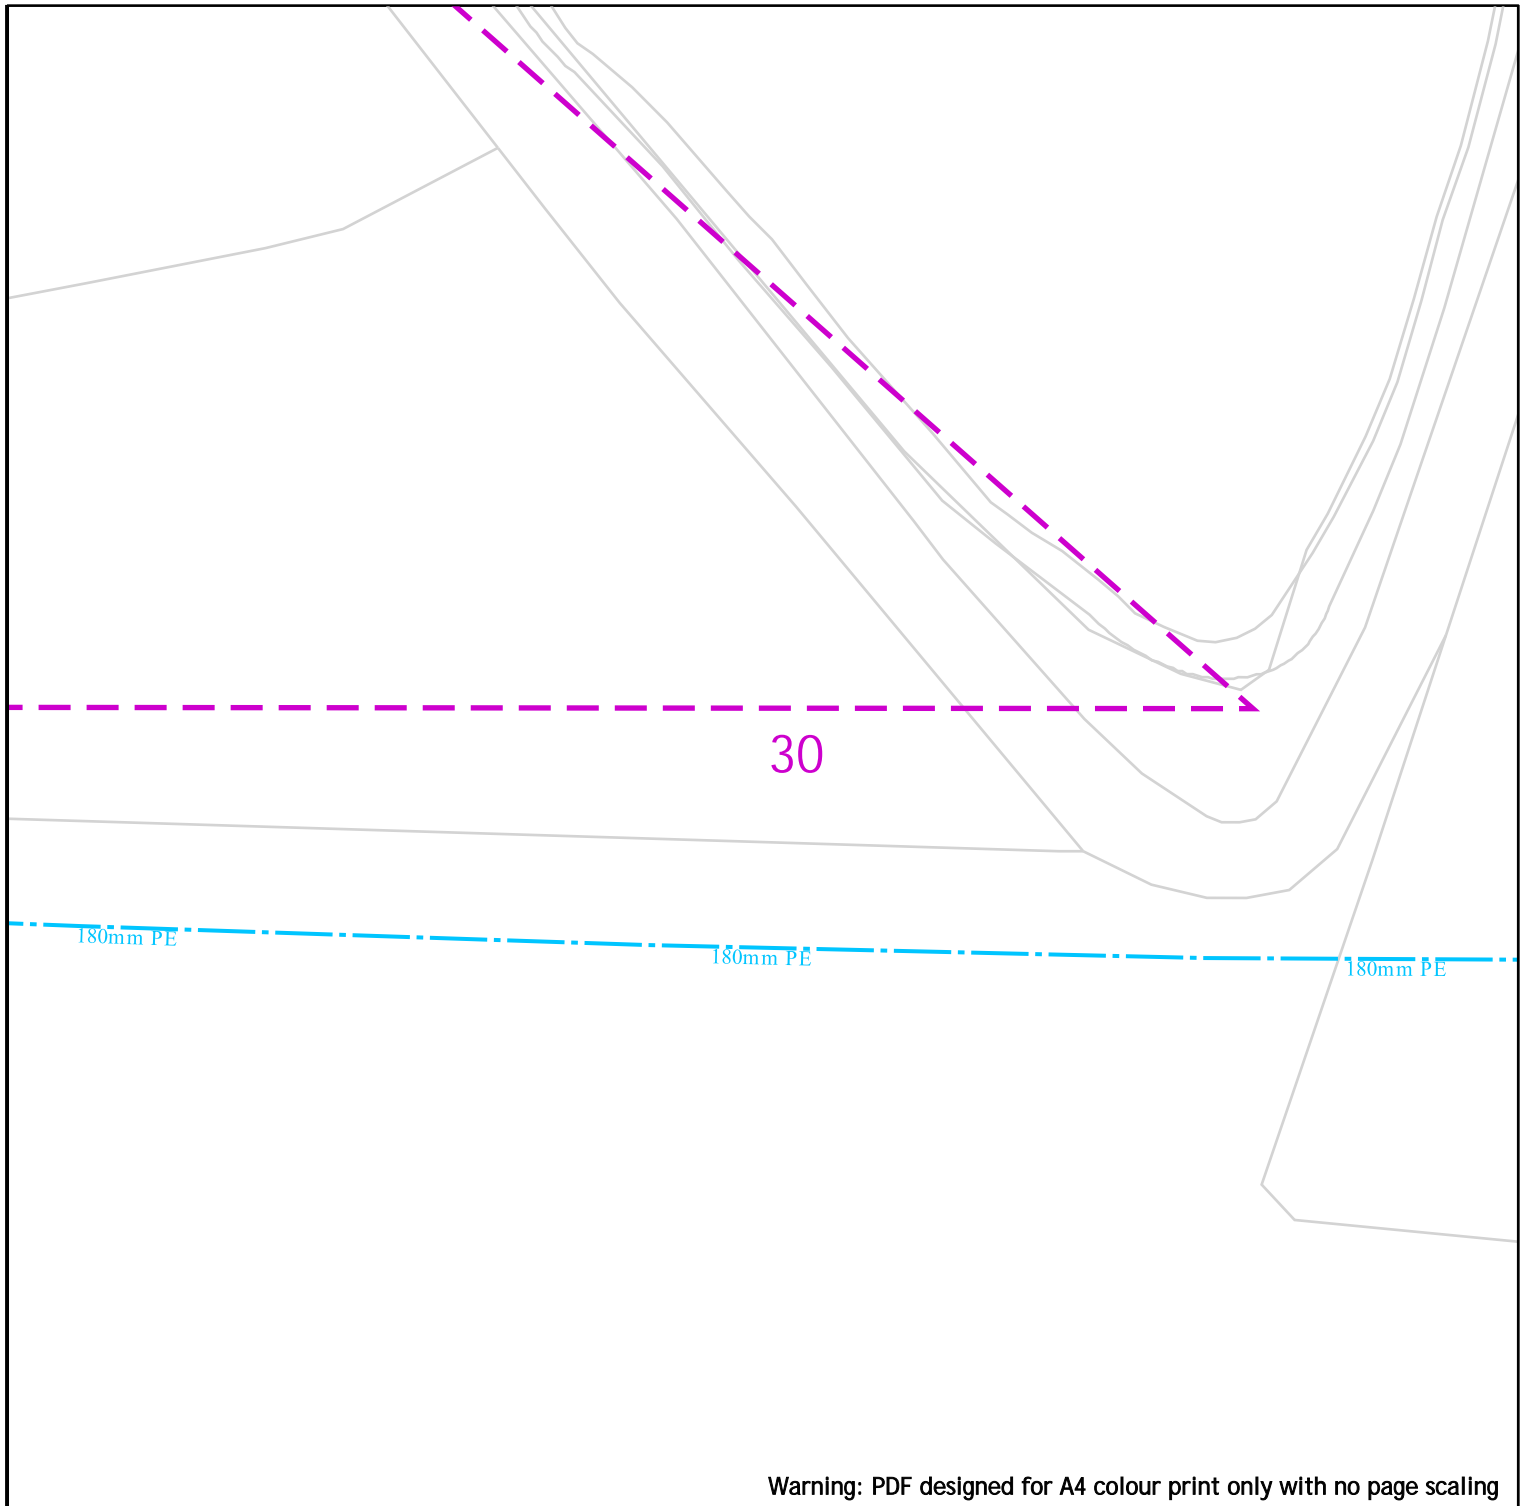

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:

- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

31

180mm PE

180mm PE

180mm PE





1.0

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m


Scale: 1:500 (When plotted at A4)

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**



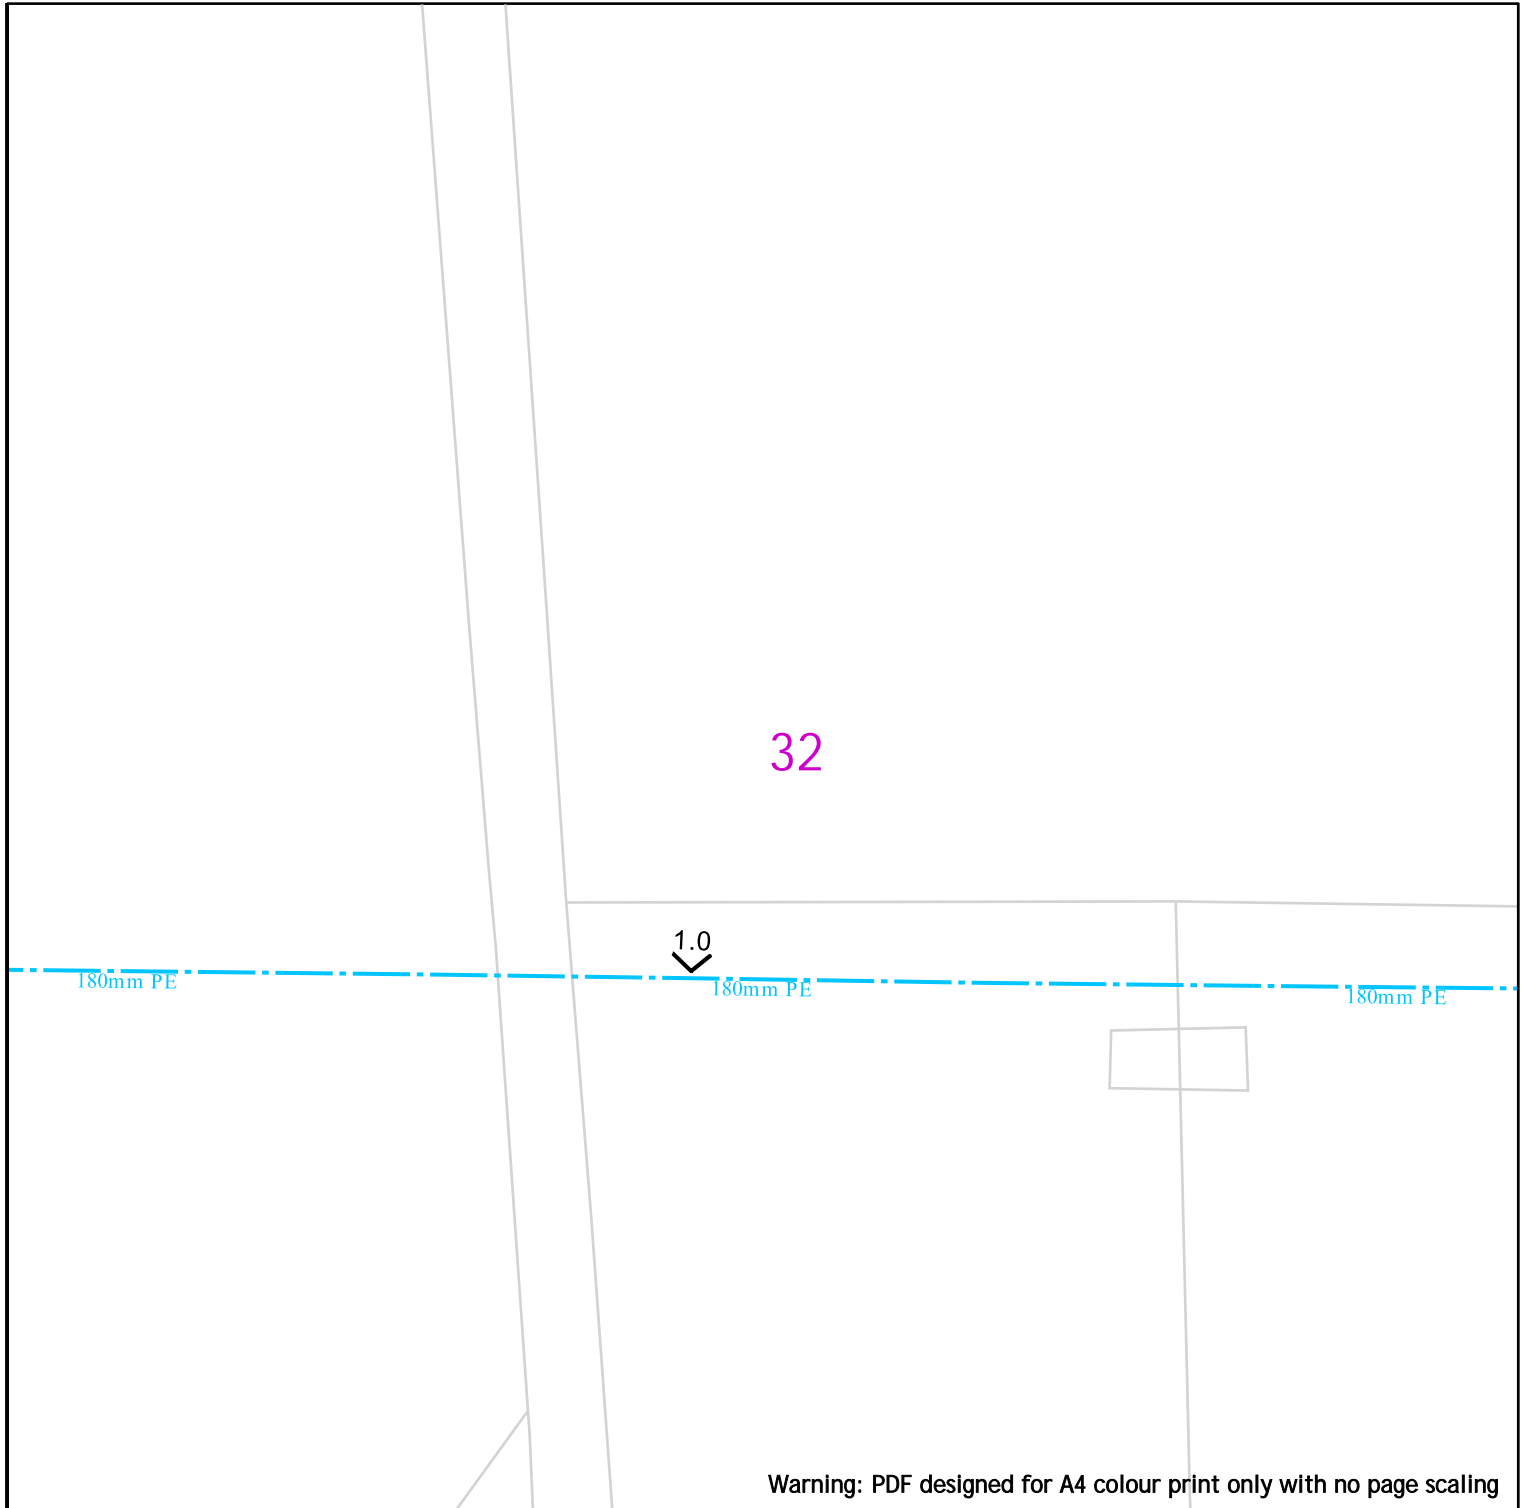

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:

	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

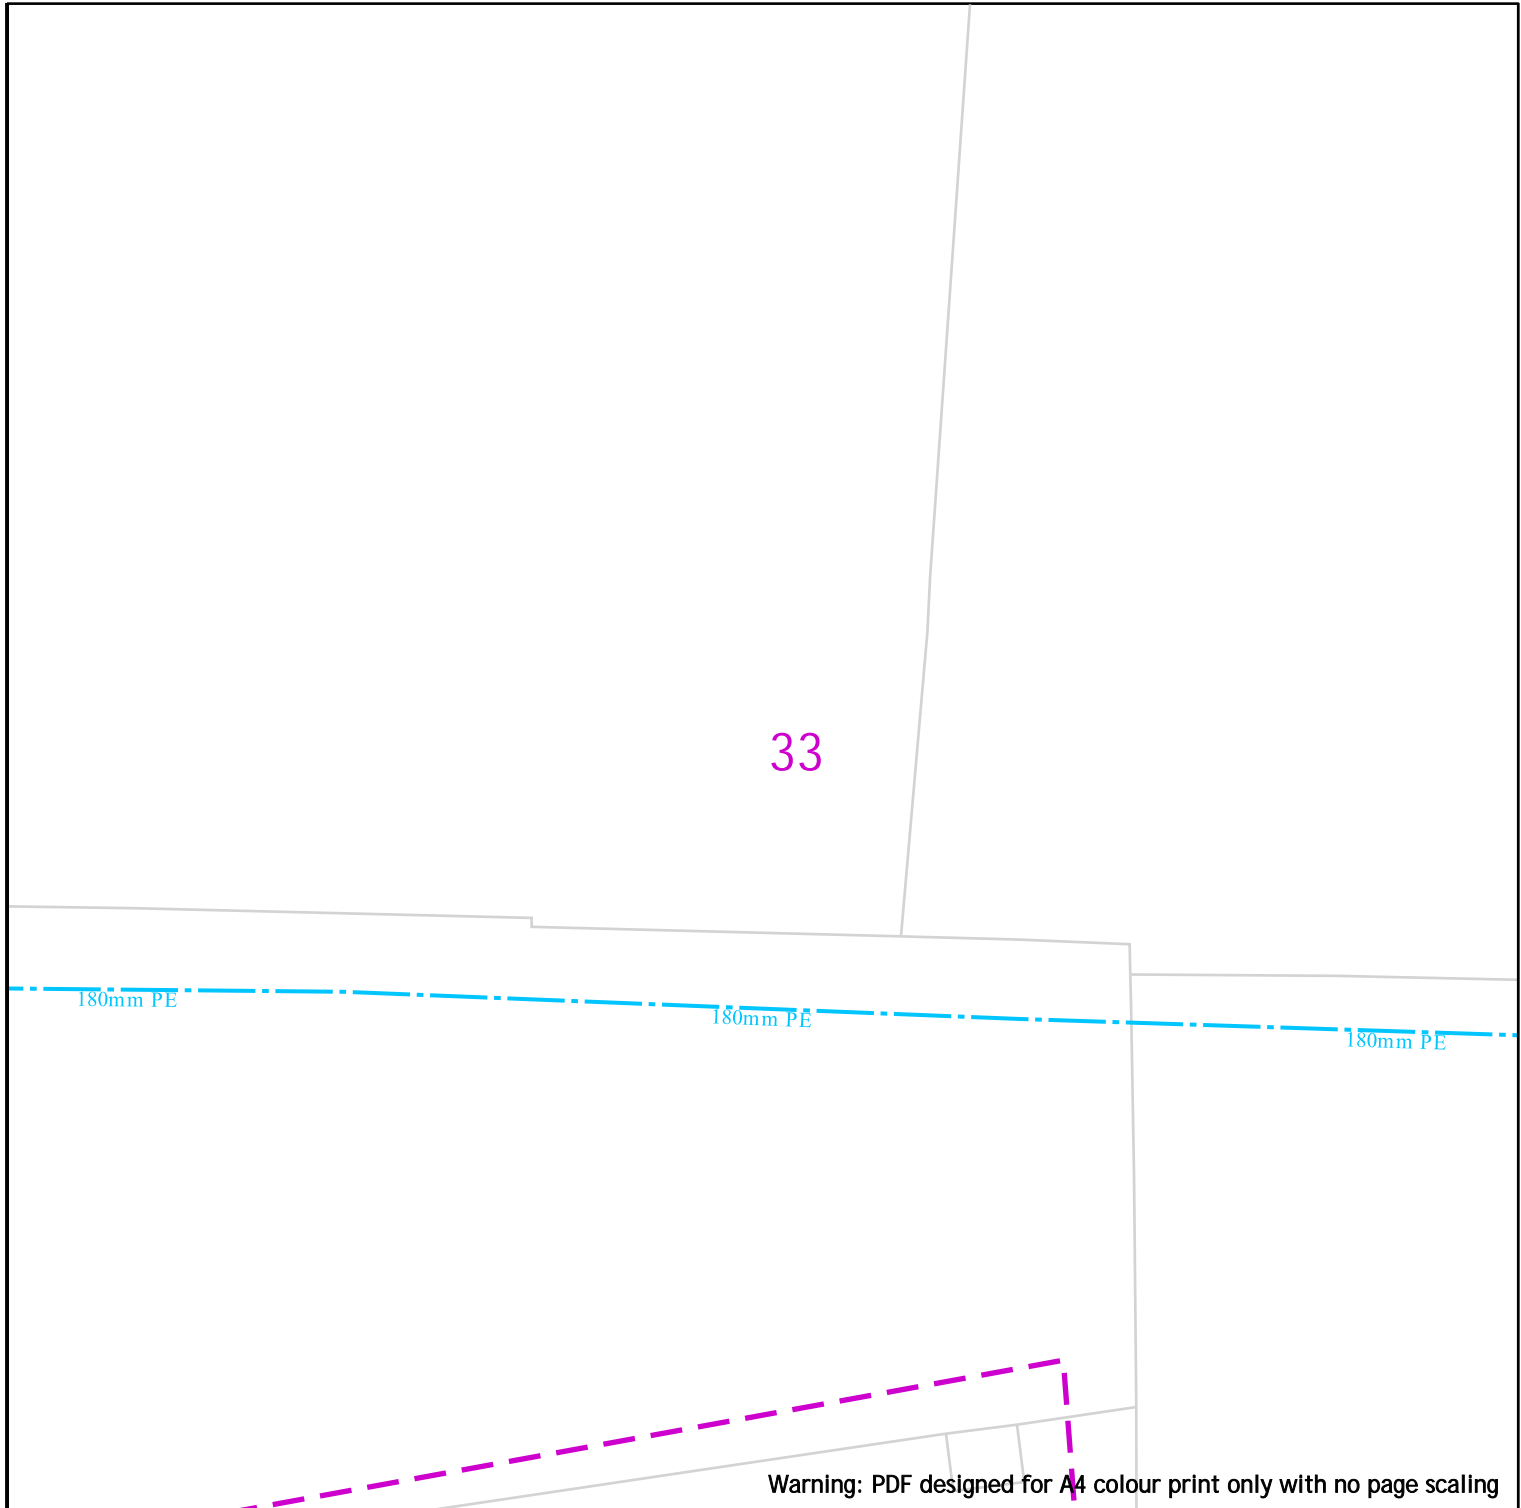

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

34













Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

#### IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

35

180mm PE

180mm PE

180mm PE


Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites

Area: 

Line: 



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

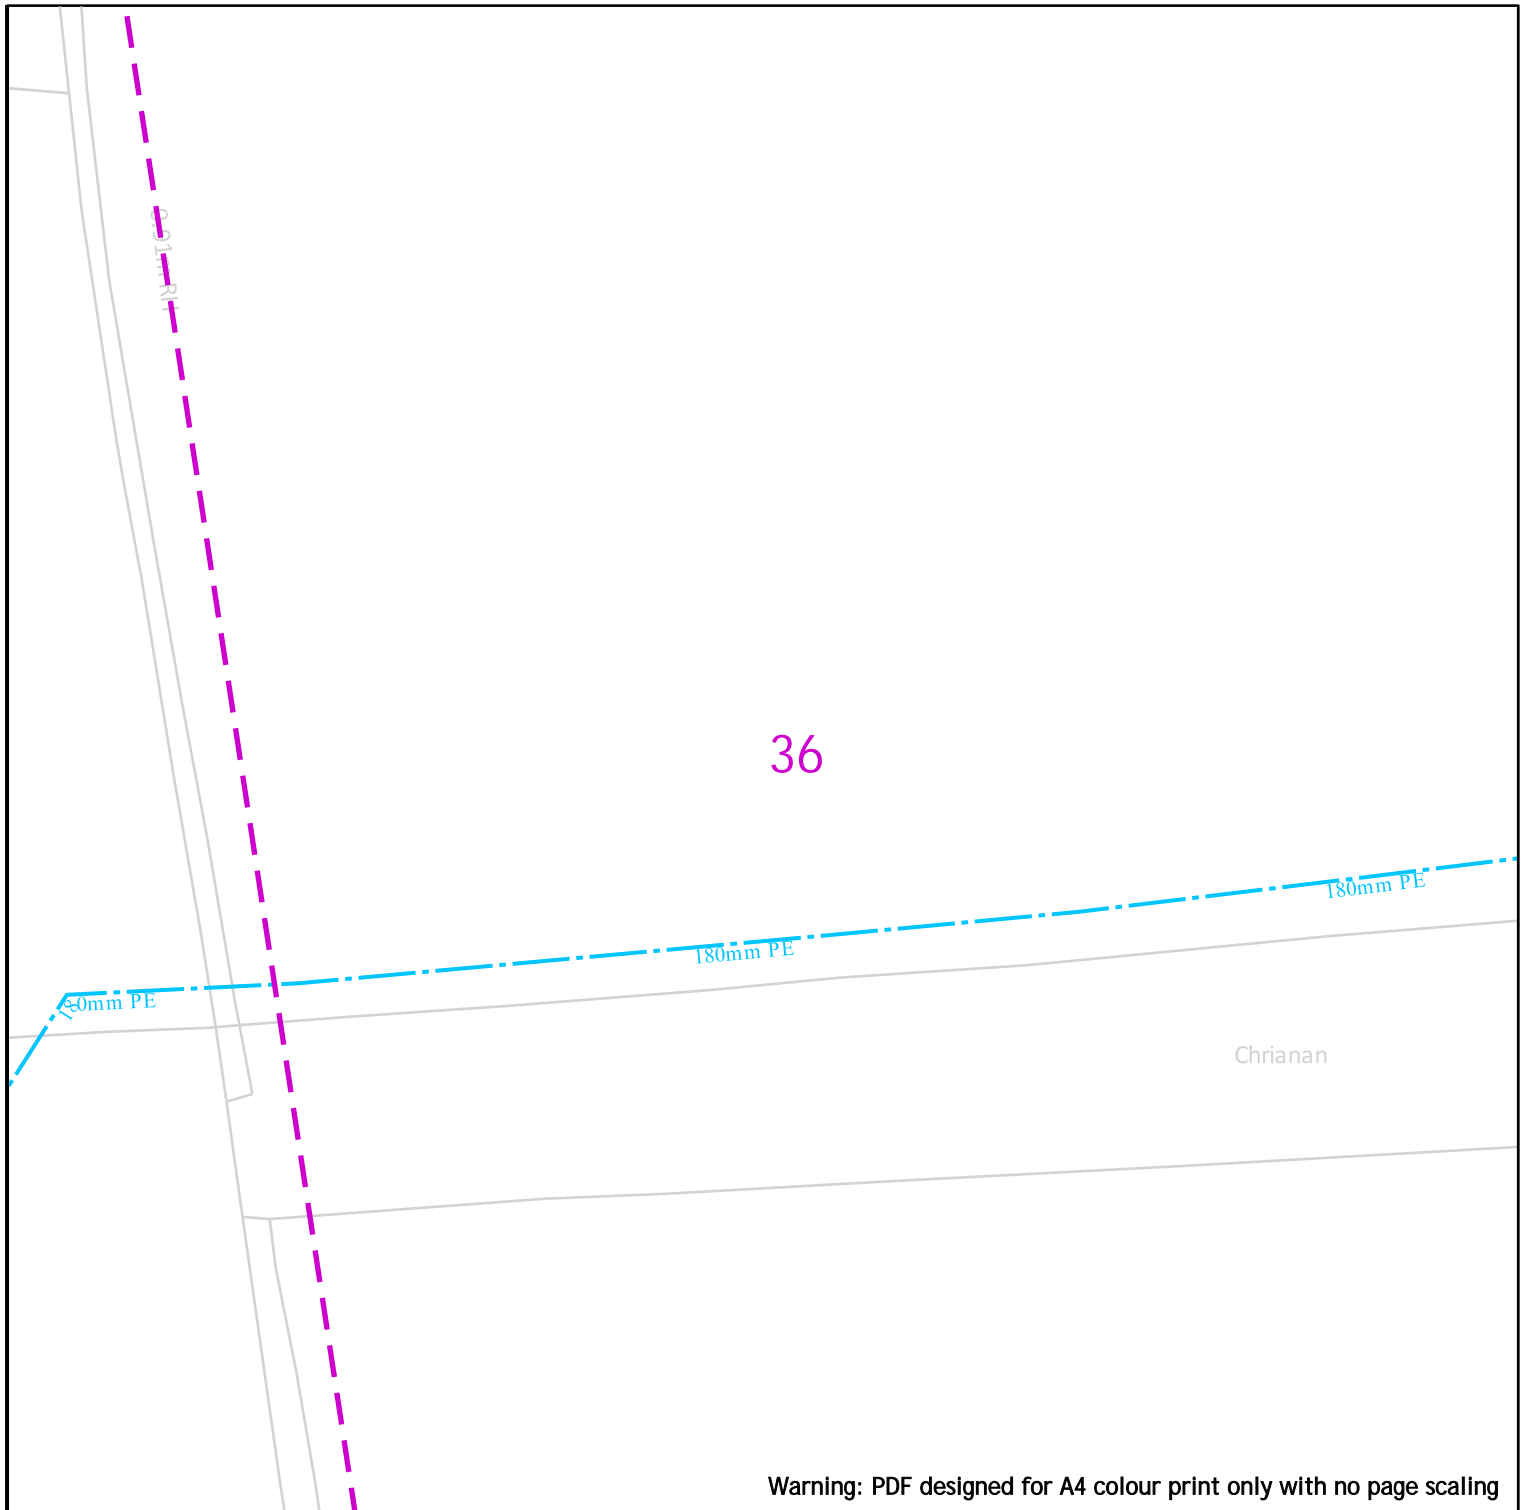

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites	Area:	Line:	
	LP Mains		Valve
	MP Mains		Depth of cover
	IP Mains		Syphon
	LHP Mains		Diameter Change
			Material Change
			Out of Standard Service




Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker  
 Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)  
 View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

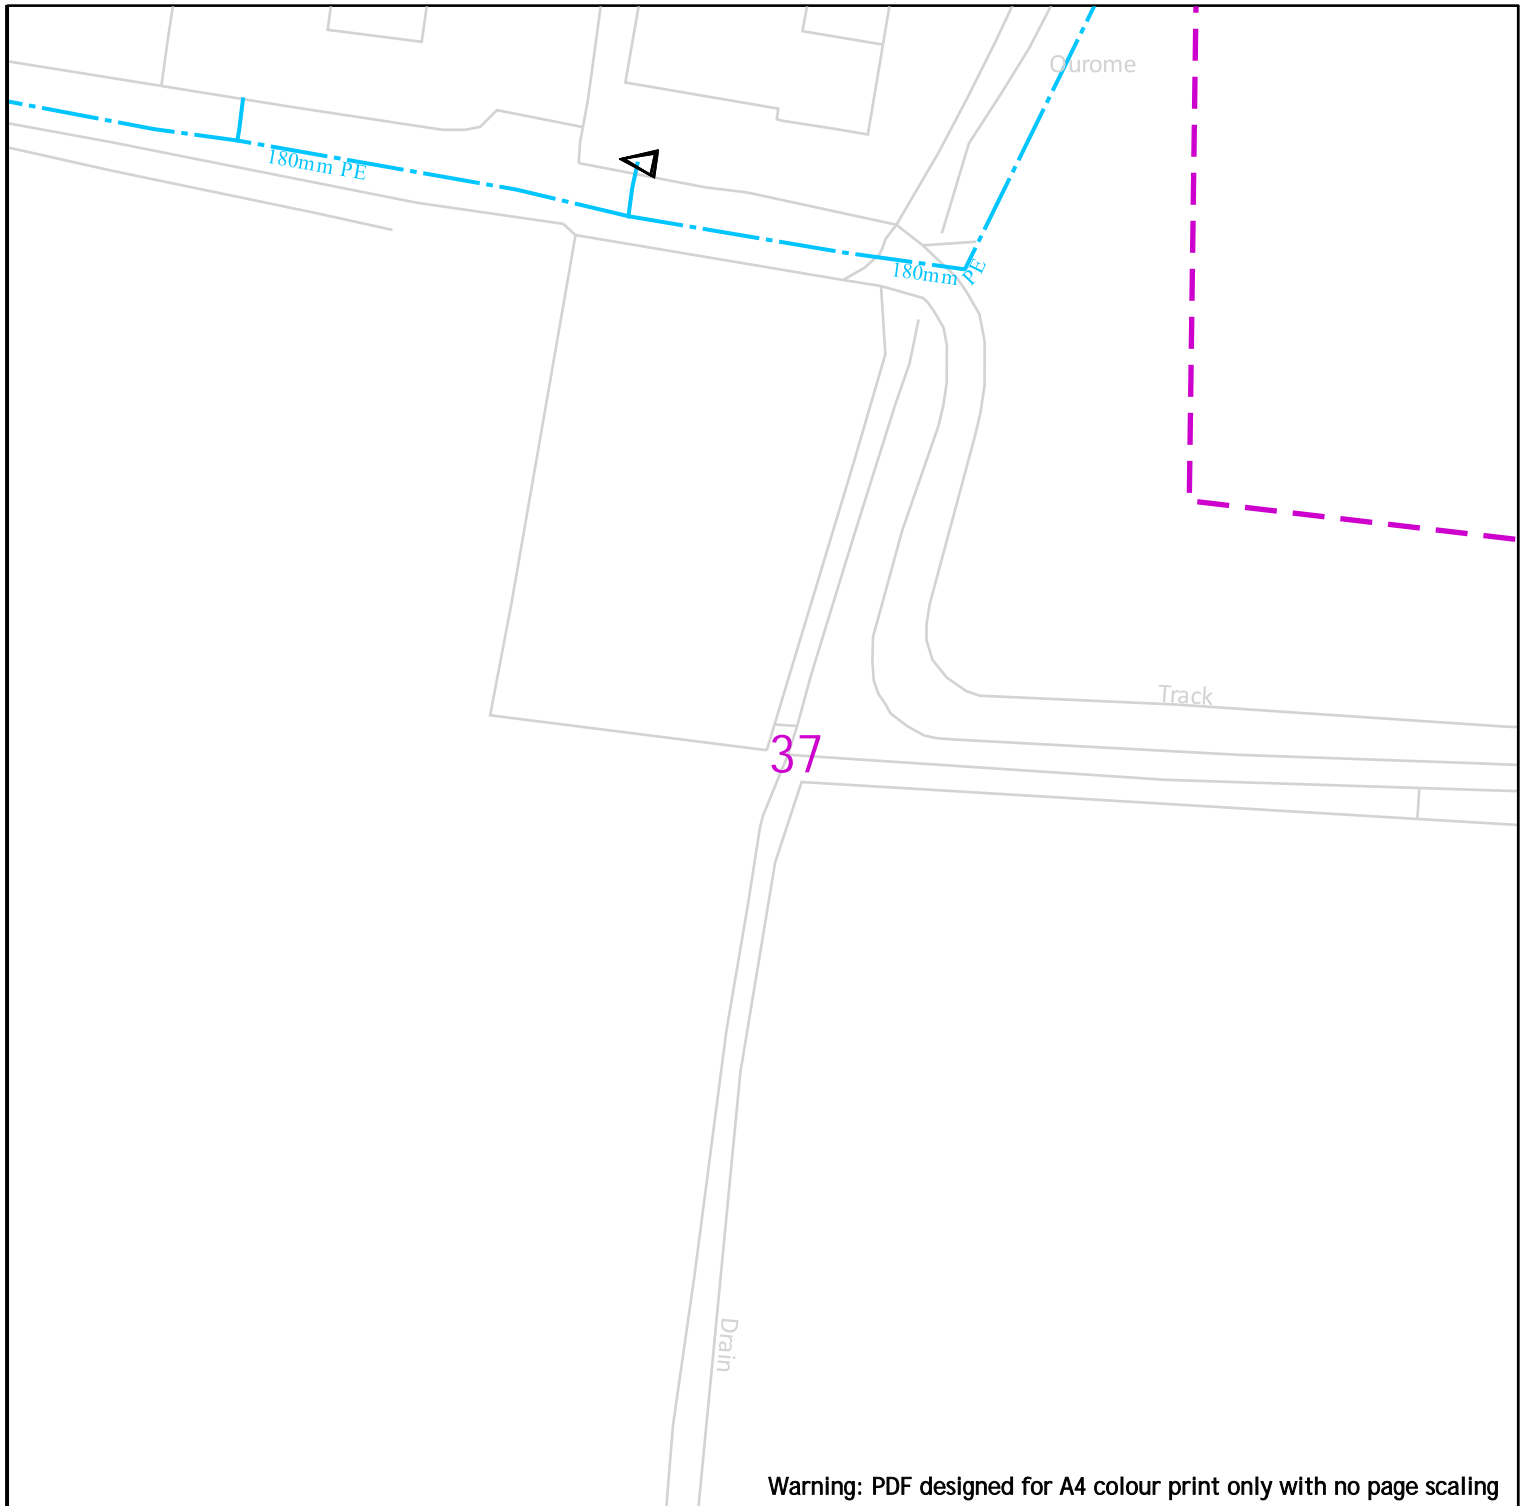

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

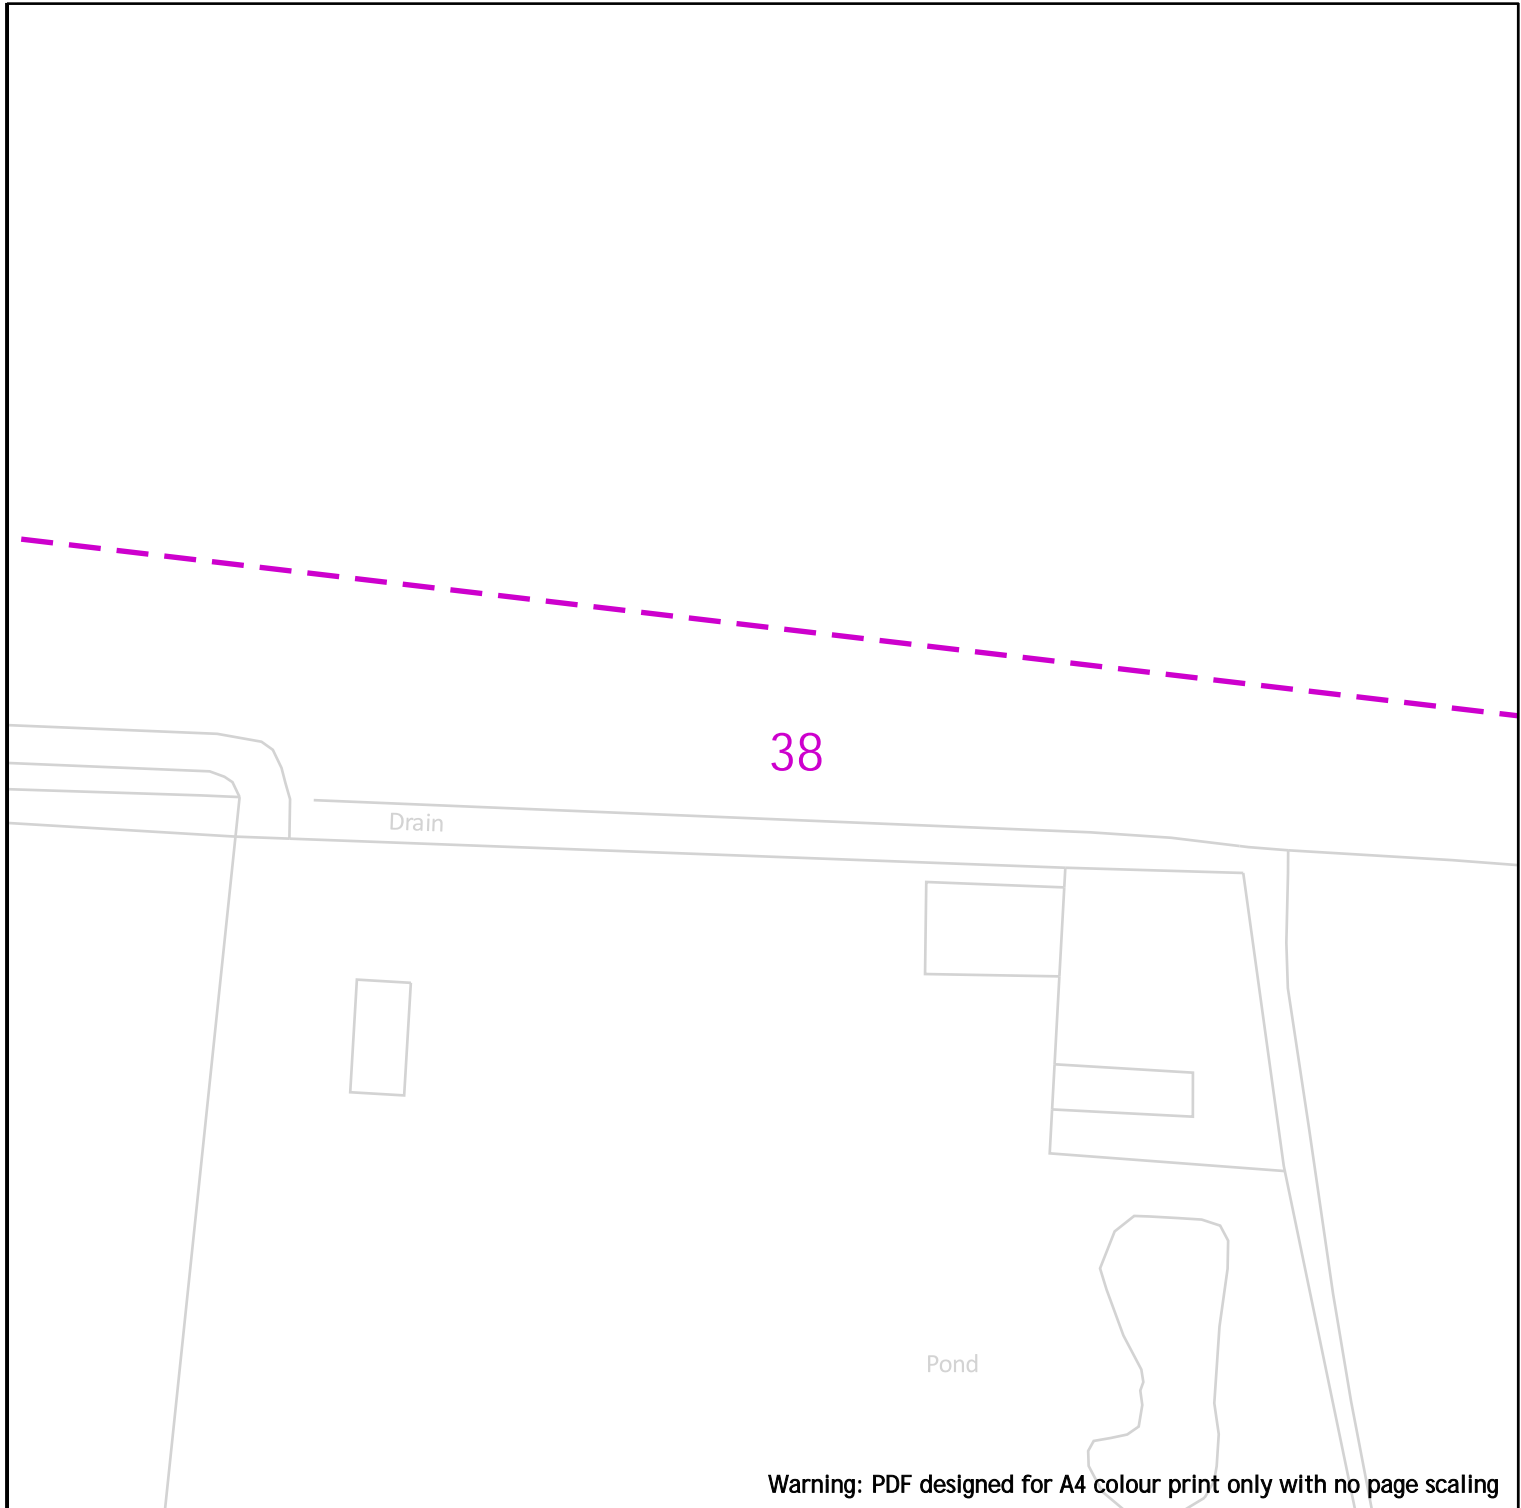

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker


Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

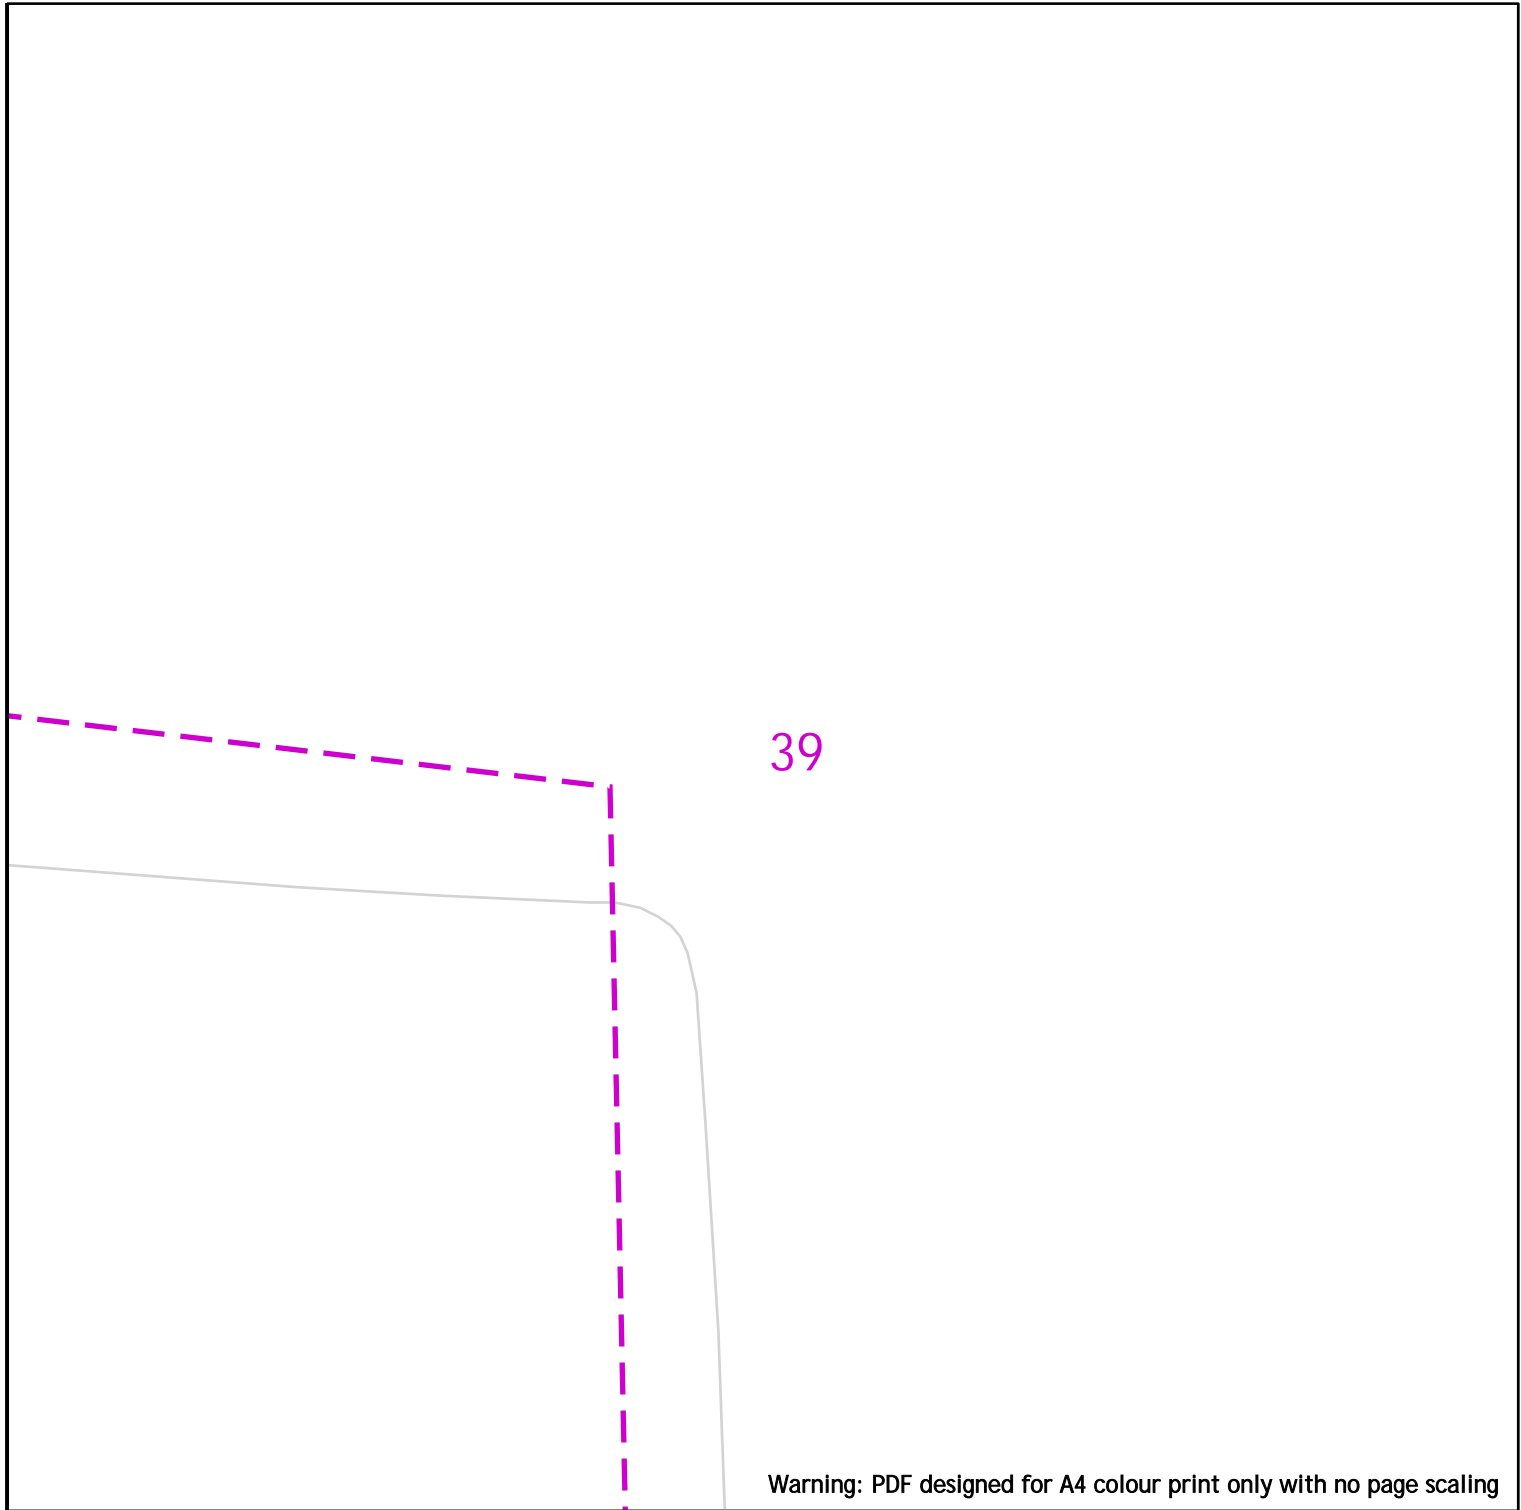

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:

- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service



**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker  
 Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

Scale: 1:500 (When plotted at A4)







40




Warning: PDF designed for A4 colour print only with no page scaling




 25m

Dig Sites      Area:       Line: 



-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains

-  Valve
-  Depth of cover
-  Syphon

-  Diameter Change
-  Material Change
-  Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

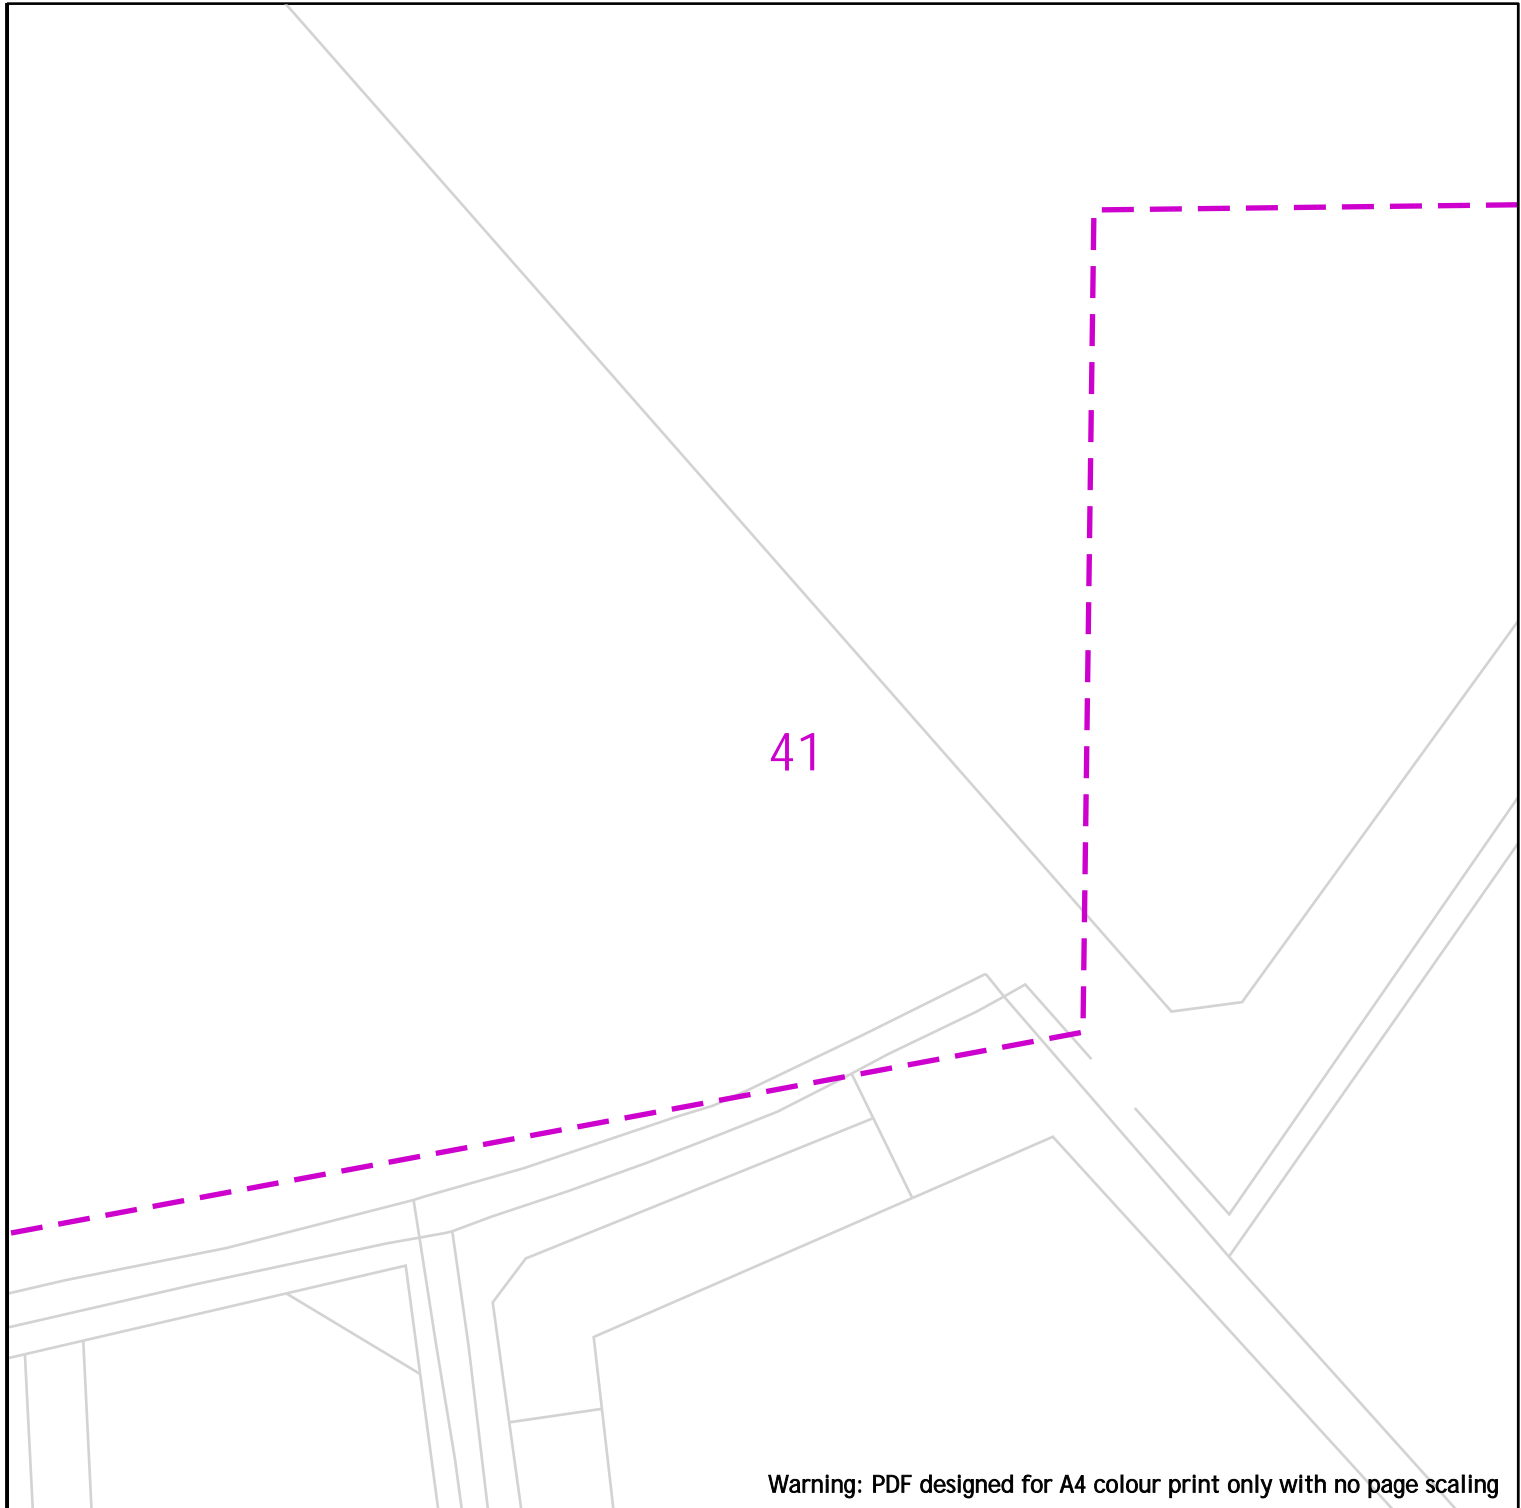


Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m


**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)


Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

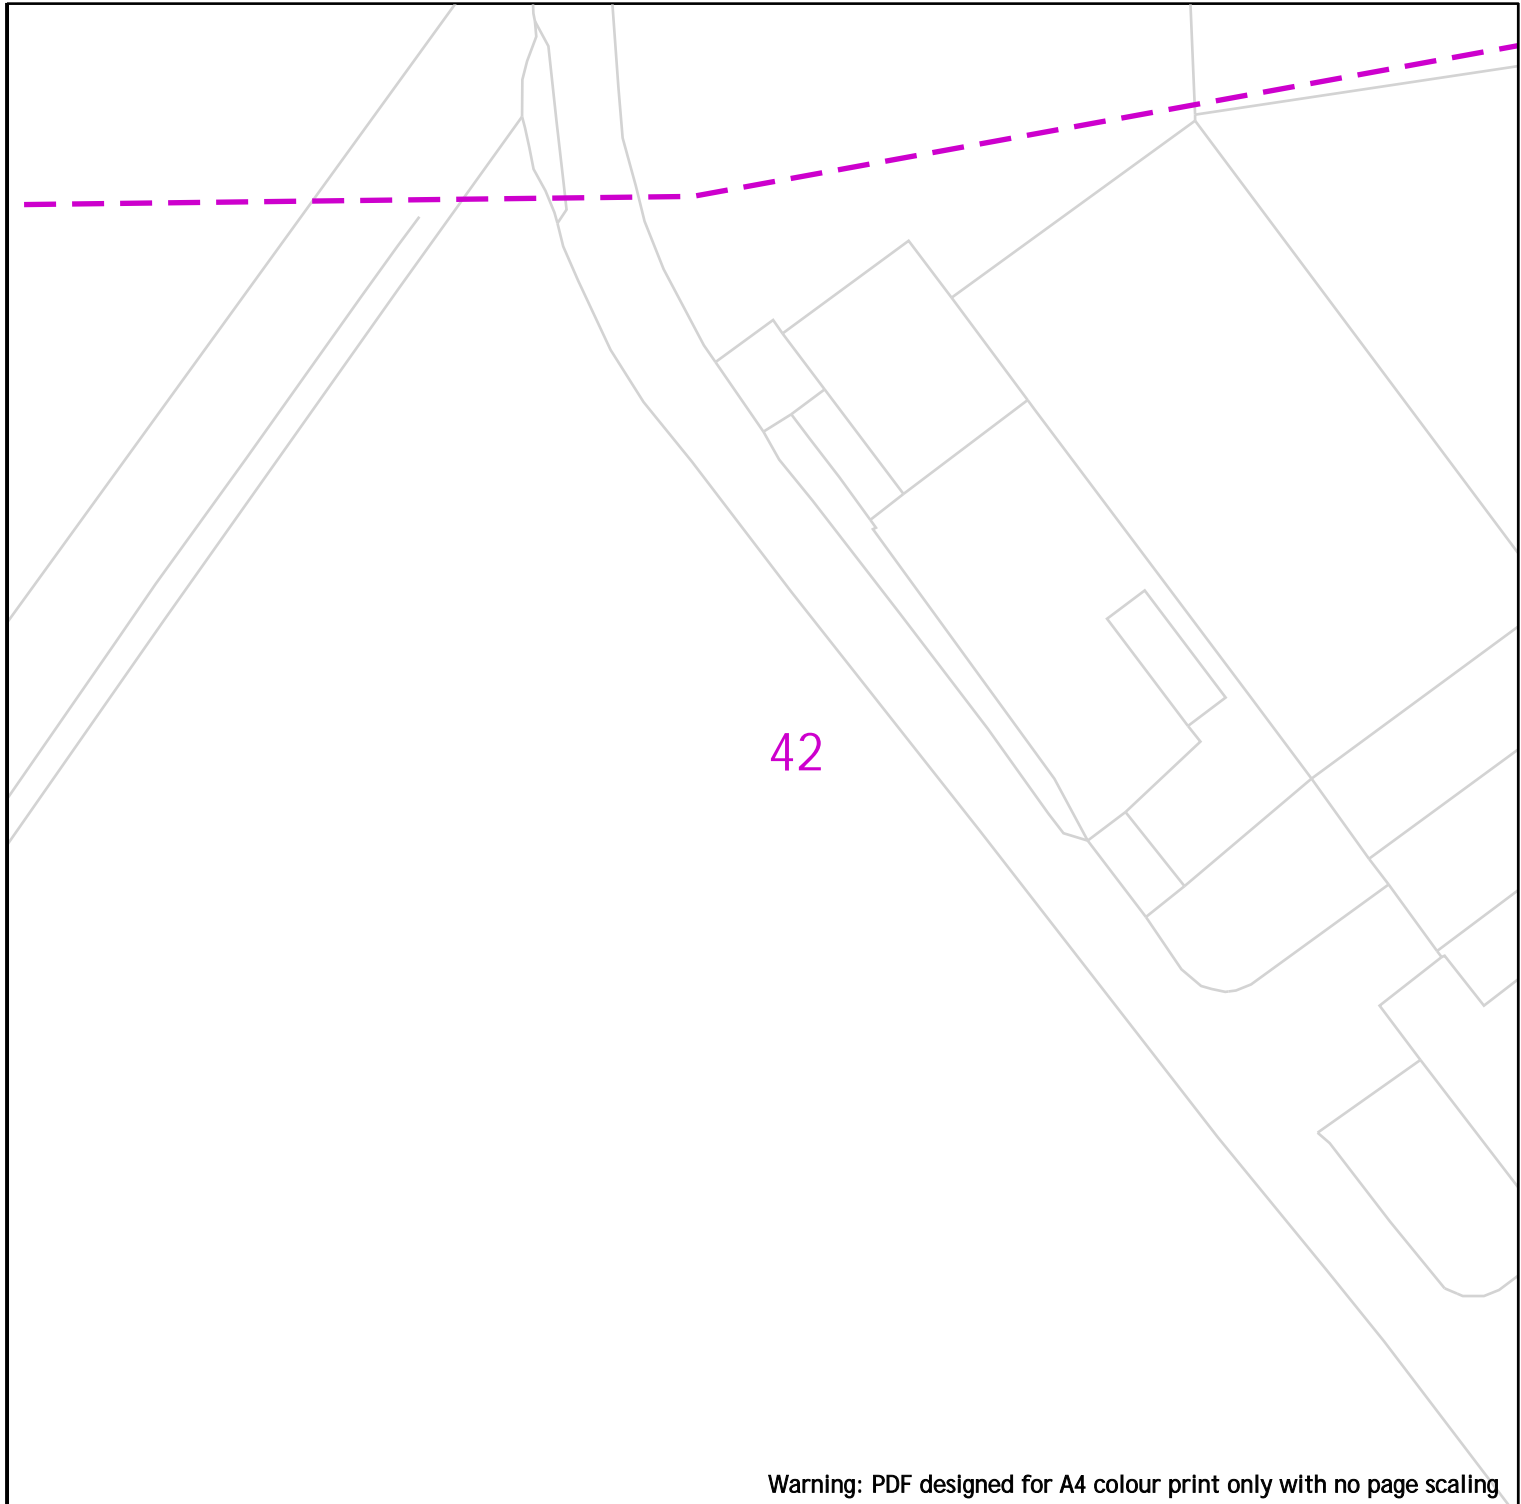


Warning: PDF designed for A4 colour print only with no page scaling

 25m


Dig Sites      Area:       Line: 



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve  
Depth of cover  
Syphon



Diameter Change  
Material Change  
Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m


#### IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

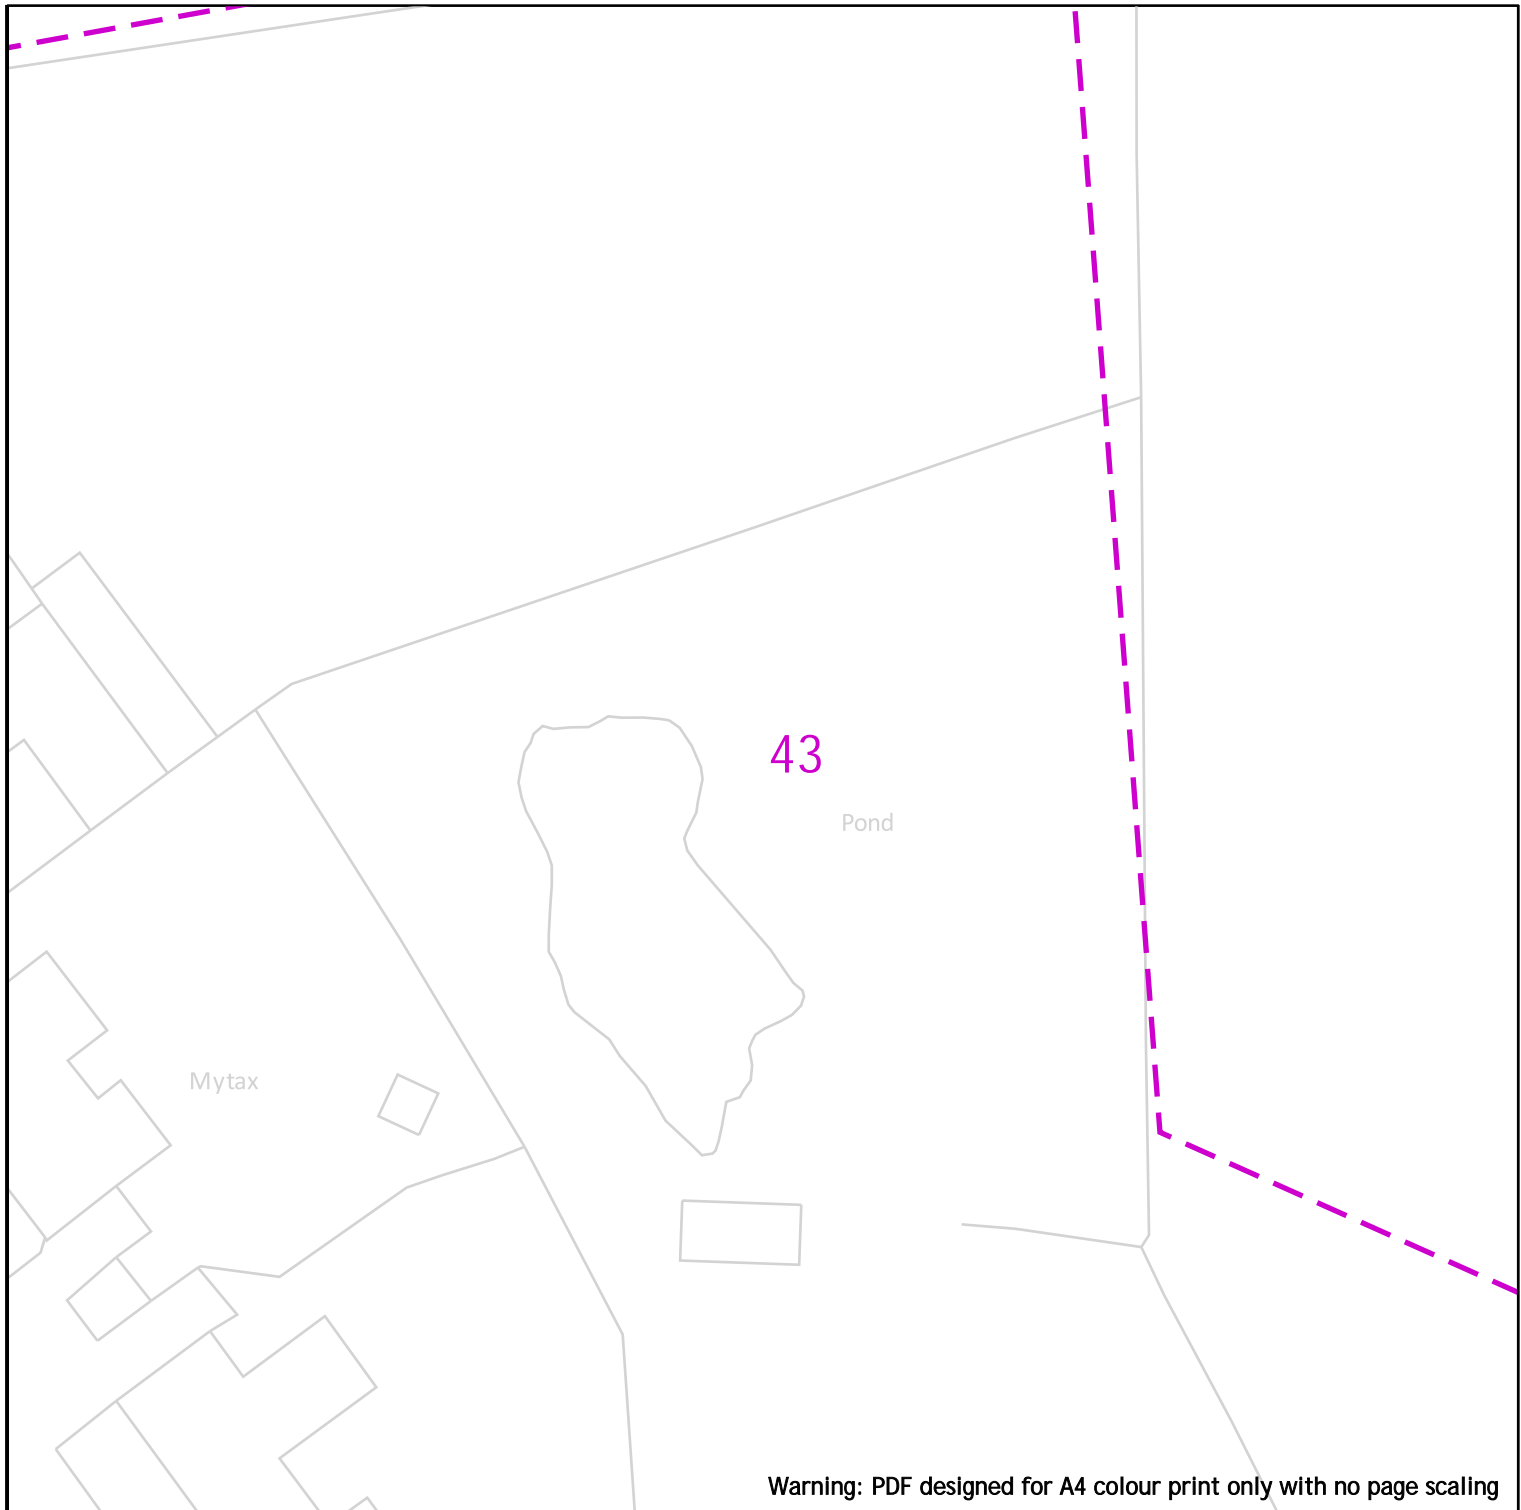

25m

Dig Sites

Area:

Line:

- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- |   |           |   |                |   |                         |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |   |                |   |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

**IMPORTANT NOTICES**


This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

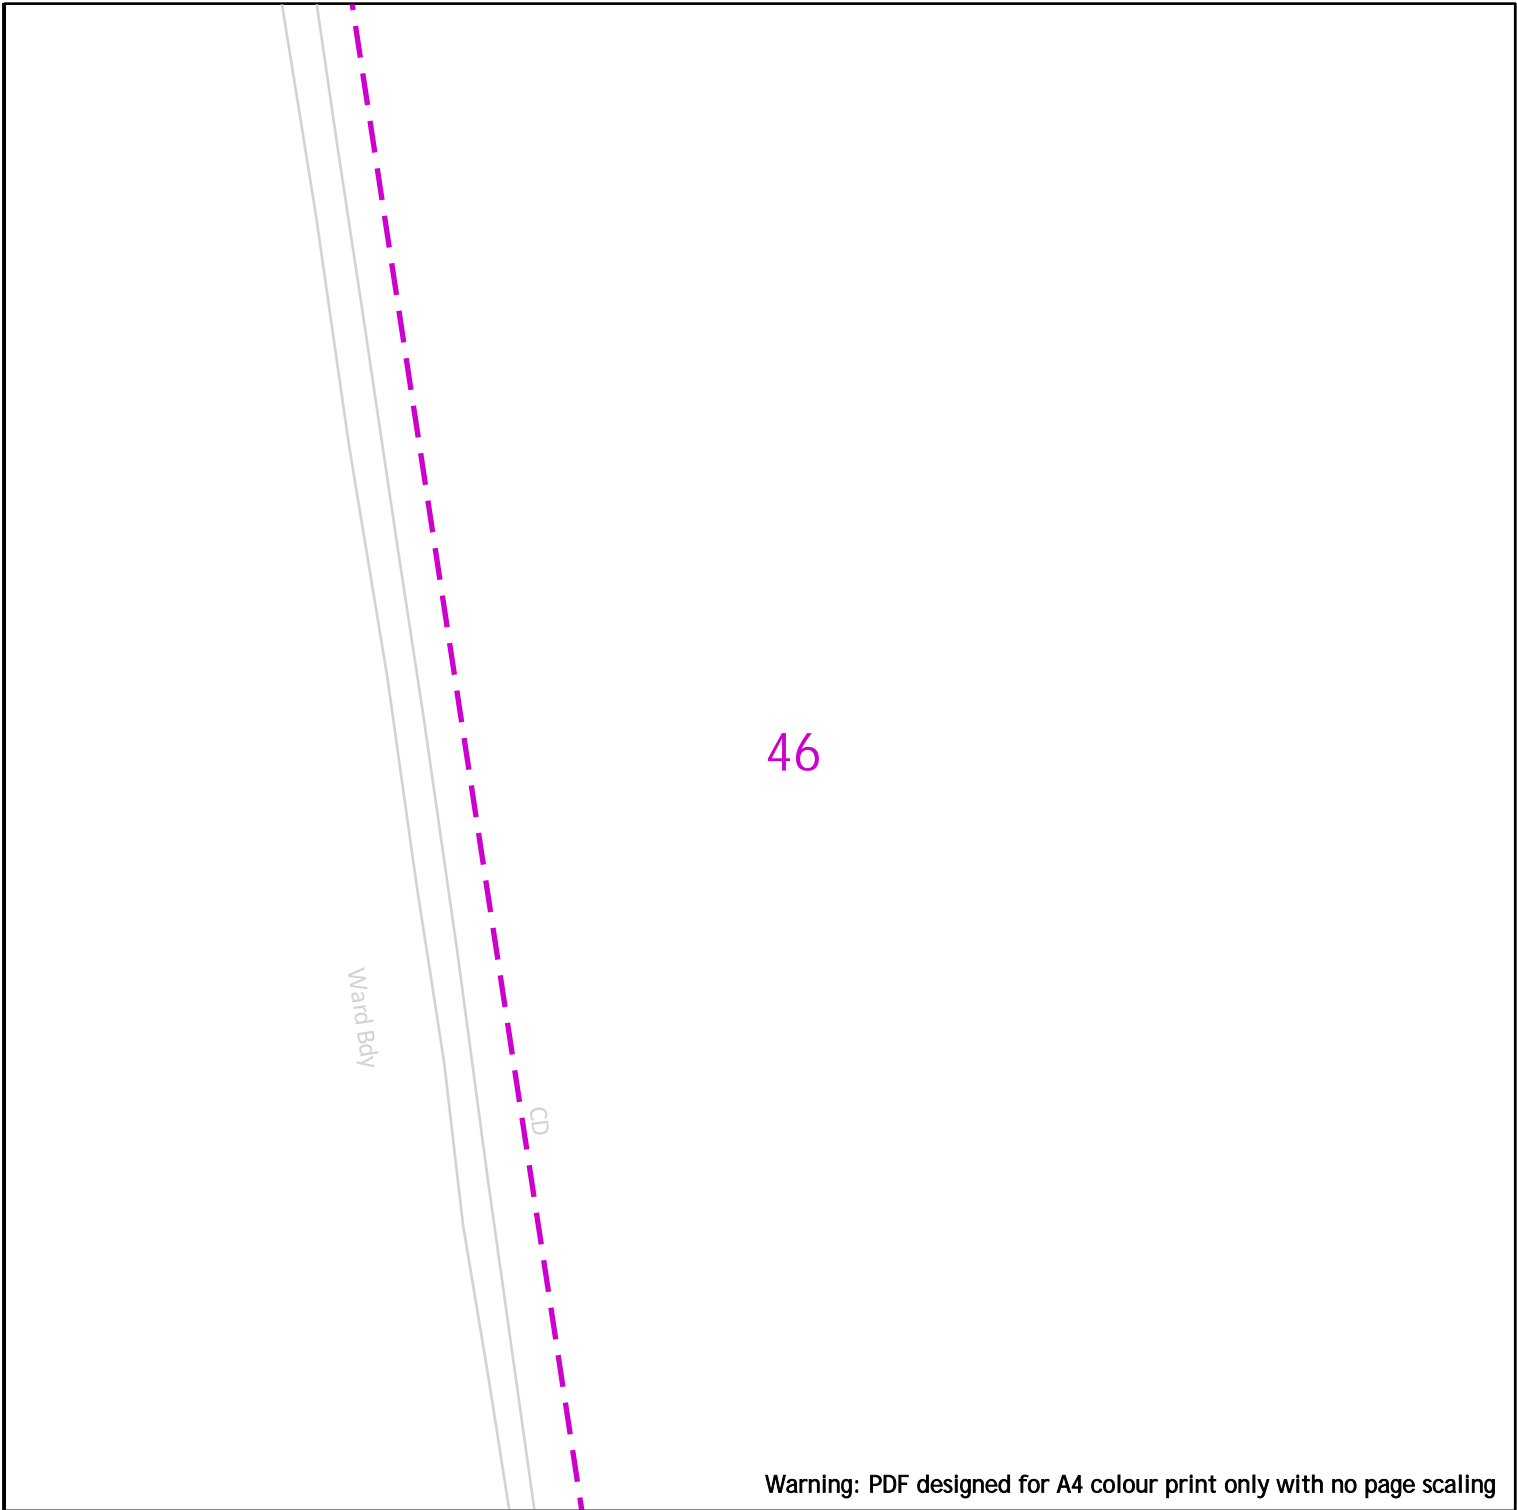

Warning: PDF designed for A4 colour print only with no page scaling

25m

- |                  |              |              |
|------------------|--------------|--------------|
| <b>Dig Sites</b> | <b>Area:</b> | <b>Line:</b> |
|                  | LP Mains     |              |
|                  | MP Mains     |              |
|                  | IP Mains     |              |
|                  | LHP Mains    |              |
|                  |              |              |
|                  |              |              |




Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker  
 Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)  
 View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**



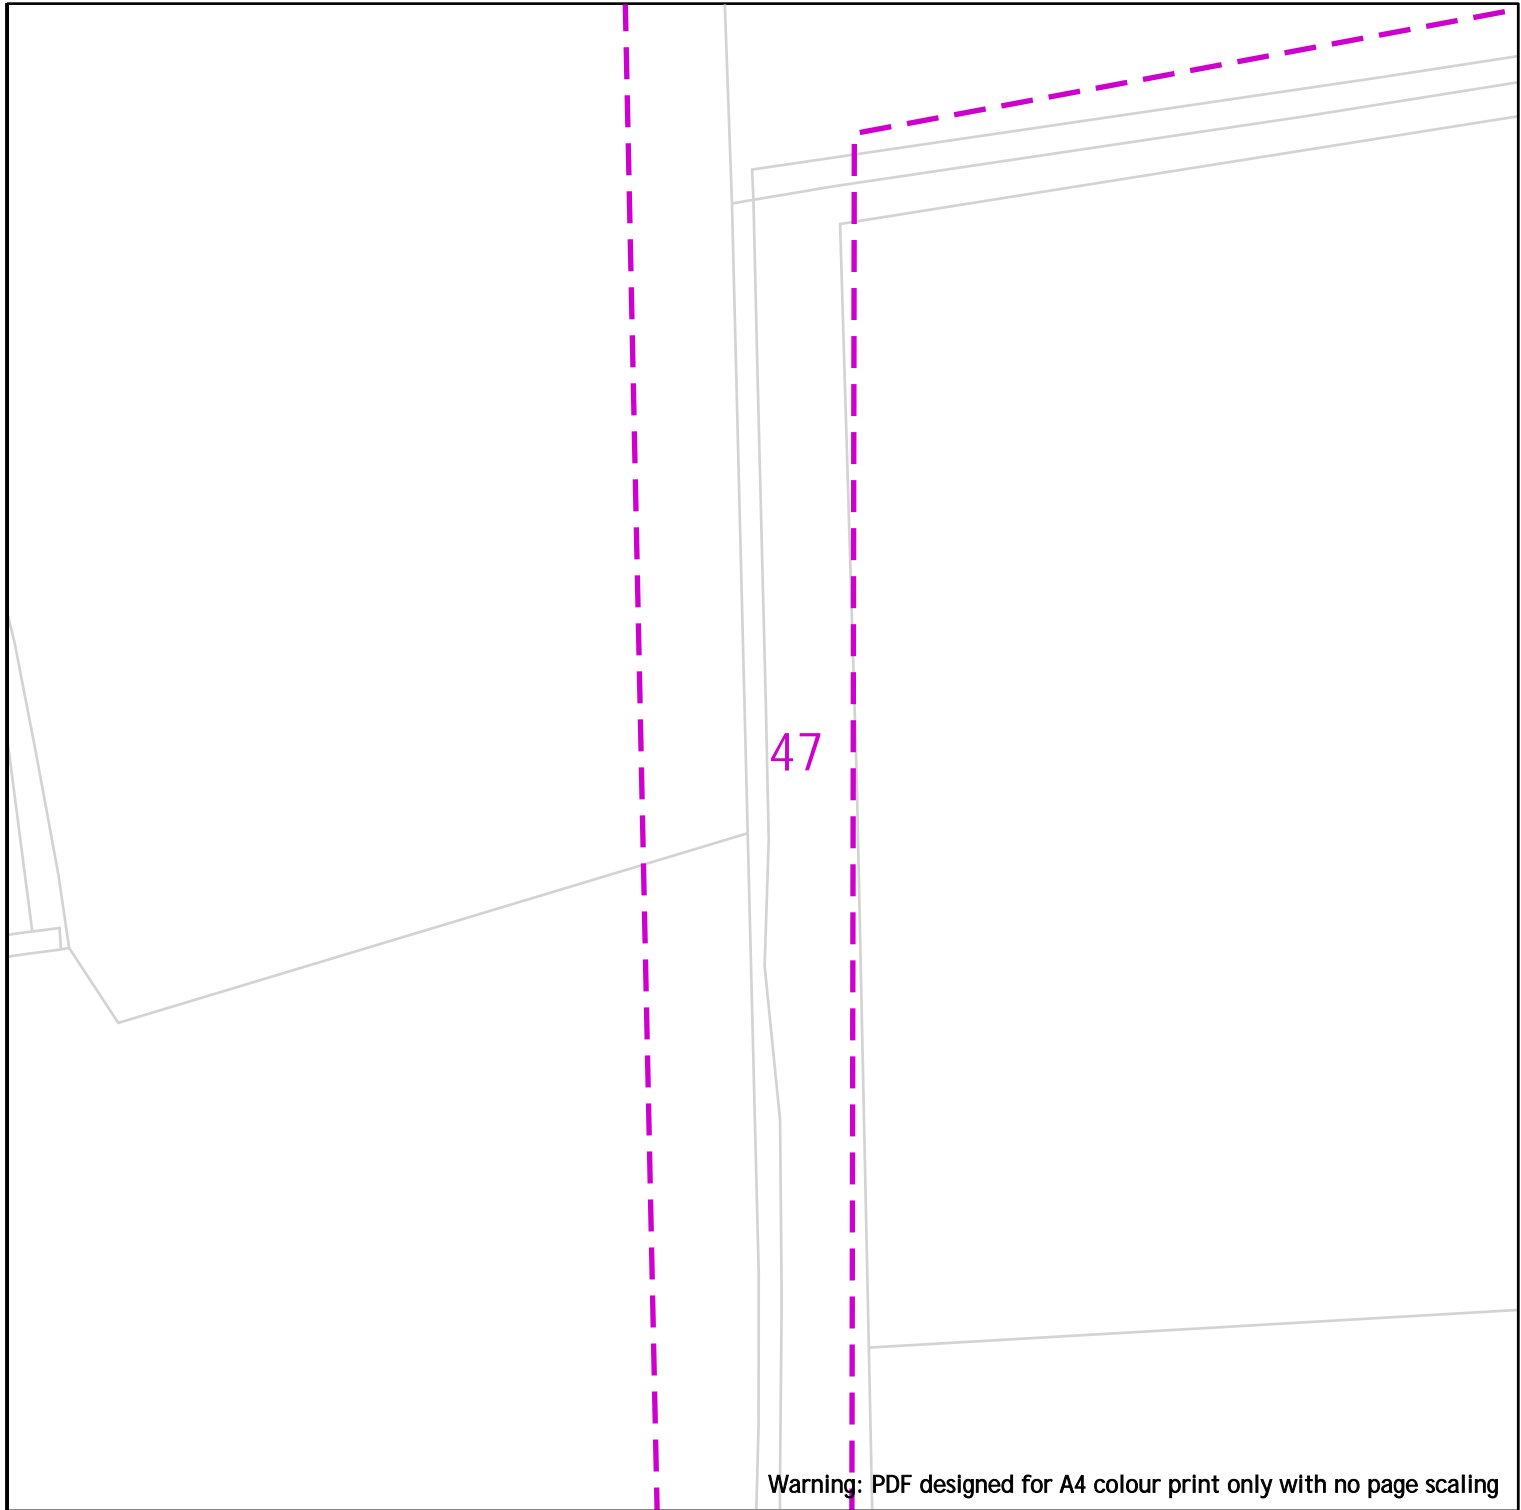

Scale: 1:500 (When plotted at A4)



Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites      Area:       Line: 

-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service



**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)







48




Warning: PDF designed for A4 colour print only with no page scaling




 25m

Dig Sites Area:  Line: 



	LP Mains
	MP Mains
	IP Mains
	LHP Mains

	Valve
	Depth of cover
	Syphon

	Diameter Change
	Material Change
	Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

49

Warning: PDF designed for A4 colour print only with no page scaling


 25m

Dig Sites

Area: 

Line: 

**Cadent**  
Your Gas Network



LP Mains  
MP Mains  
IP Mains  
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 24/08/2023  
Job Reference: 30622849  
Site Location: 337833 447563  
Requested by: Mr James Parker

Your Scheme/Reference:  
LCC/2023/0030/JMH (JP)

View extent: 100m, 100m


#### IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

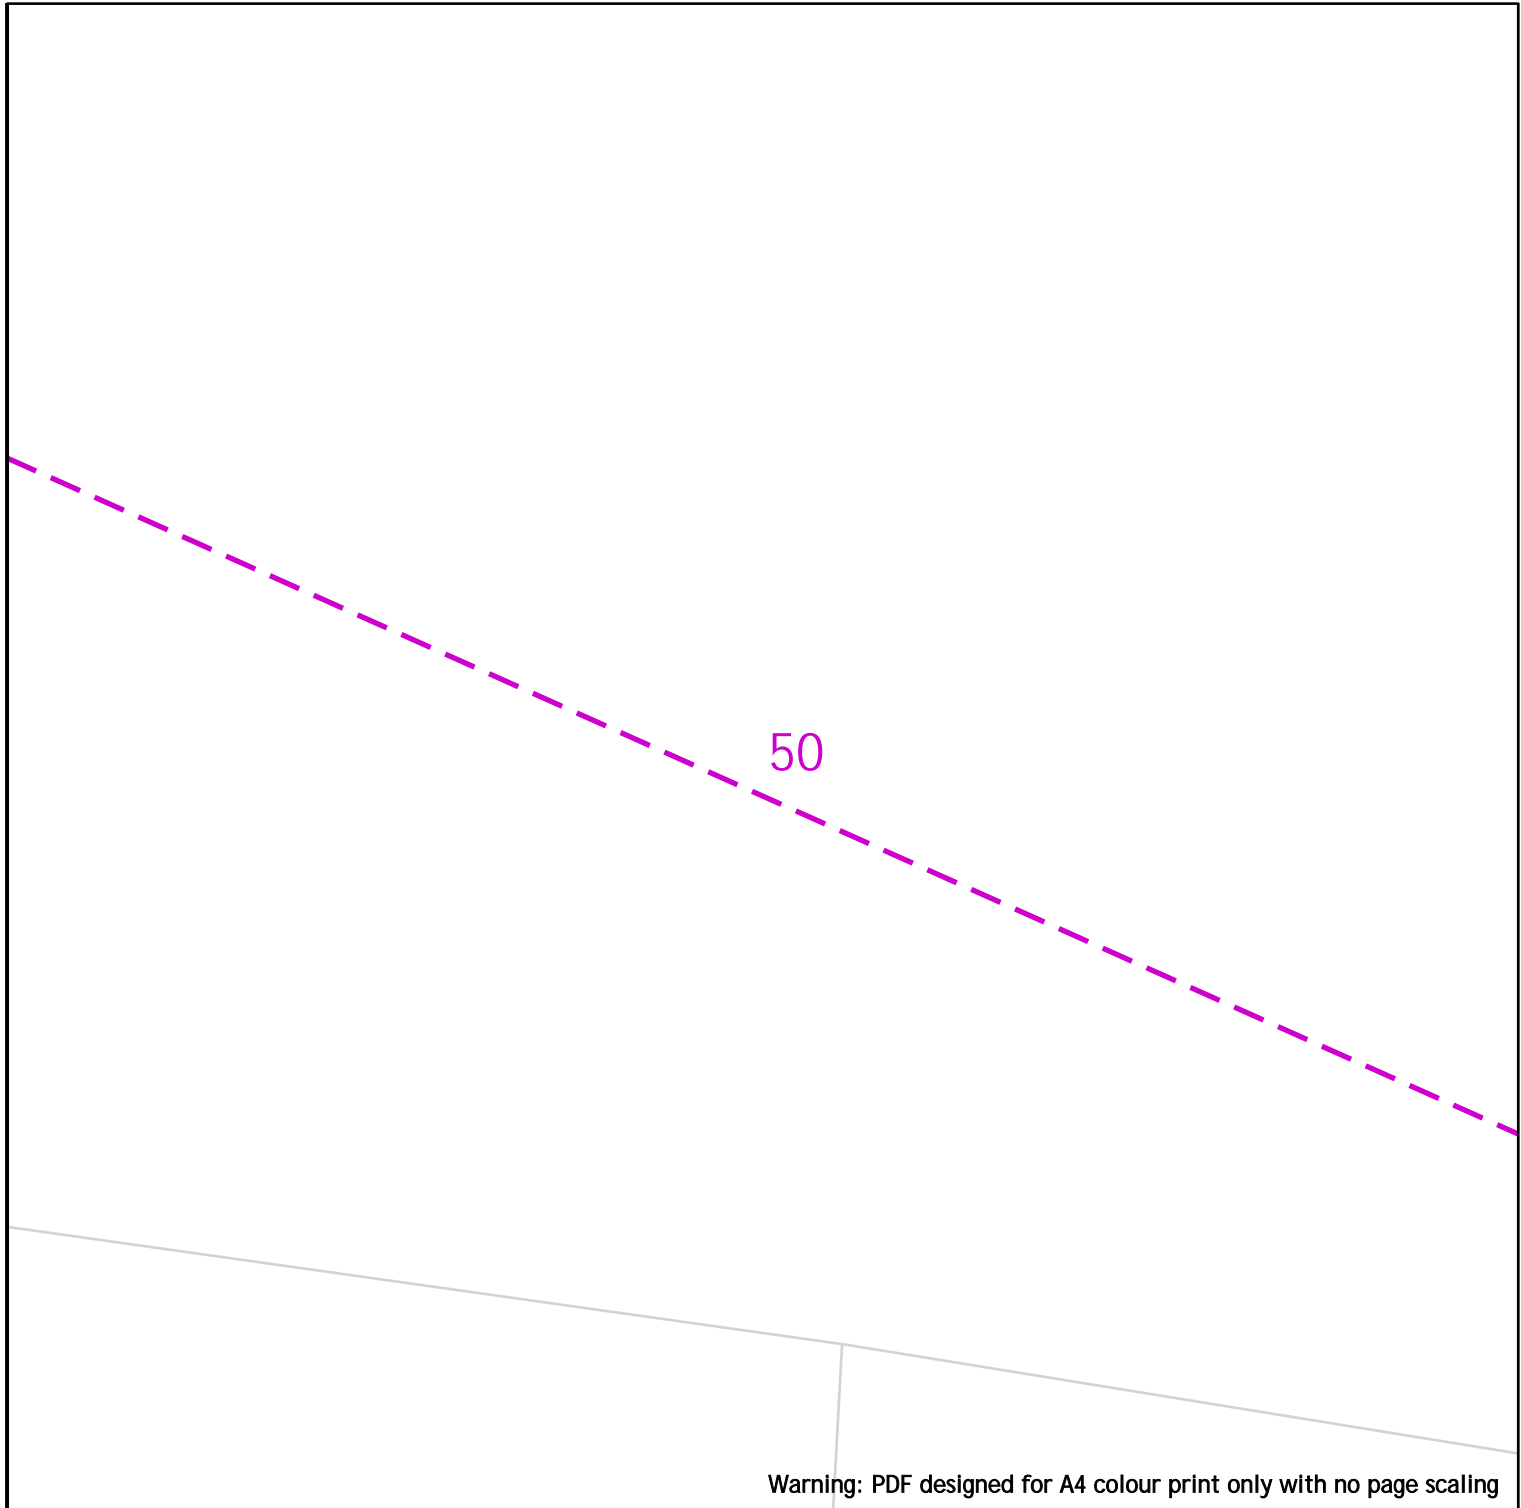

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:

- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

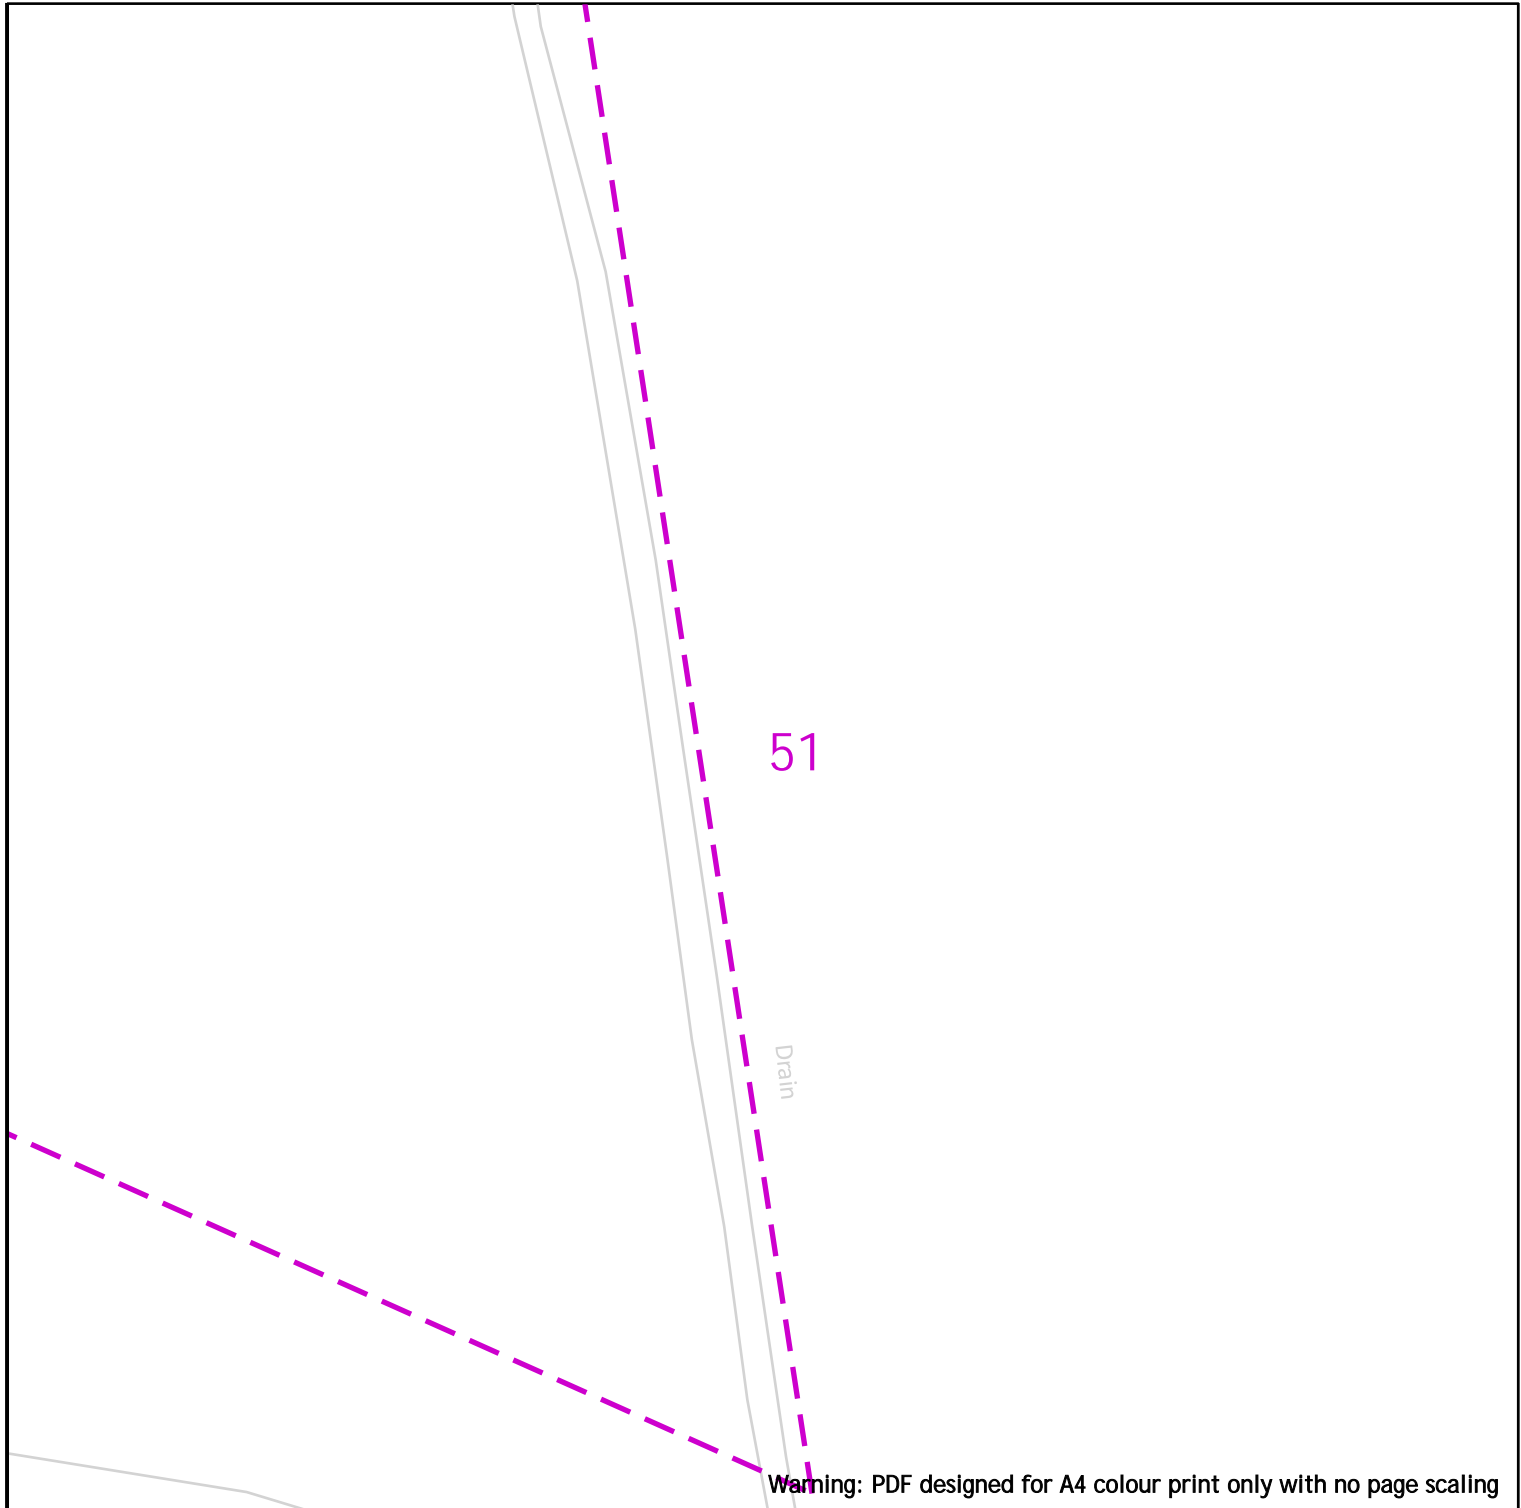

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:

- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service



Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

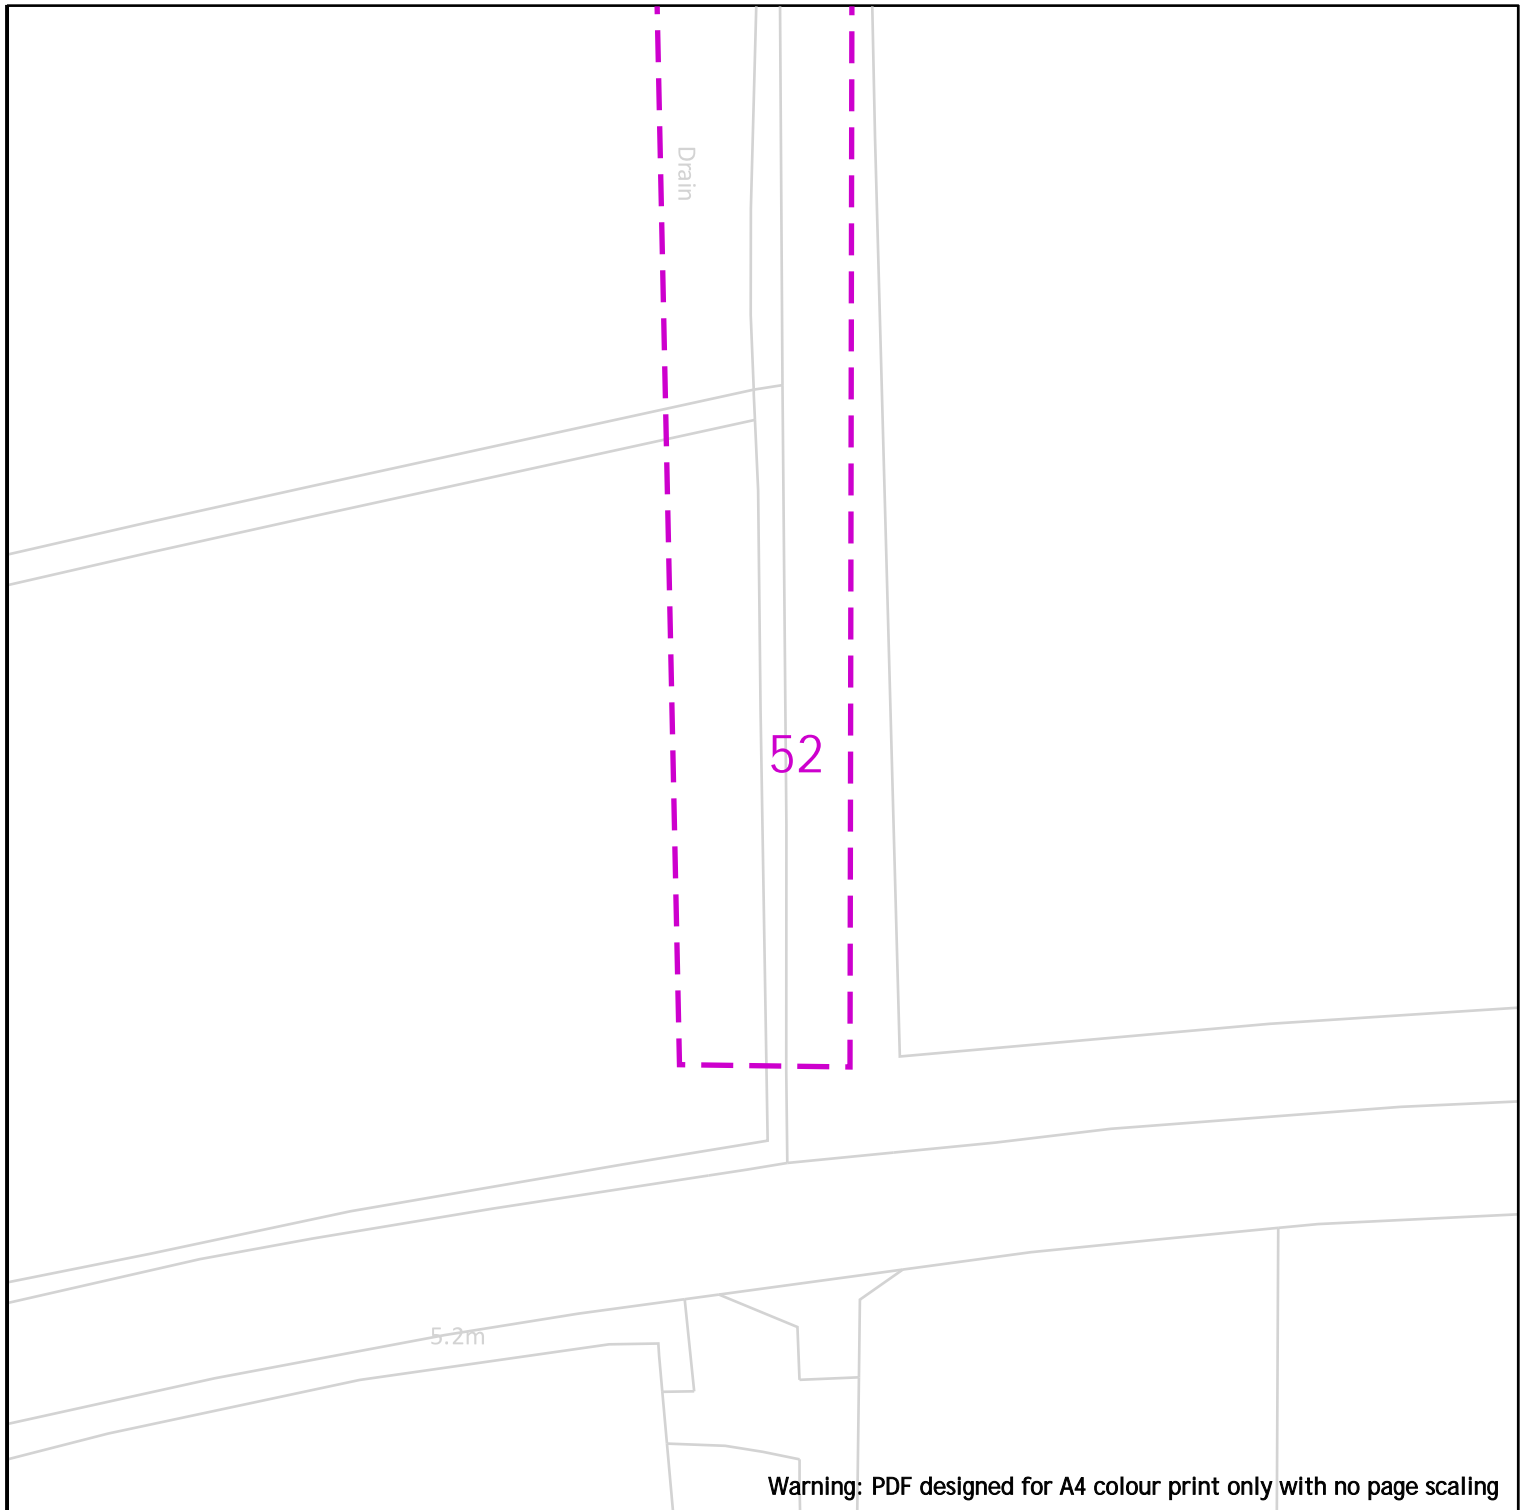

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites

Area:

Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Valve
- Depth of cover
- Syphon

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)


View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)

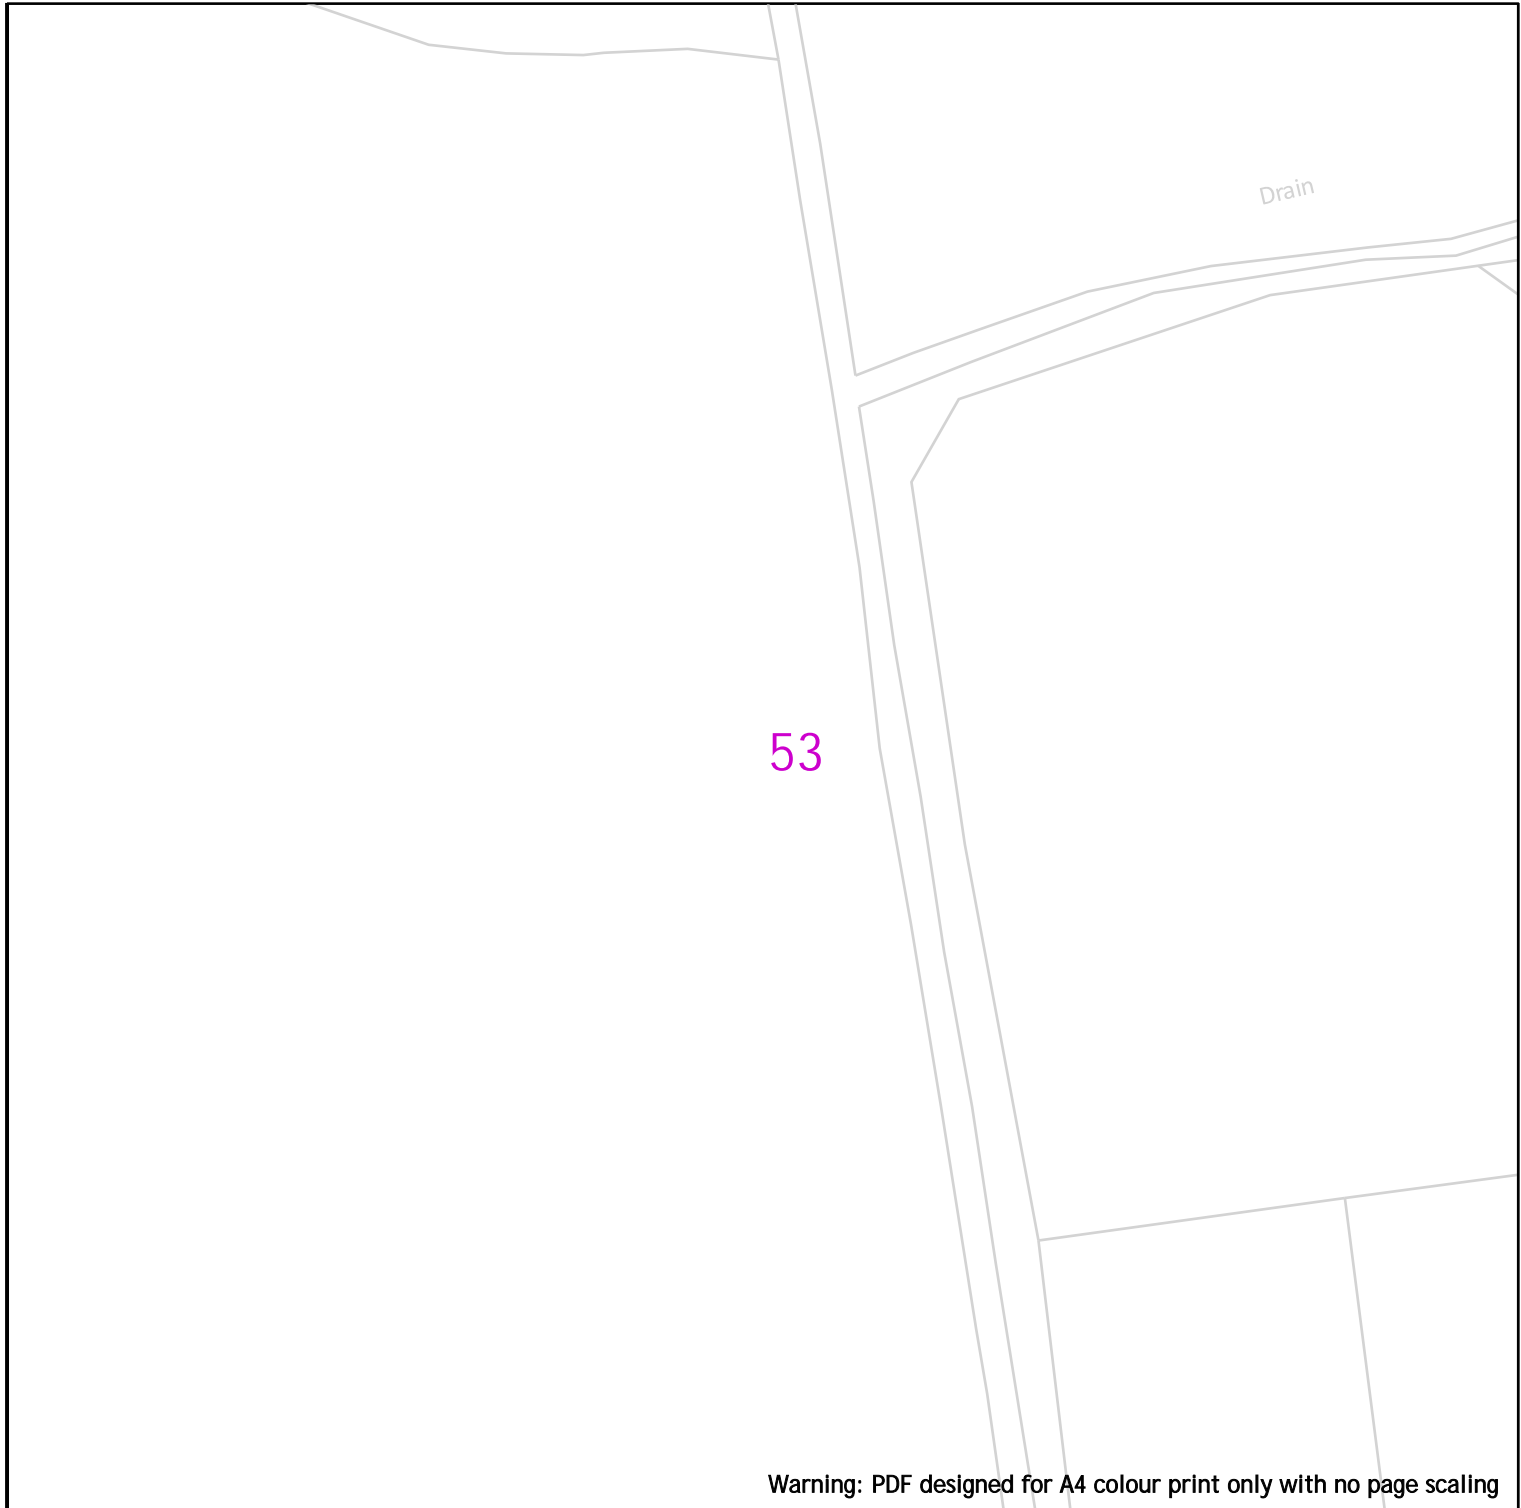

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites      Area:      Line:



- |  |           |  |                |  |                         |
|--|-----------|--|----------------|--|-------------------------|
|  | LP Mains  |  | Valve          |  | Diameter Change         |
|  | MP Mains  |  | Depth of cover |  | Material Change         |
|  | IP Mains  |  | Syphon         |  | Out of Standard Service |
|  | LHP Mains |  |                |  |                         |

Date Requested: 24/08/2023  
 Job Reference: 30622849  
 Site Location: 337833 447563  
 Requested by: Mr James Parker

Your Scheme/Reference:  
 LCC/2023/0030/JMH (JP)

View extent: 100m, 100m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of emergency call - 0800 111 999**

Scale: 1:500 (When plotted at A4)